

July 7, 2015

VIA EMAIL: usrb@cpuc.ca.gov

Charlotte TerKeurst
Electric Safety and Reliability Branch
Safety and Enforcement Division
California Public Utilities Commission
505 Van Ness Avenue
San Francisco, California 94102

Subject: General Order 165 Annual Report and General Order 174 Annual Report


Modesto Irrigation District (MID) voluntarily submits data consistent with the GO 165 Annual Report and GO 174 Annual Report to the Commission. MID is a publicly owned electric utility governed by its elected board of directors. MID's voluntary submittal of the requested reports to the Commission shall not in any way be interpreted as an admission of any obligation under the cited General Orders, nor shall it constitute a waiver of the right to object to any future Commission request or assertion of jurisdiction.

Subject to the foregoing, enclosed are MID's reports for 2014.

If you have any questions regarding this matter, please contact Ed Franciosa, Assistant General Manager, Transmission and Distribution, (209) 5267429.

Sincerely,

MODESTO IRRIGATION DISTRICT

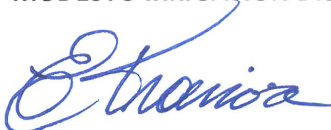

Ed Franciosa
AGM, Transmission and Distribution

Enclosures: MID's GO 165 Annual Report for 2014
MID's GO 174 Annual Report for 2014

2014 GO 165 Electric Distribution Inspection Summary

Type of Inspection	Due	Outstanding
OH Detailed	7002	0
Subsurface Detailed	1507	0
Padmounts Detailed	839	0
Intrusive Wood Pole	0	0
Patrol (by substation circuits)	All circuits	All completed

Notes:

- 1) OH Detail includes all poles. This is a 5 year cycle.
- 2) Subsurface is all subsurface transformers, boxes and switch gear. This is a 3 year cycle.
- 3) Padmounts includes transformers and pad mounted switch gear. This is a 5 year cycle.
- 4) Intrusive inspections completed in 2012 will start again in 2023.
- 5) All inspections that were due have been completed.
- 6) Patrols are done annually on 100% of our electrical system.

2014 GO 174 Substation Inspection Summary

Scheduled	Completed	Outstanding
168	989	0

Notes:

1. Includes all 41 MID Substations
2. MID OB 49 requires only Quarterly inspections (41 Substations) and MID practice is to inspect each station bi-monthly.