




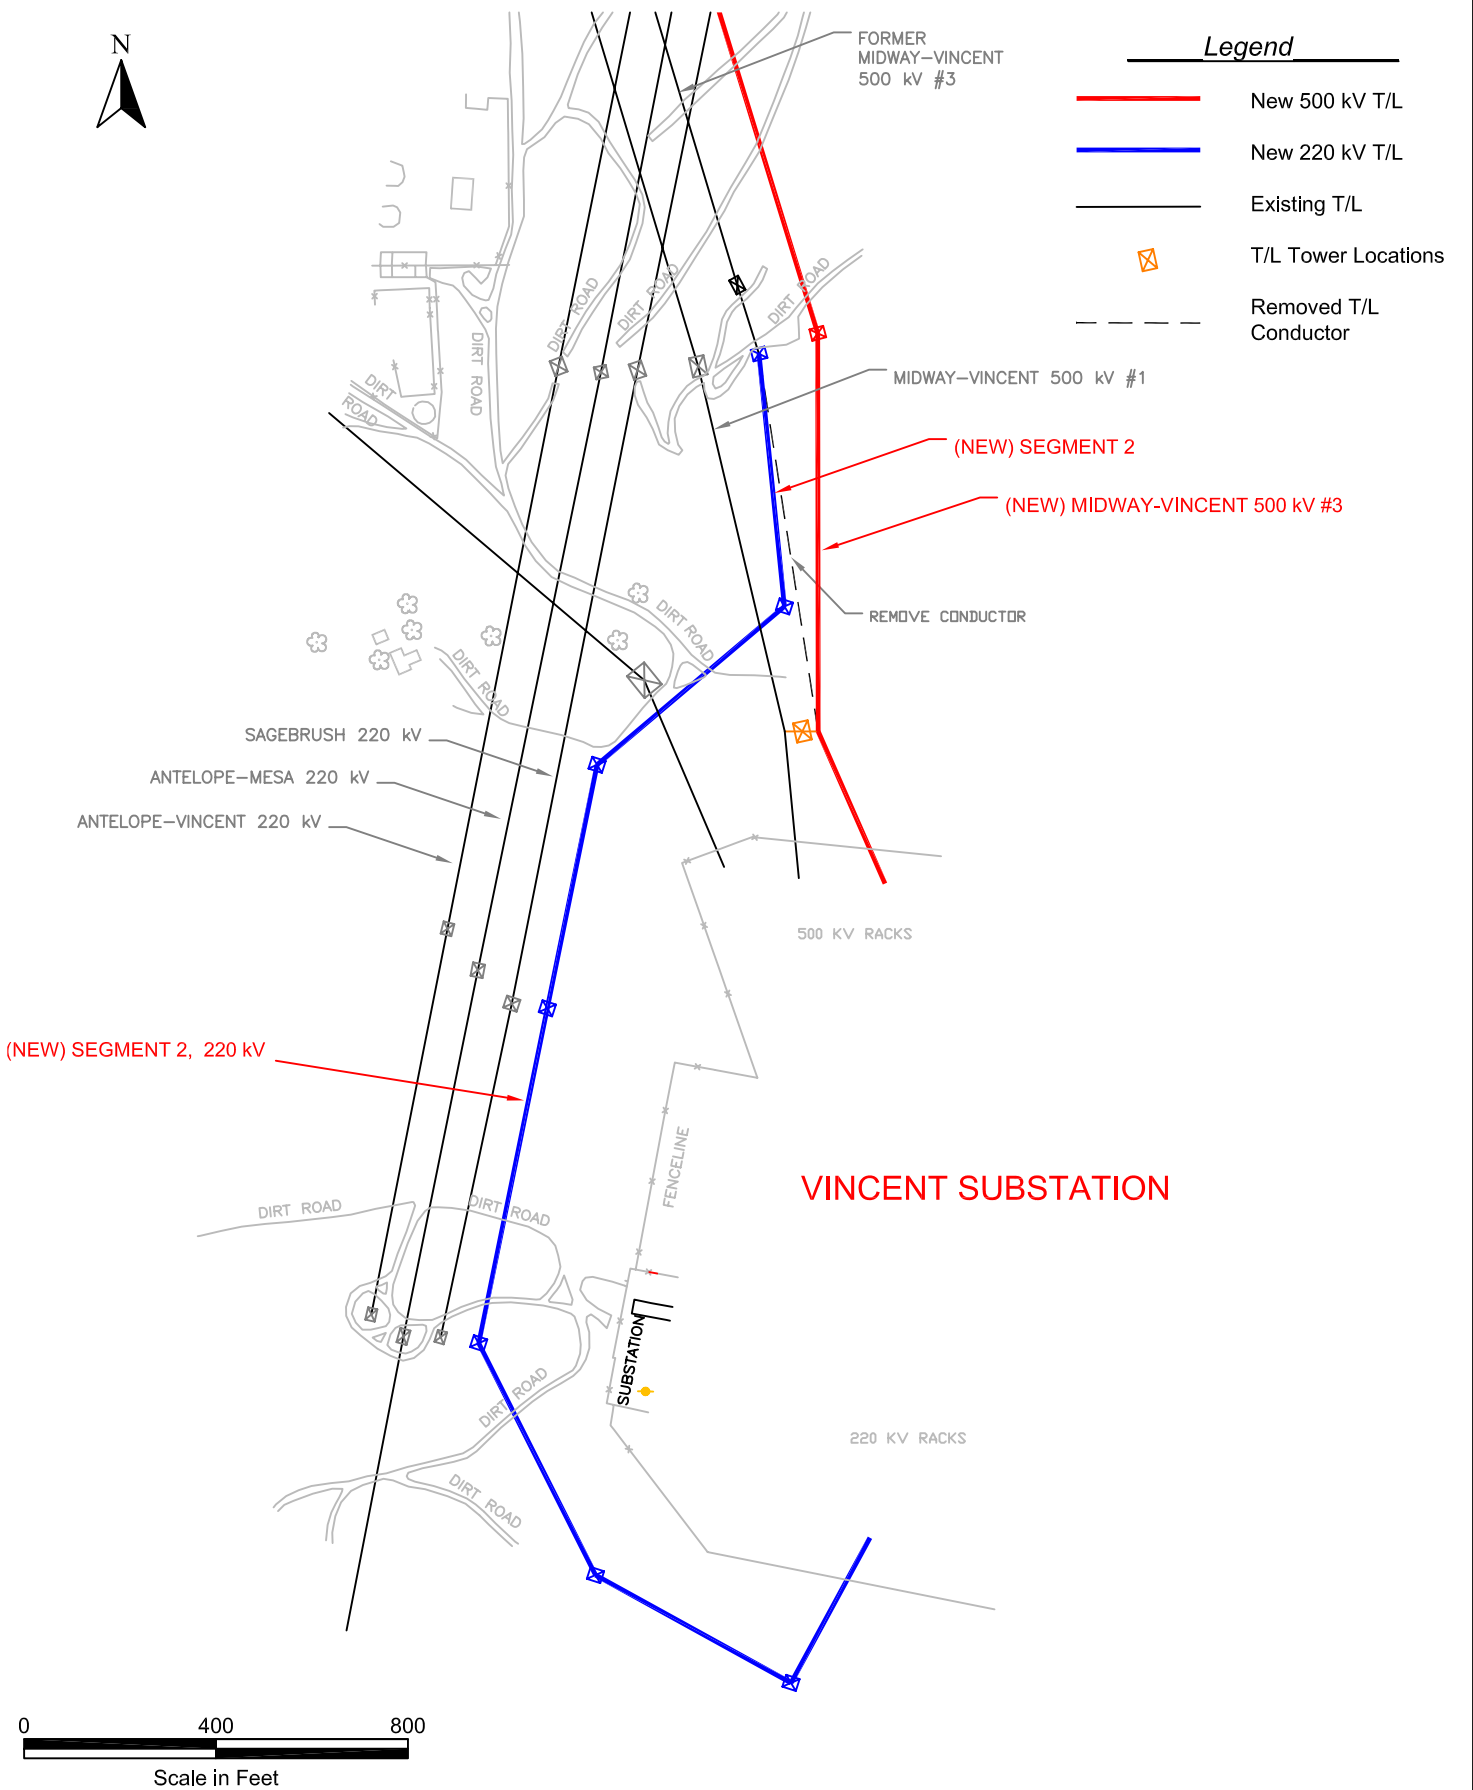




**Legend**

-  New 500 kV T/L
-  New 220 kV T/L
-  Existing T/L
-  T/L Tower Locations
-  Removed T/L Conductor



T:\SCE\Antelope\Segments 2 & 3\2005\Fig. 3-4B.dwg (derived from Fig. 3-9.dwg) 9/15/05



Antelope Transmission Project PEA Segments 2 & 3

Figure 3-4B. LINE CROSSINGS AND CONFIGURATION OF SEGMENT 2 500 KV AND 220 KV LINES NEAR THE VINCENT SUBSTATION