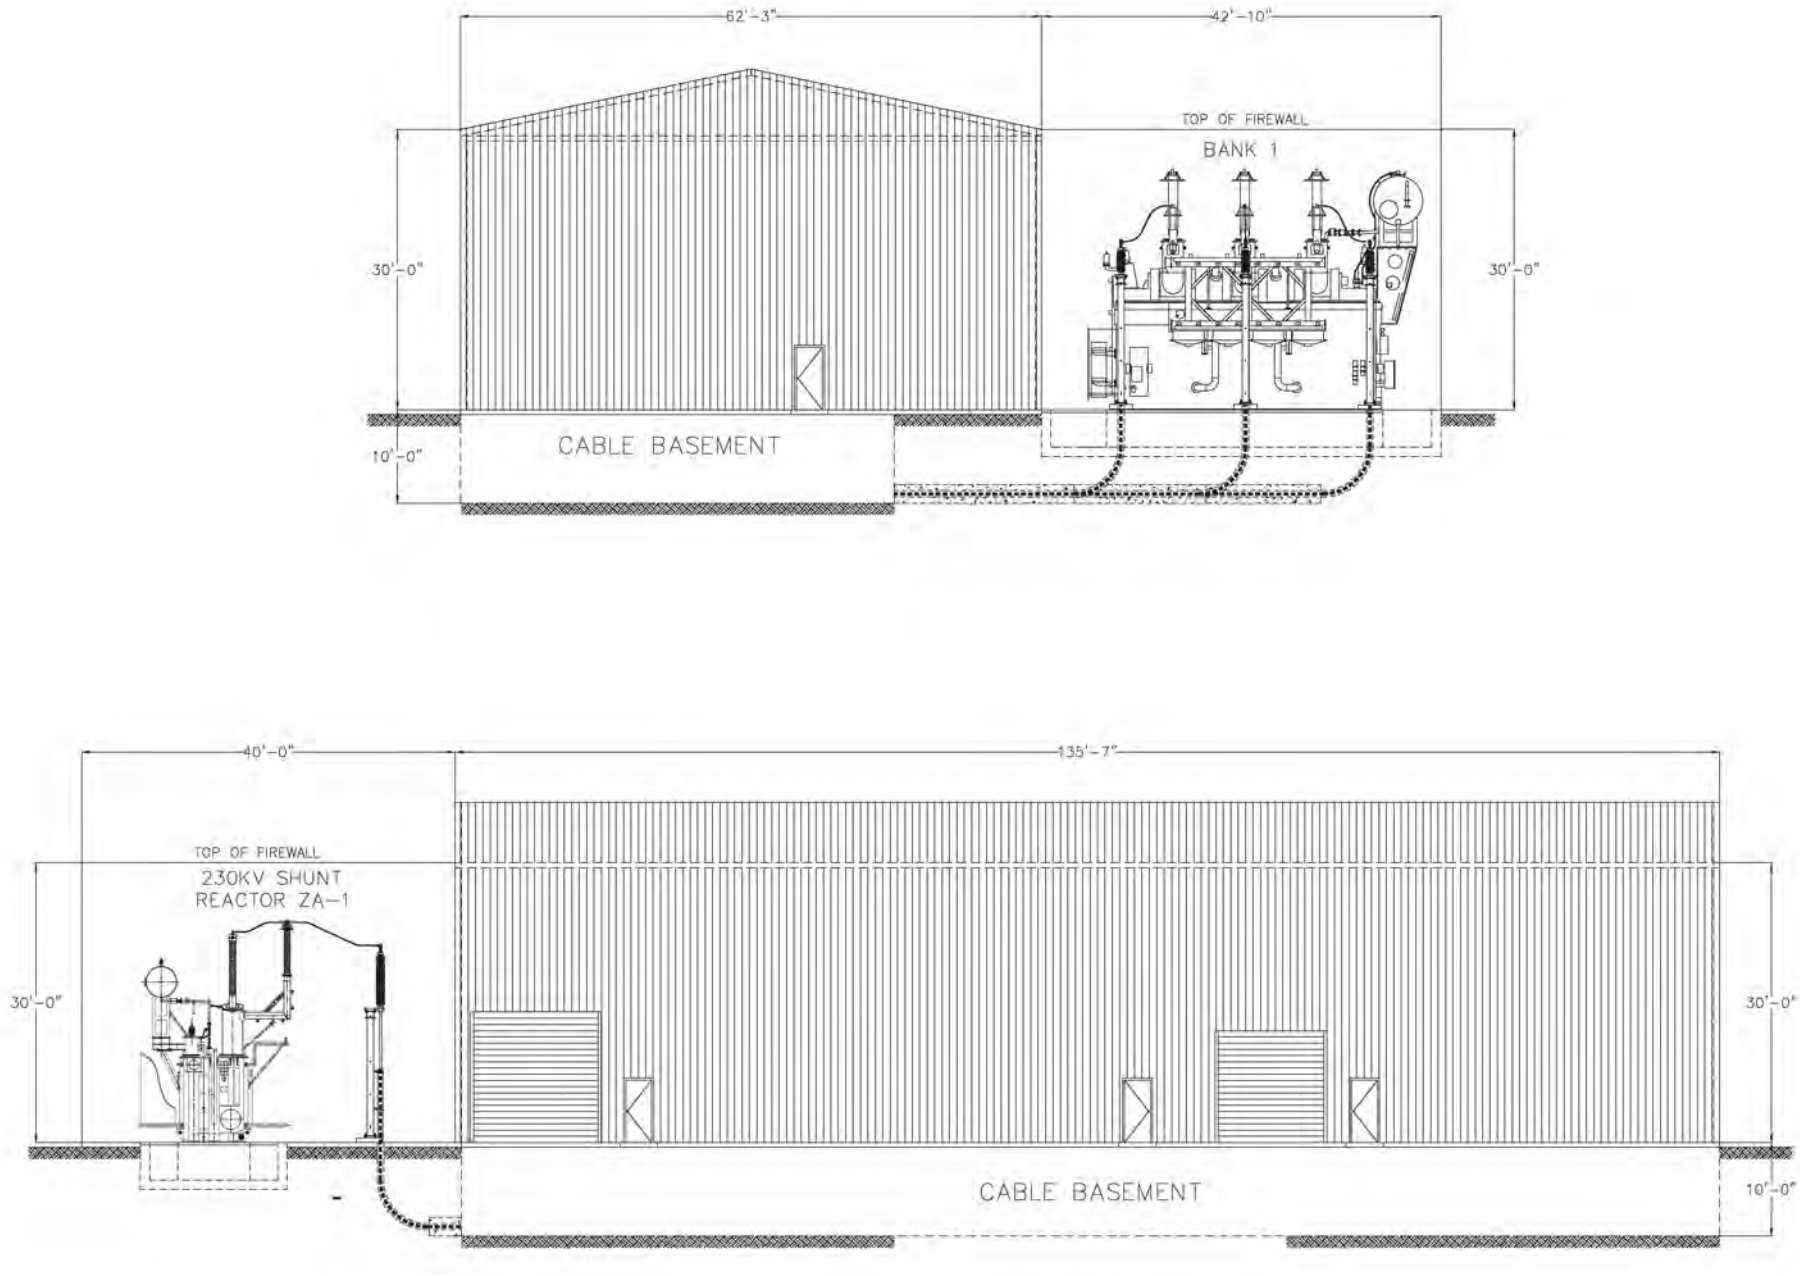

Source: PG&E, 2012.

Figure 4-14

Potrero Gas Insulated Switchgear Building Conceptual