

Appendix A

Diagram 1

Summer - Existing System, Potrero #7 Not Constructed, Hunters Point Retired, Potrero #3 Shutdown, and Jefferson-Martin 230 kV Project Installed in Sept. 2005
 Contingency: San Mateo-Millbrae 115 kV Circuit and San Mateo-Martin 230 kV Cable Outage

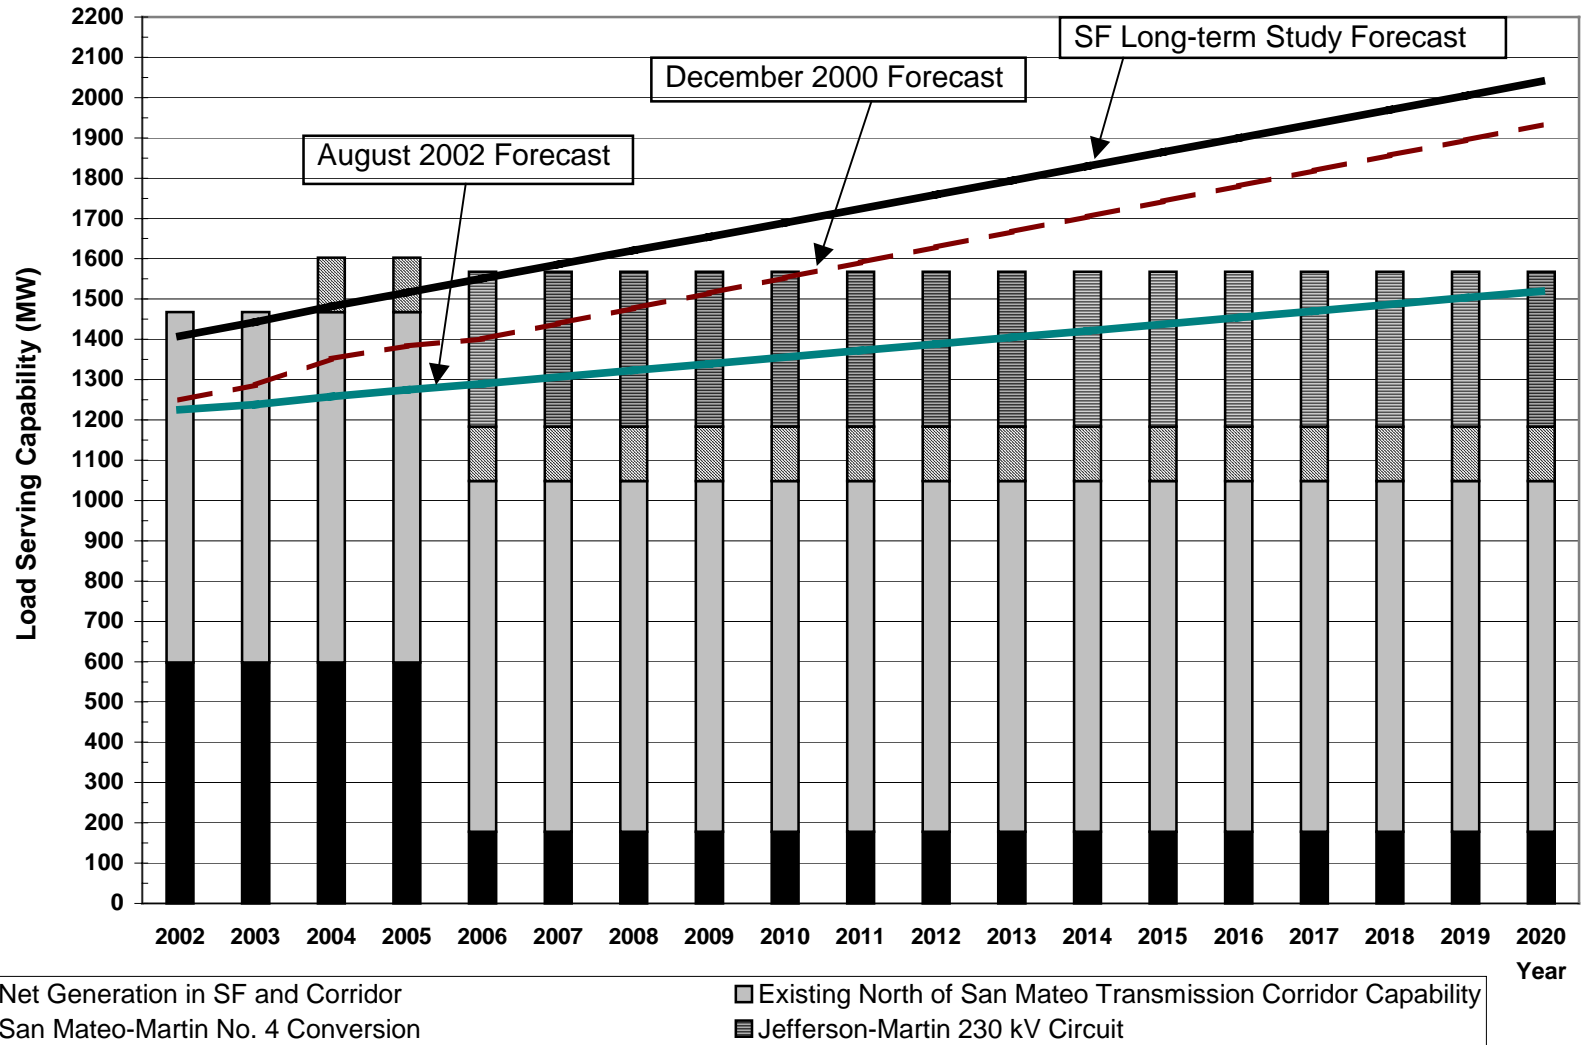


Diagram 2 – Potrero #3 in Overhaul

Fall - Existing System, Potrero #7 Not Constructed, Hunters Point Retired, Potrero #3 Not Shutdown, Jefferson-Martin 230 kV Project Installed in Sept. 2005
 Contingency: San Mateo-Millbrae 115 kV Circuit and San Mateo-Martin 230 kV Cable Outage

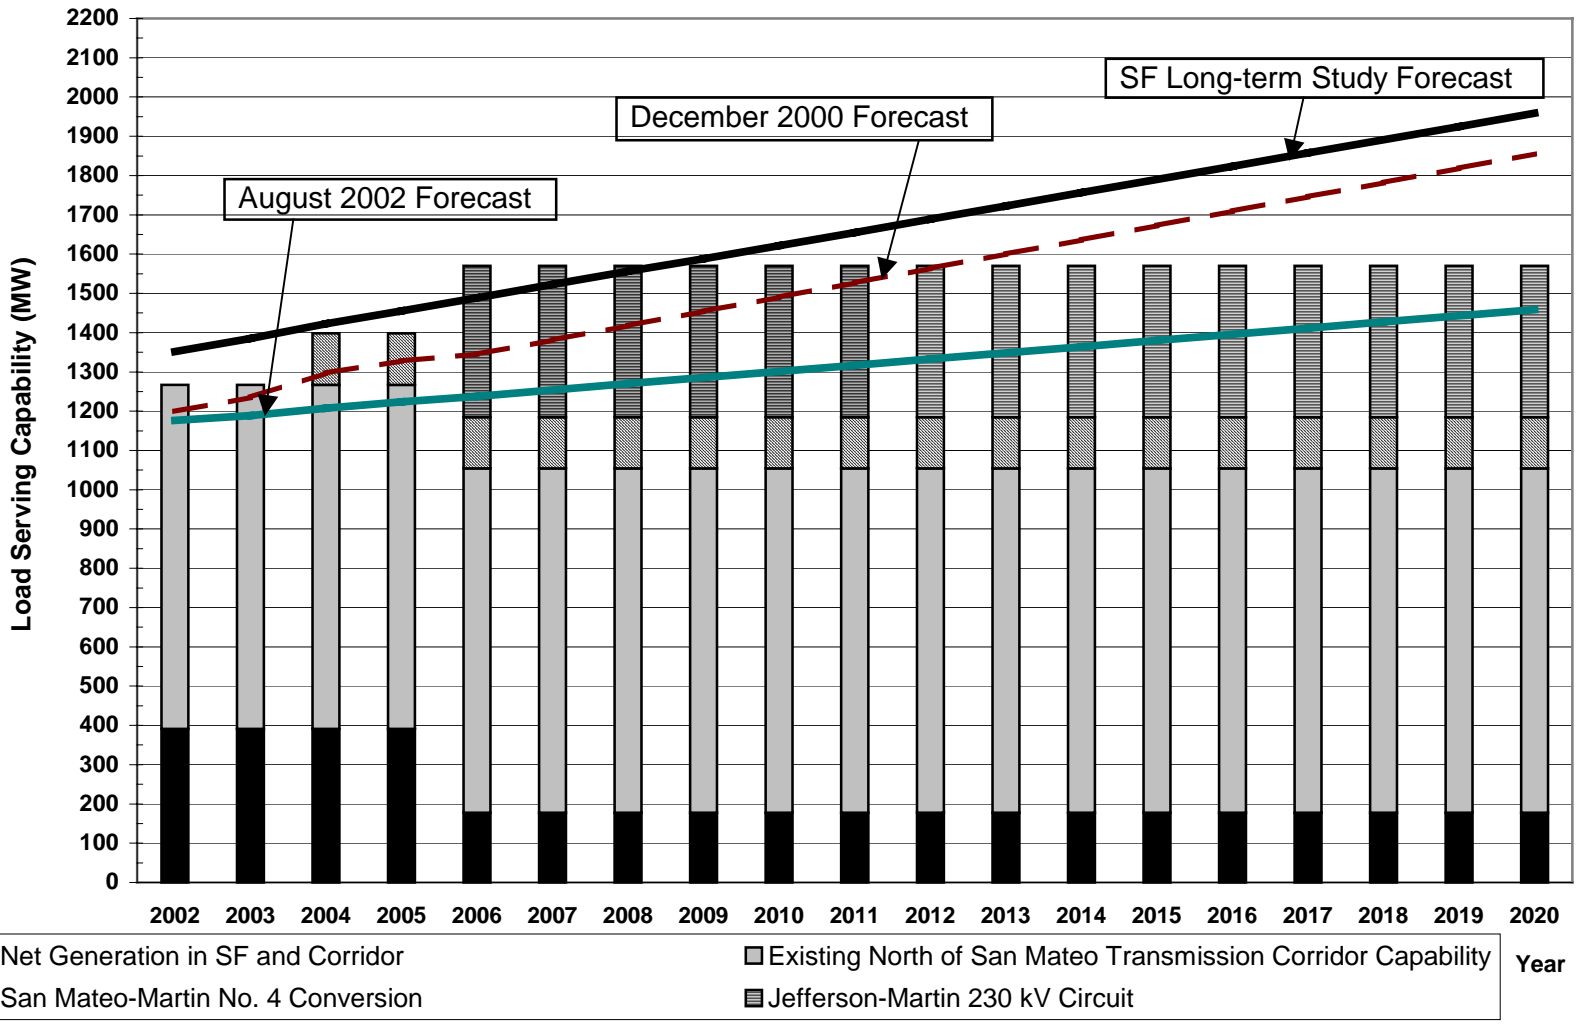


Diagram 3 – Hunters Point #4 in Overhaul

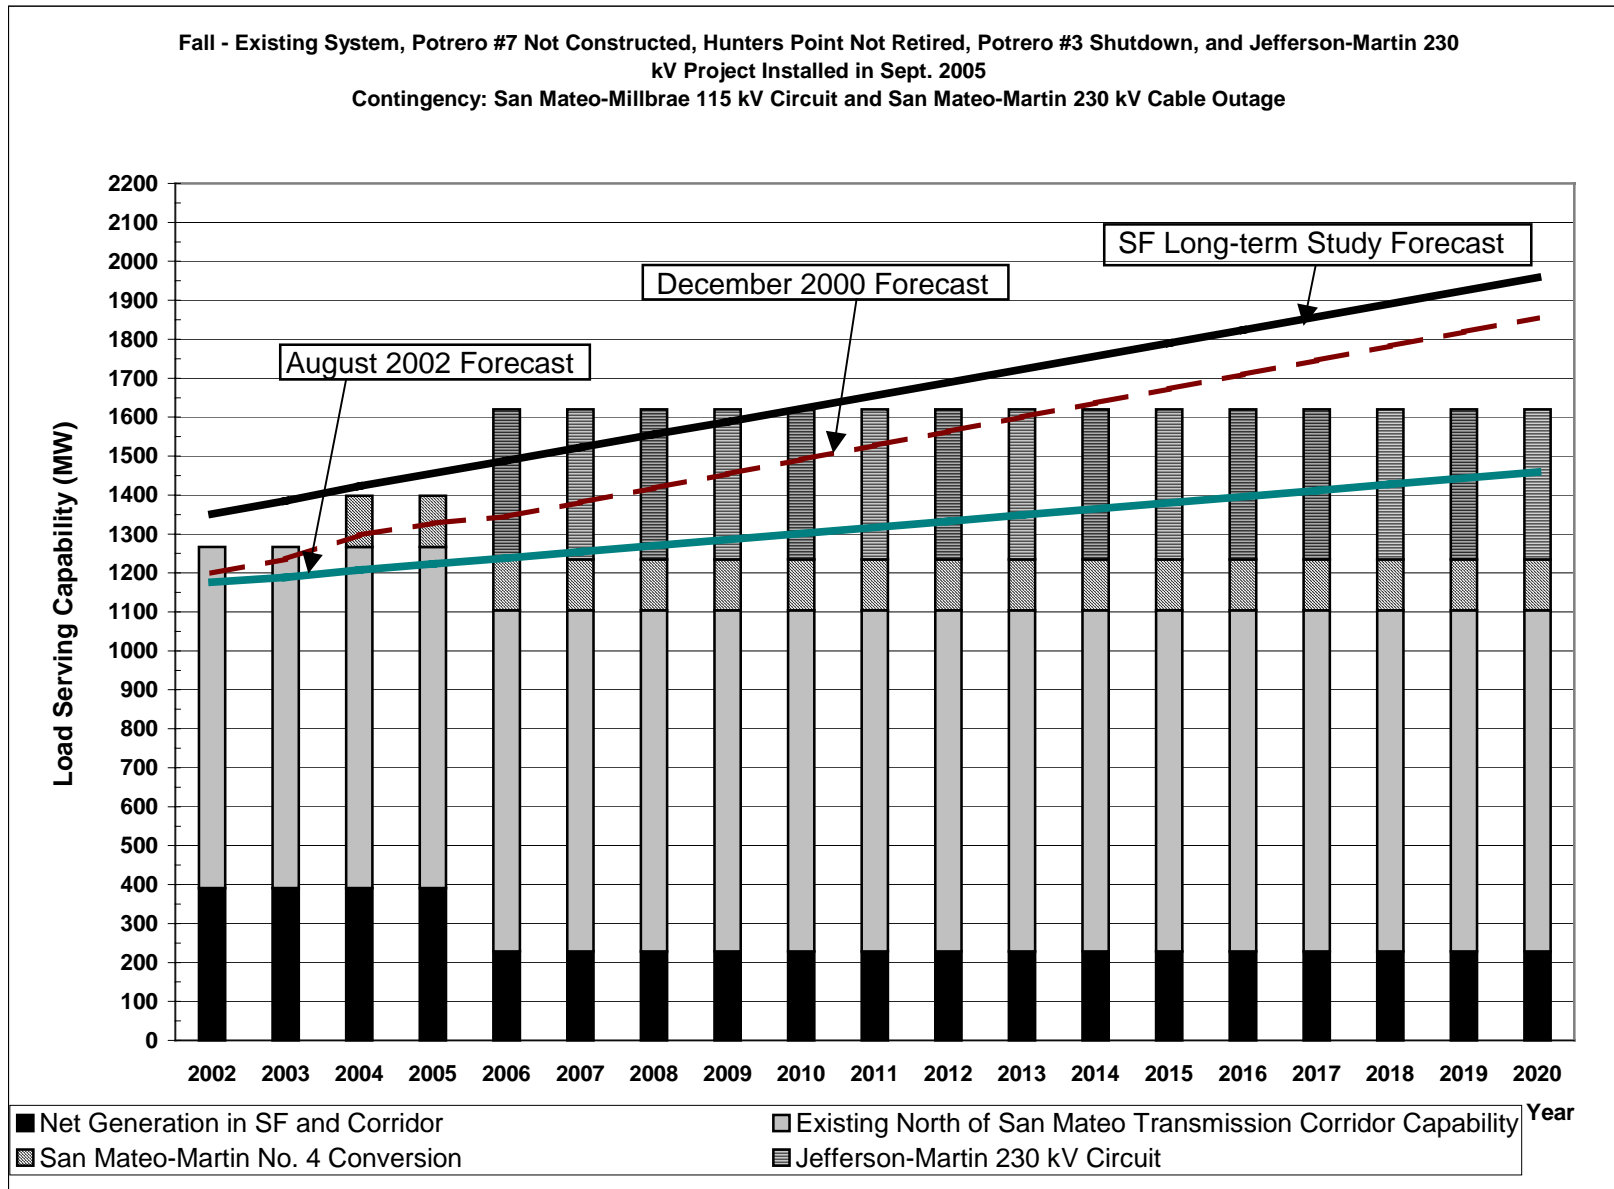


Diagram 4 - Potrero #3 in Overhaul

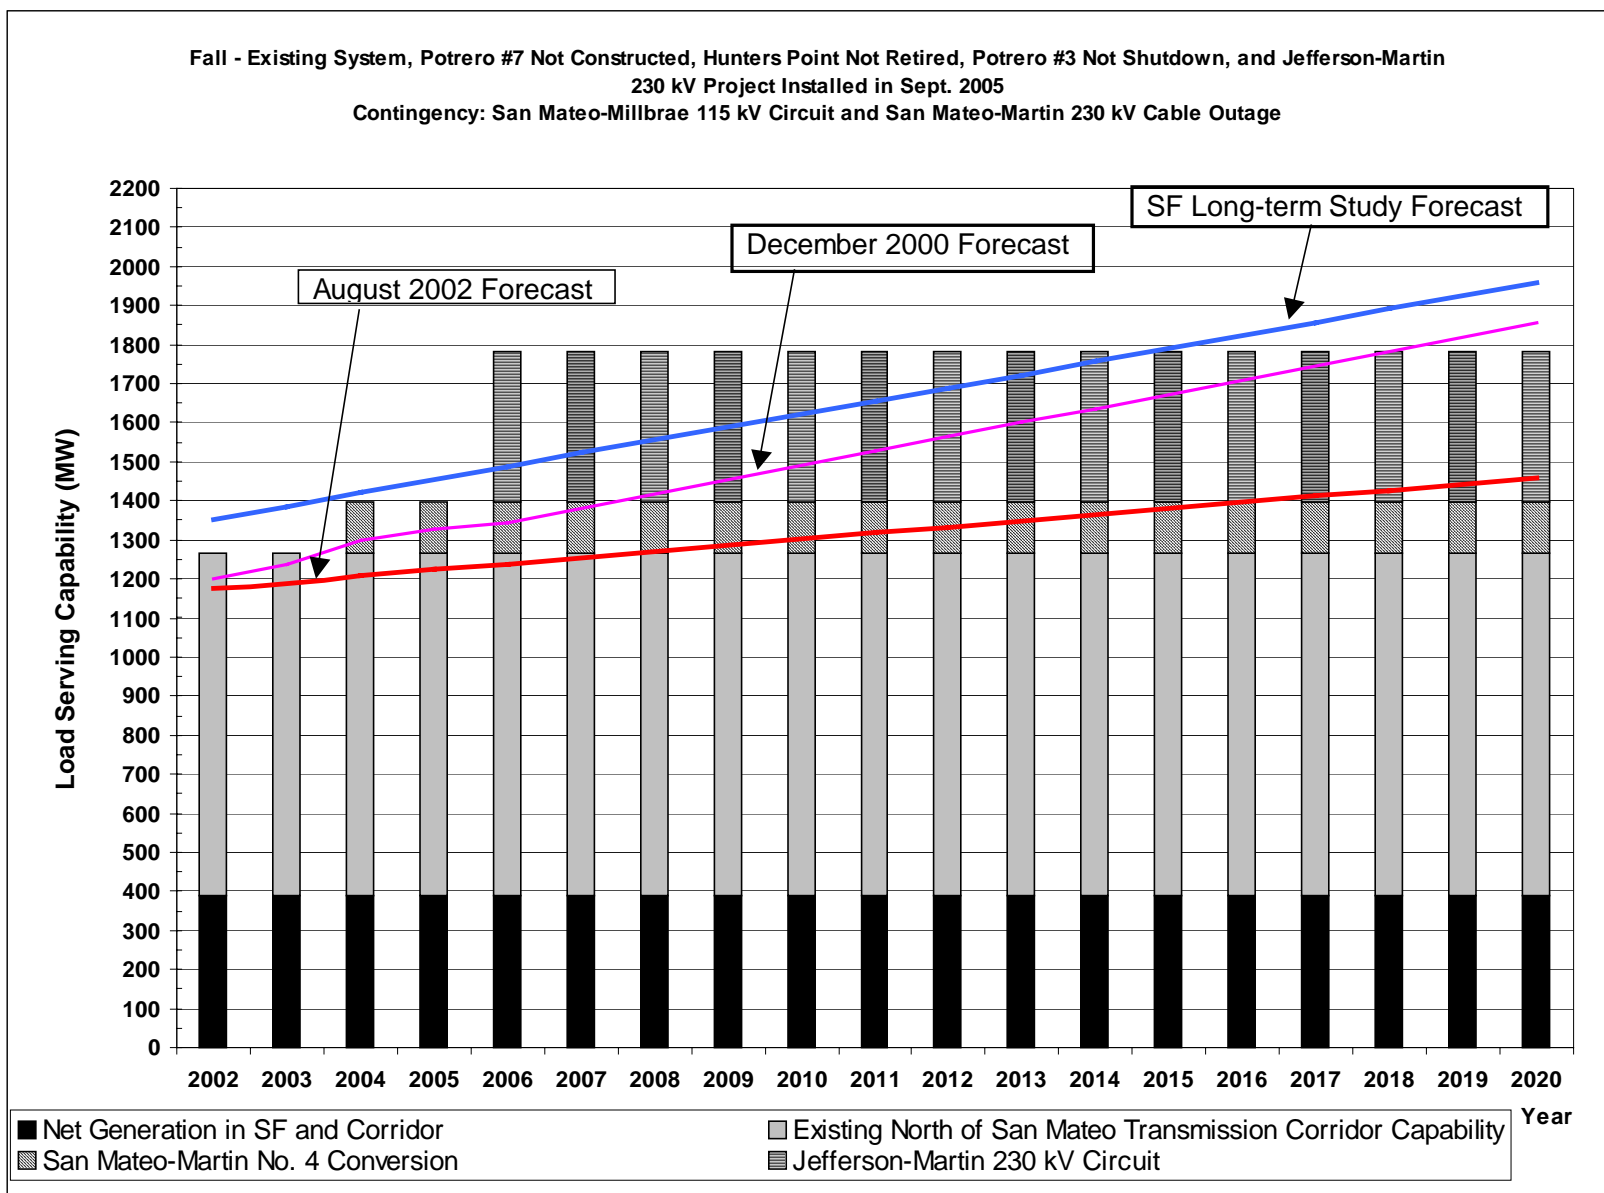


Diagram 5

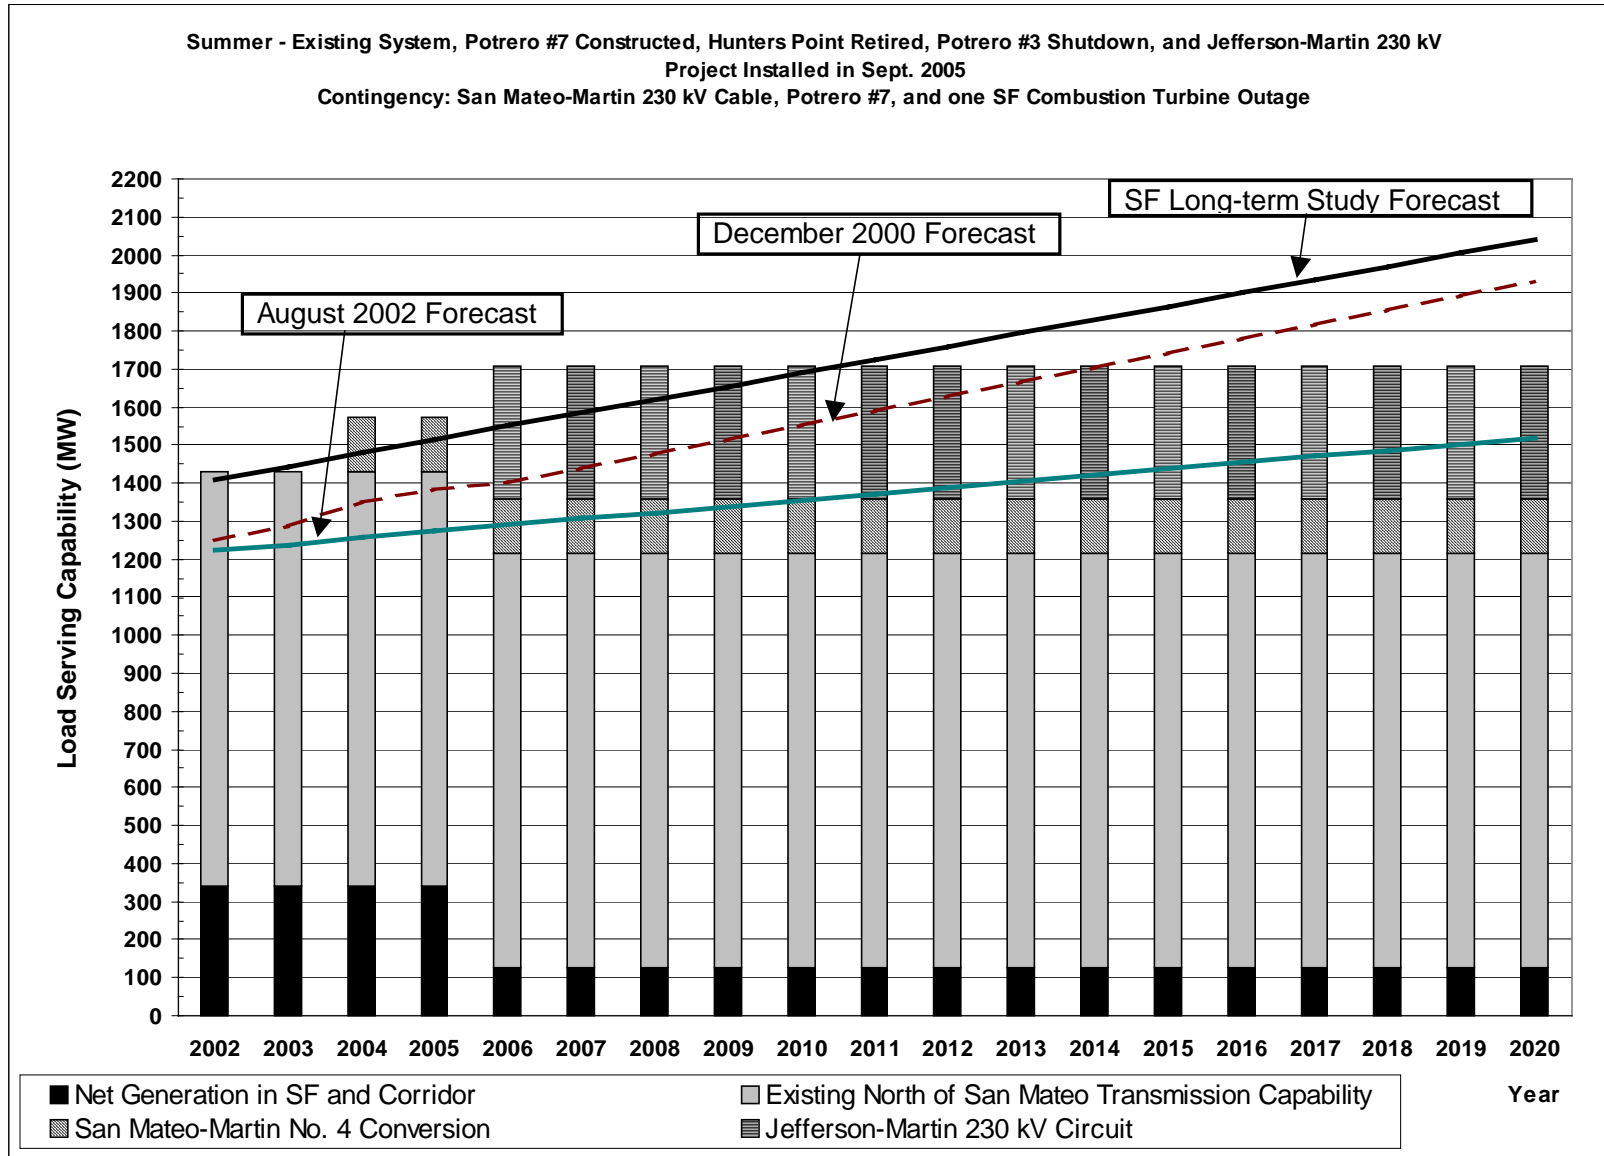


Diagram 6 – Potrero #3 in Overhaul

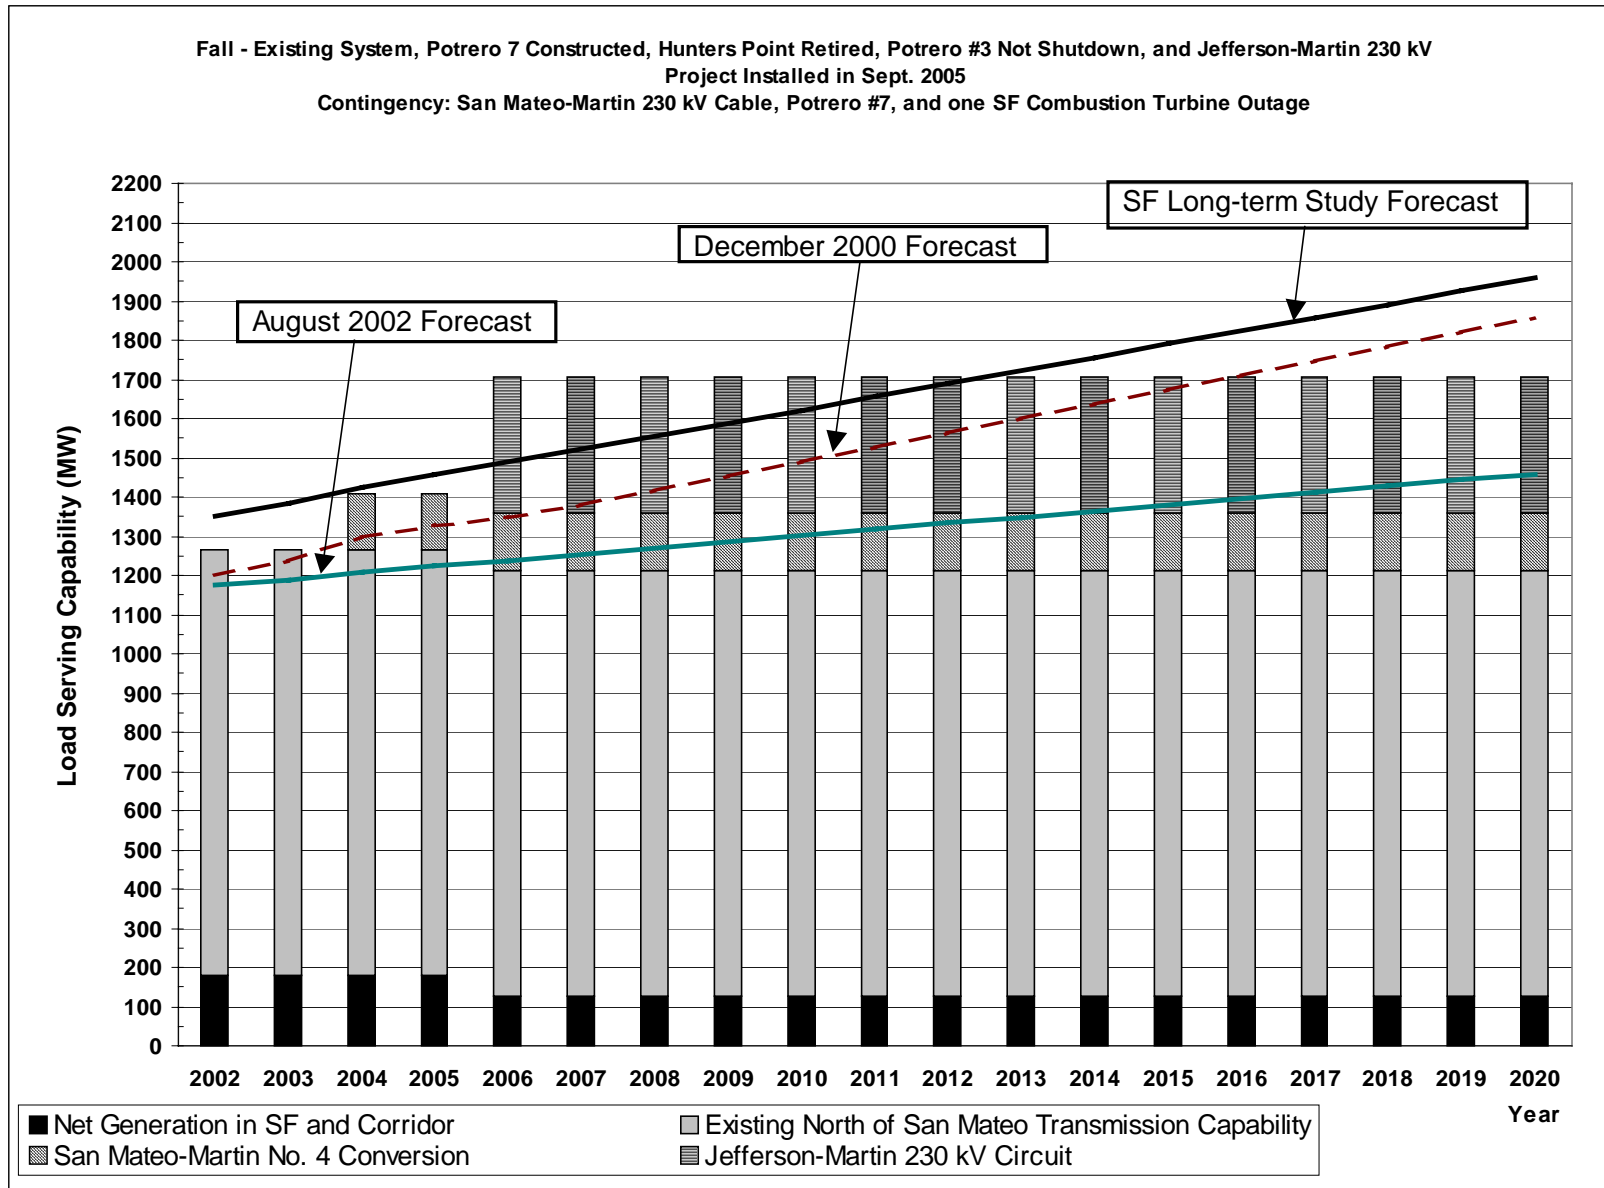


Diagram 7 – Hunters Point #4 in Overhaul

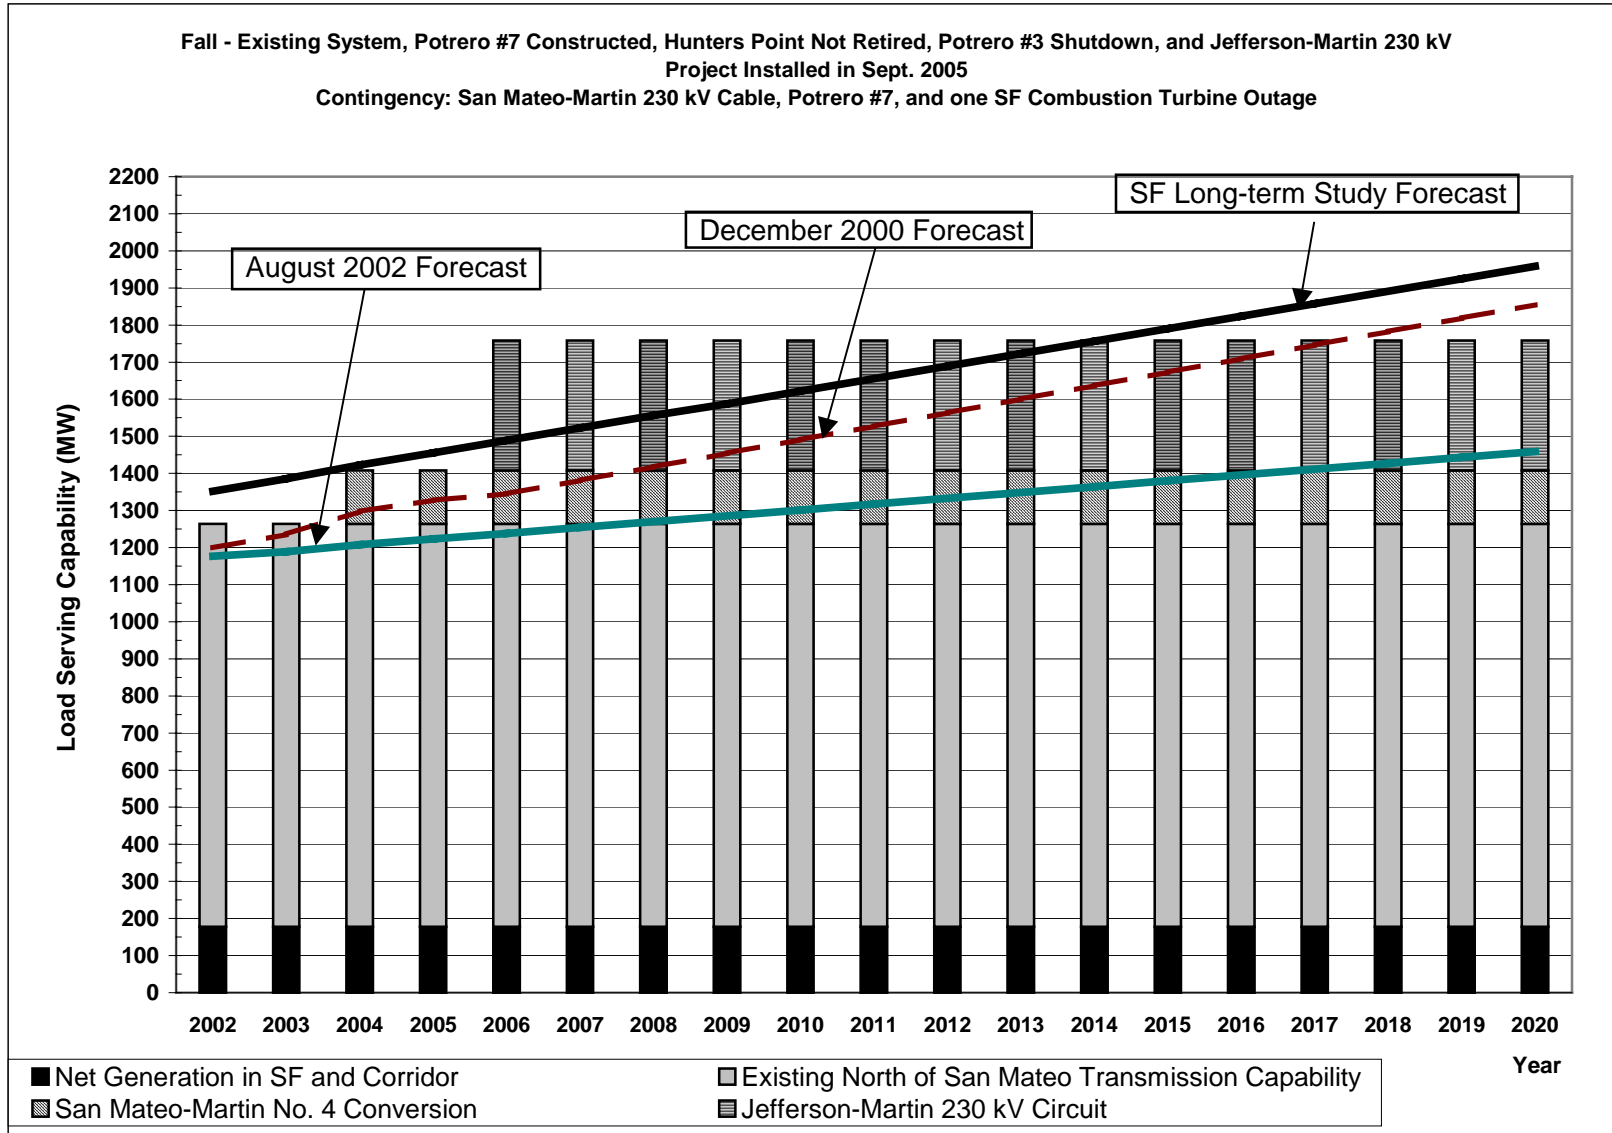


Diagram 8 – Potrero #3 in Overhaul

