
TE/VS Interconnect

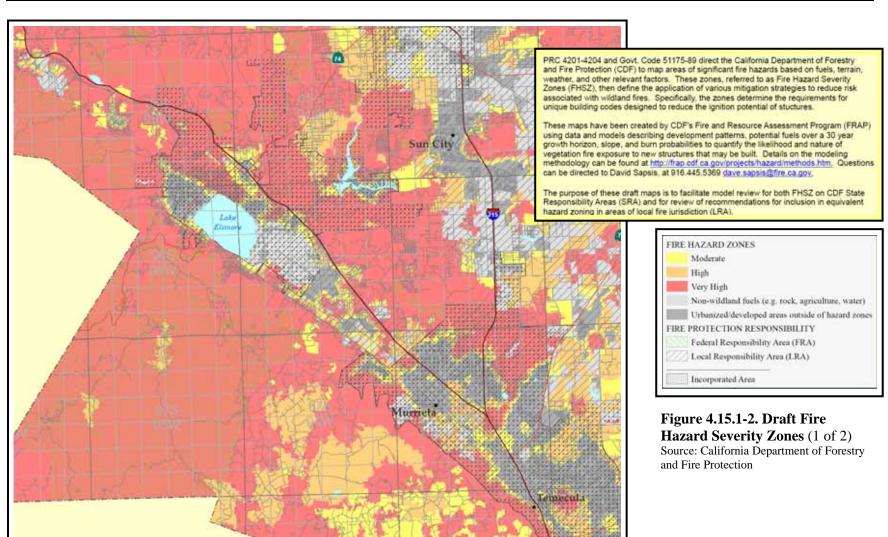

TE/VS Interconnect

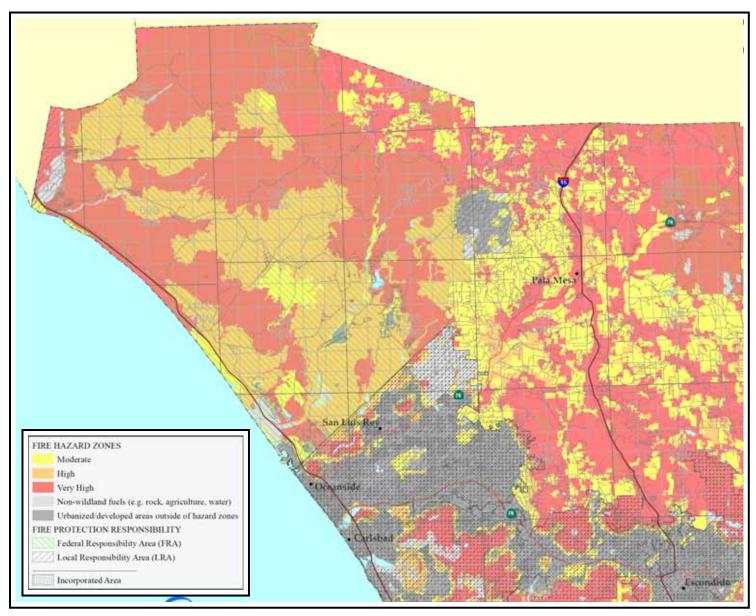


Figure 4.15.1-2. Draft Fire Hazard Severity Zones (2 of 2)

Source: California Department of Forestry and Fire Protection