



Talega-Escondido/Valley-Serrano 500-kV Interconnect Project  
Lake Elsinore Advanced Pumped Storage Project  
Talega-Escondido Tower Upgrade Facilities Plan



**Figure 3.6.3-2: Talega-Escondido 230 kV Line Upgrade (Index)**

Source: The Nevada Hydro Company

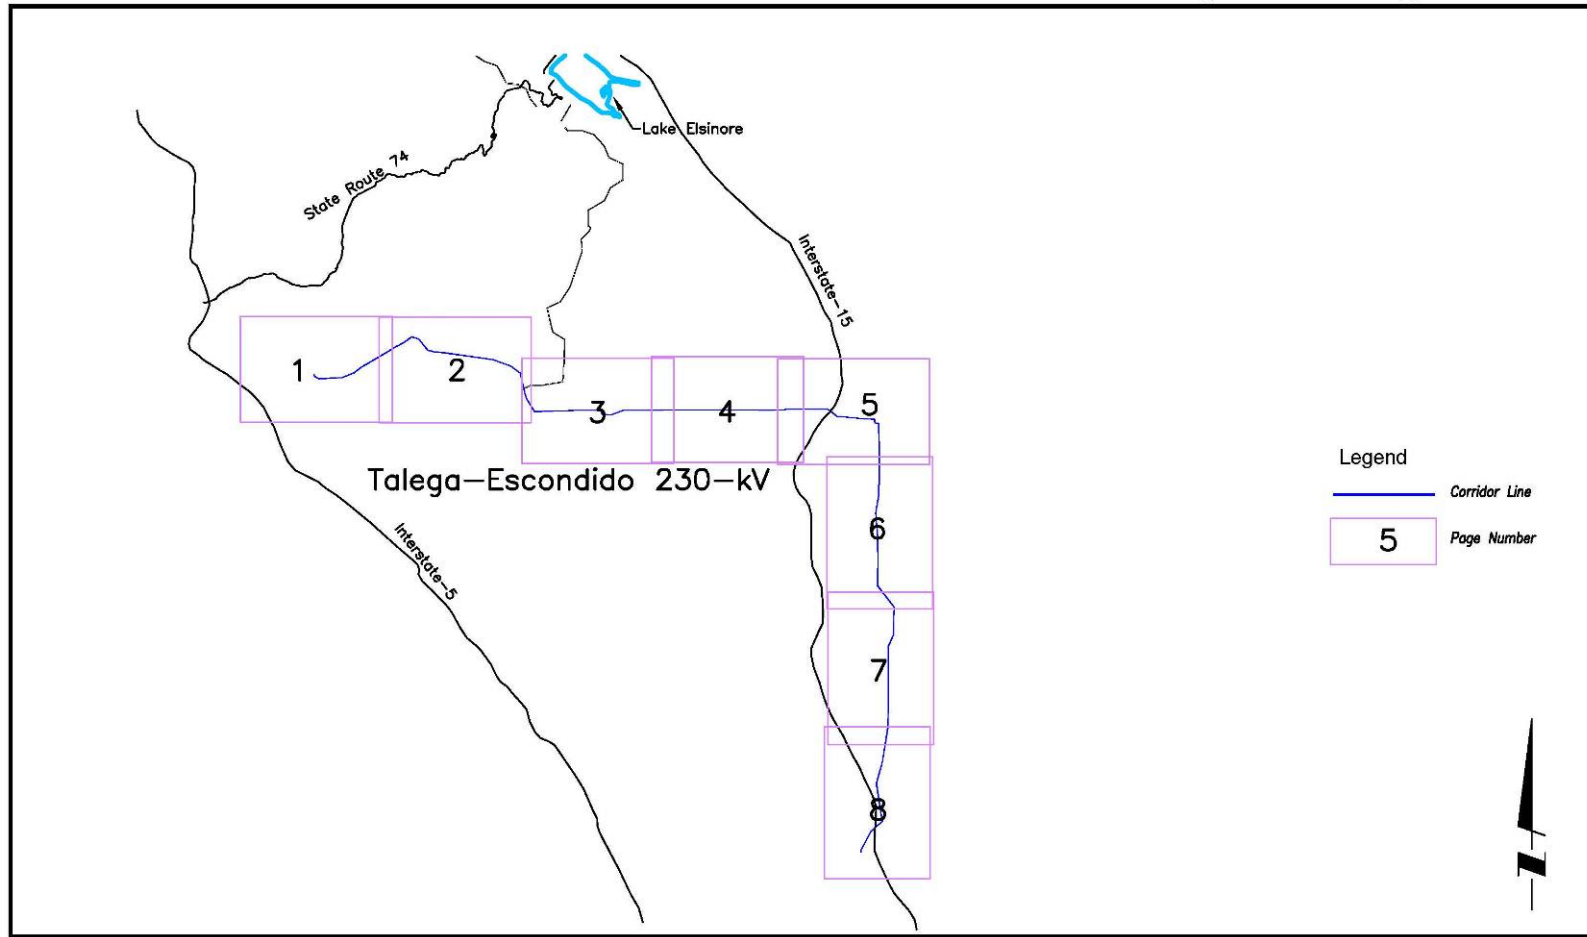


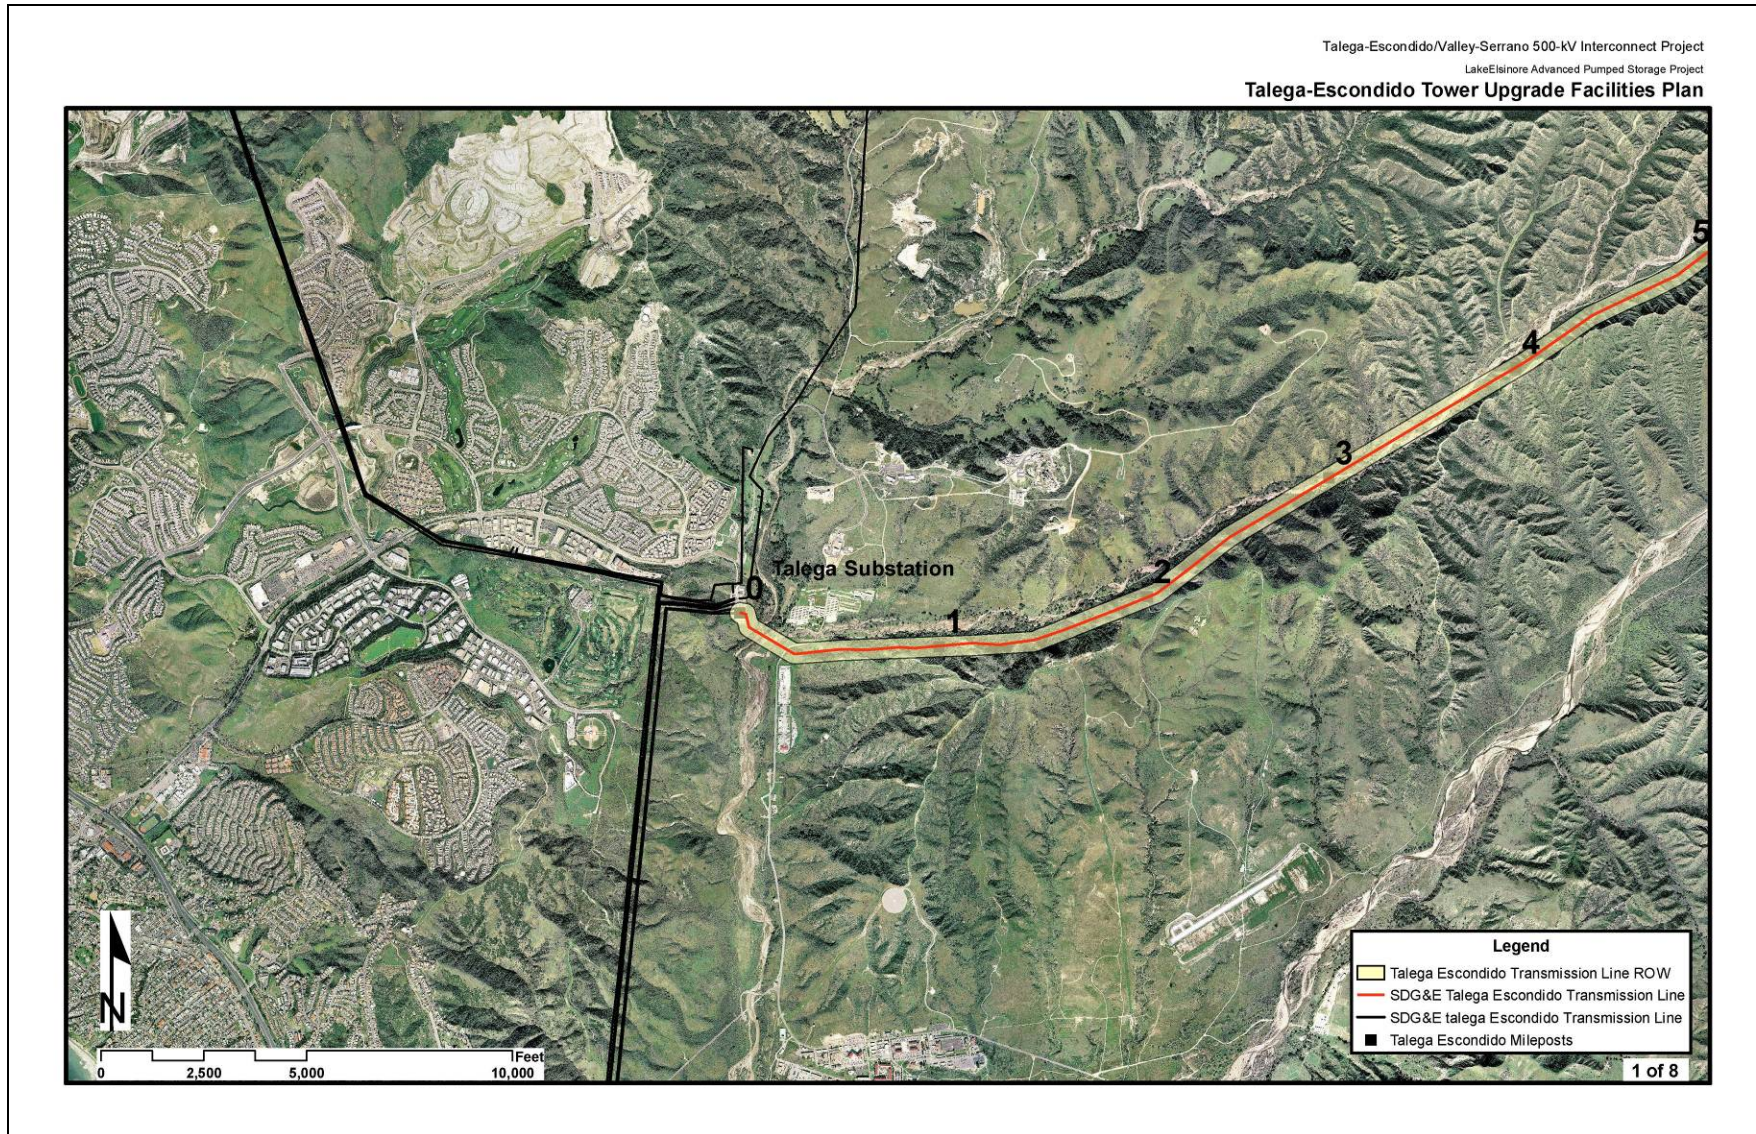

**Figure 3.6.3-2: Talega-Escondido 230 kV Line Upgrade (1 of 8)**

Source: The Nevada Hydro Company




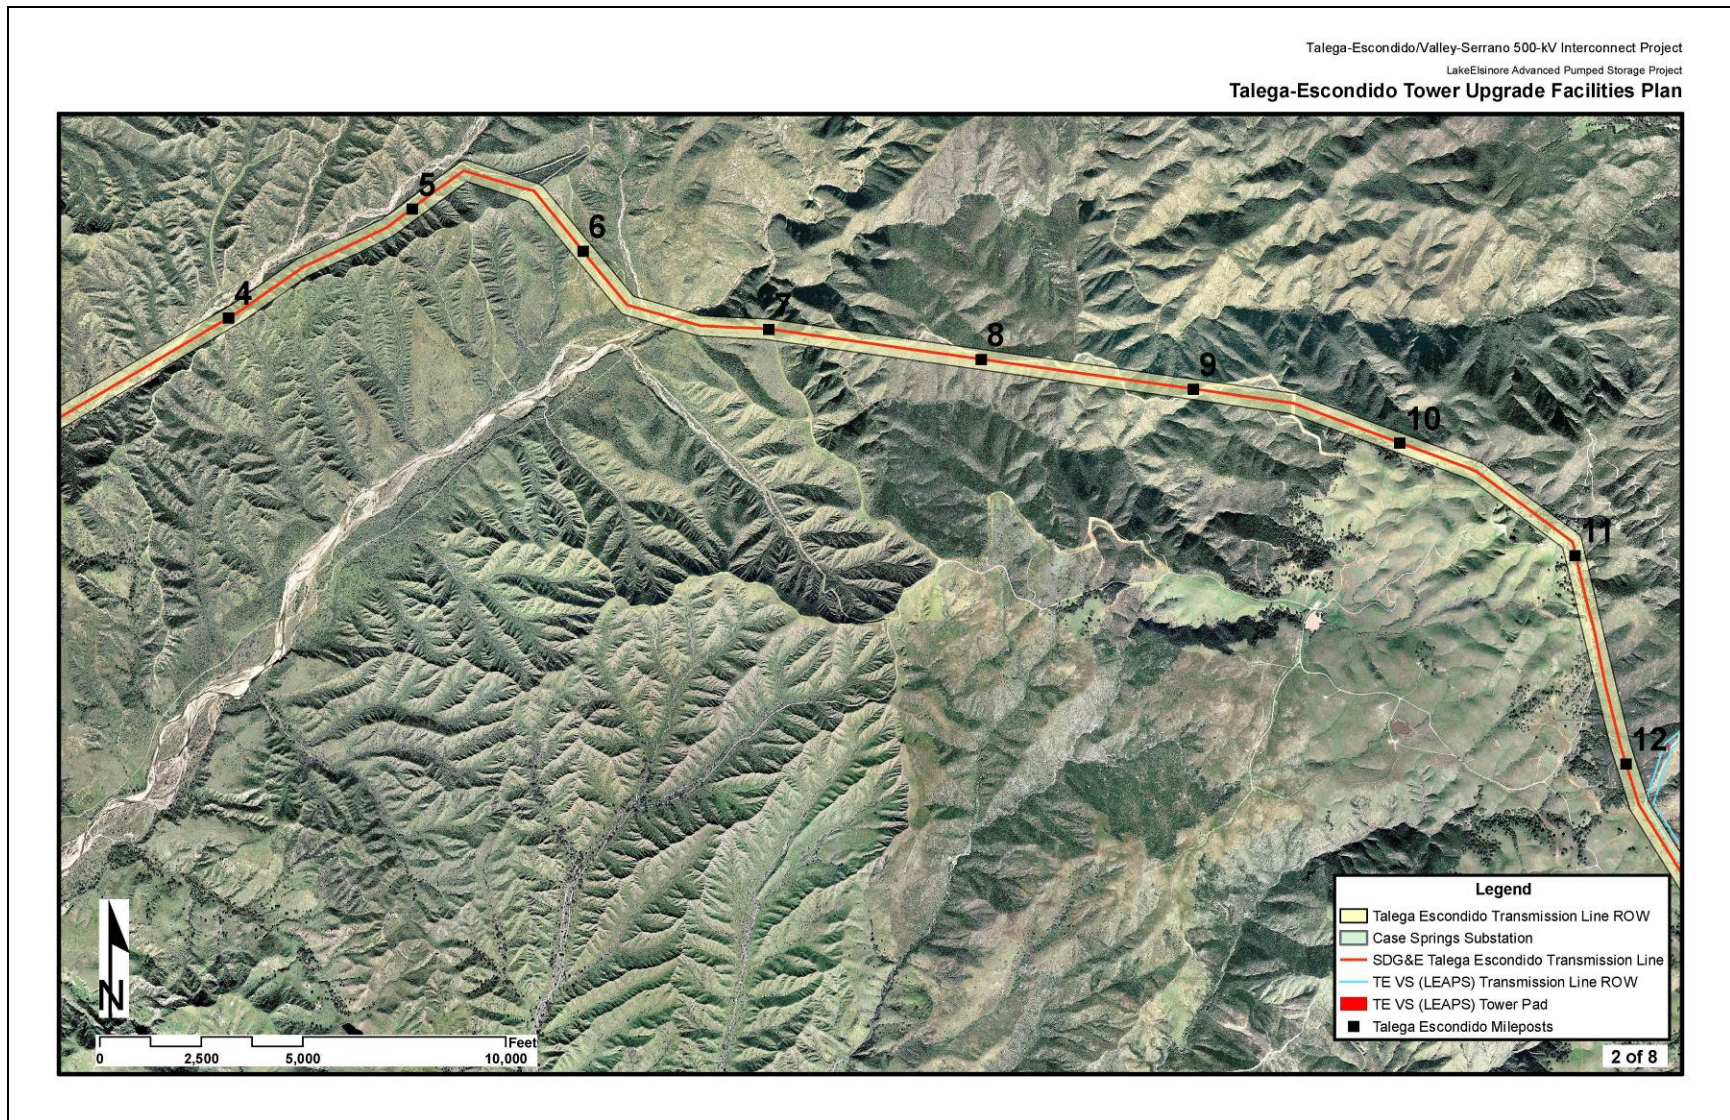

**Figure 3.6.3-2: Talega-Escondido 230 kV Line Upgrade (2 of 8)**

Source: The Nevada Hydro Company




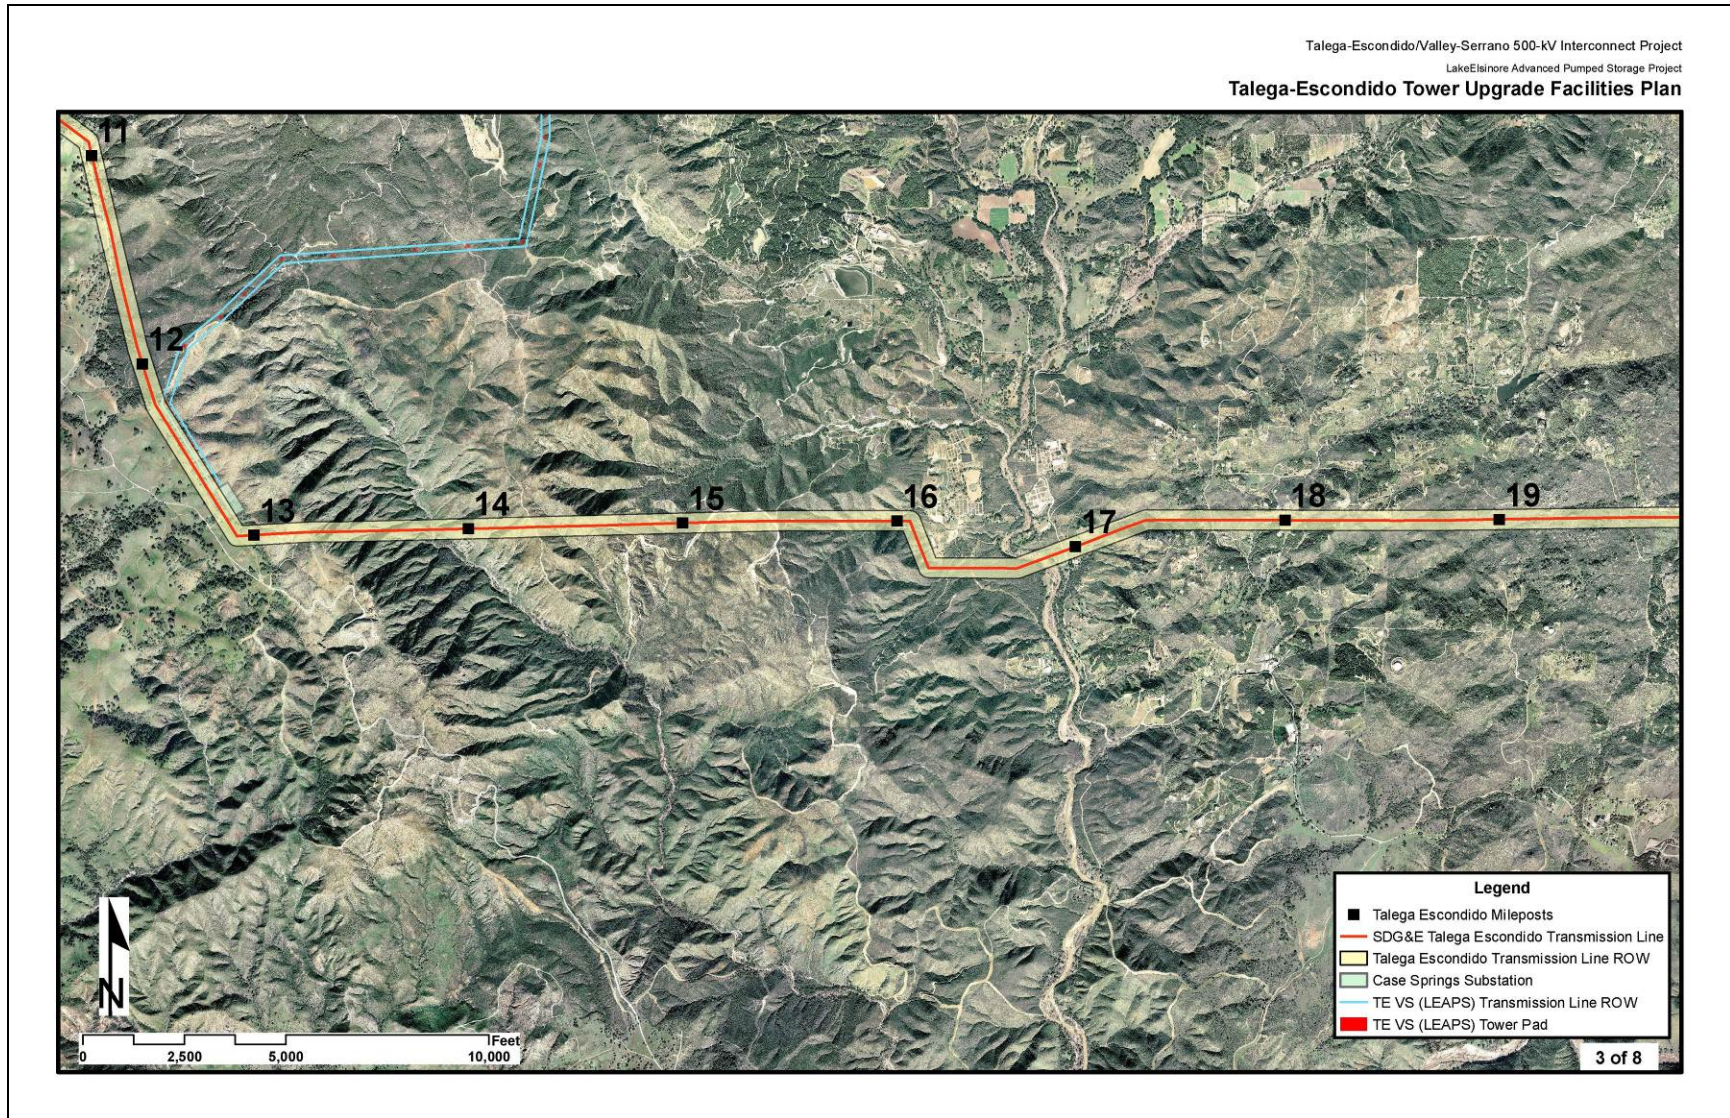

**Figure 3.6.3-2: Talega-Escondido 230 kV Line Upgrade Map (3 of 8)**

Source: The Nevada Hydro Company




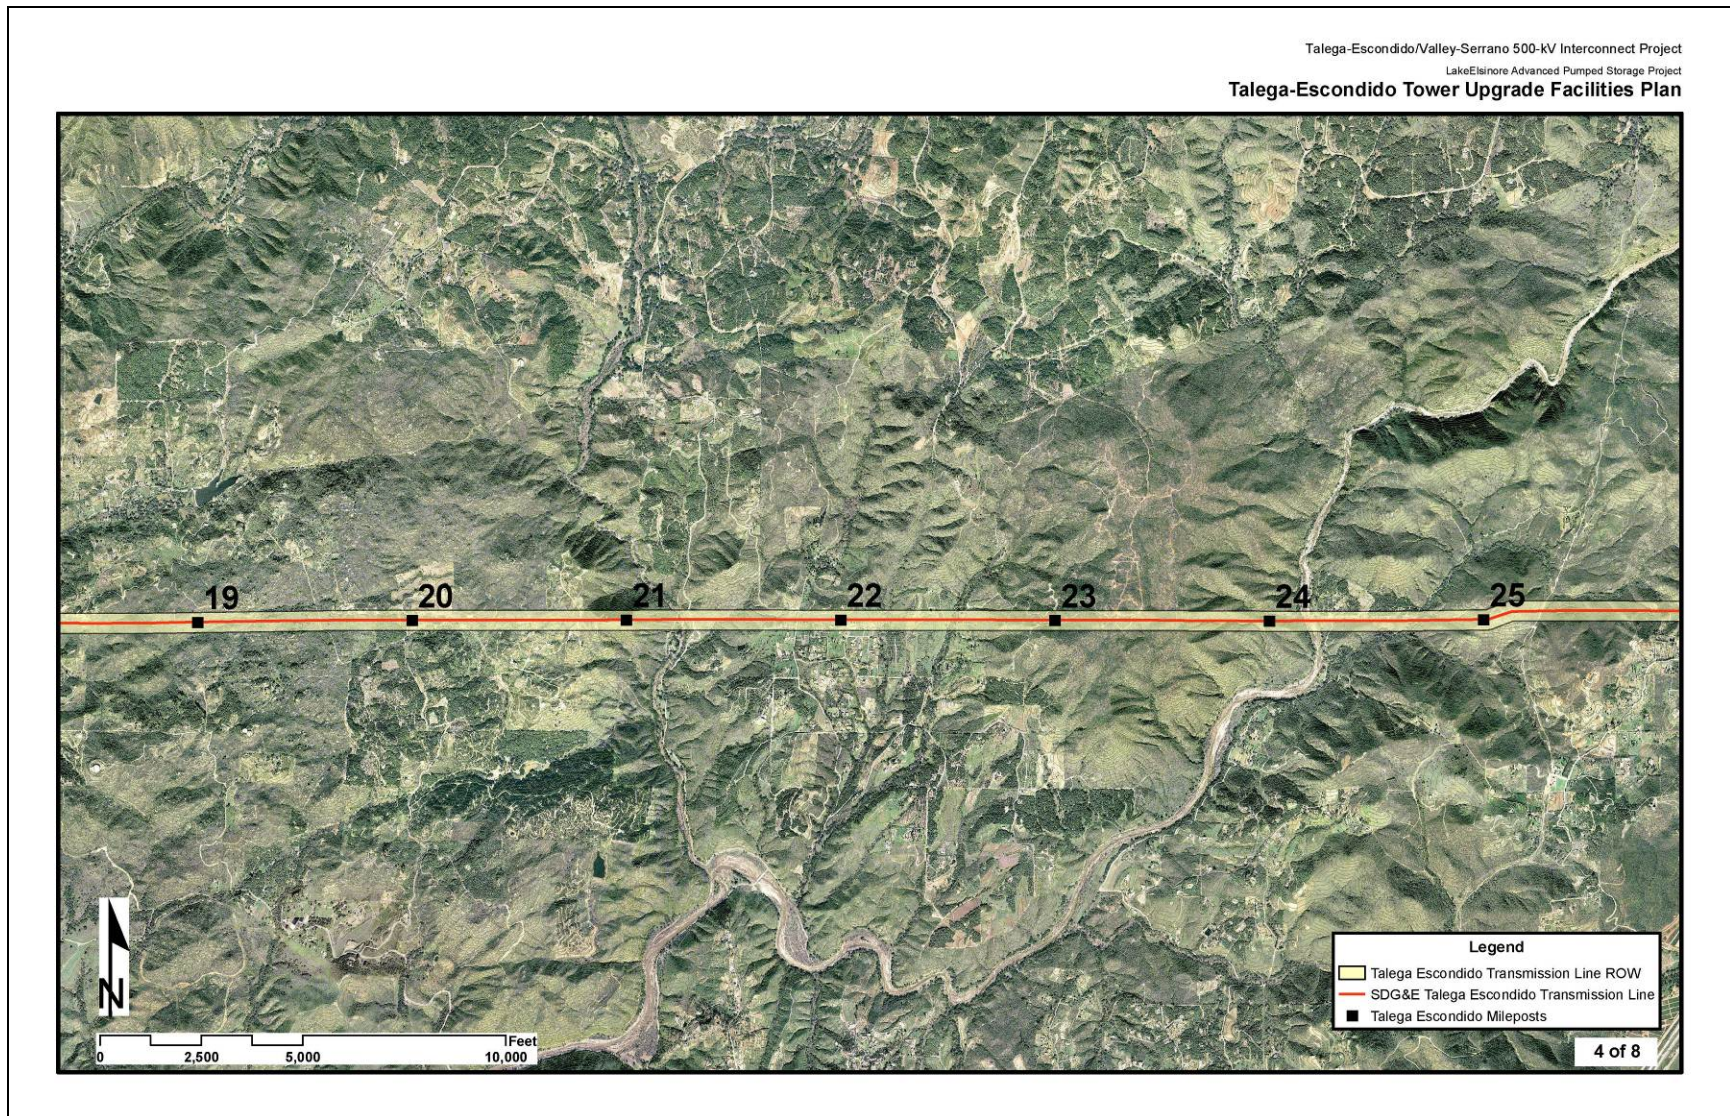

**Figure 3.6.3-2: Talega-Escondido 230 kV Line Upgrade Map (4 of 8)**

Source: The Nevada Hydro Company



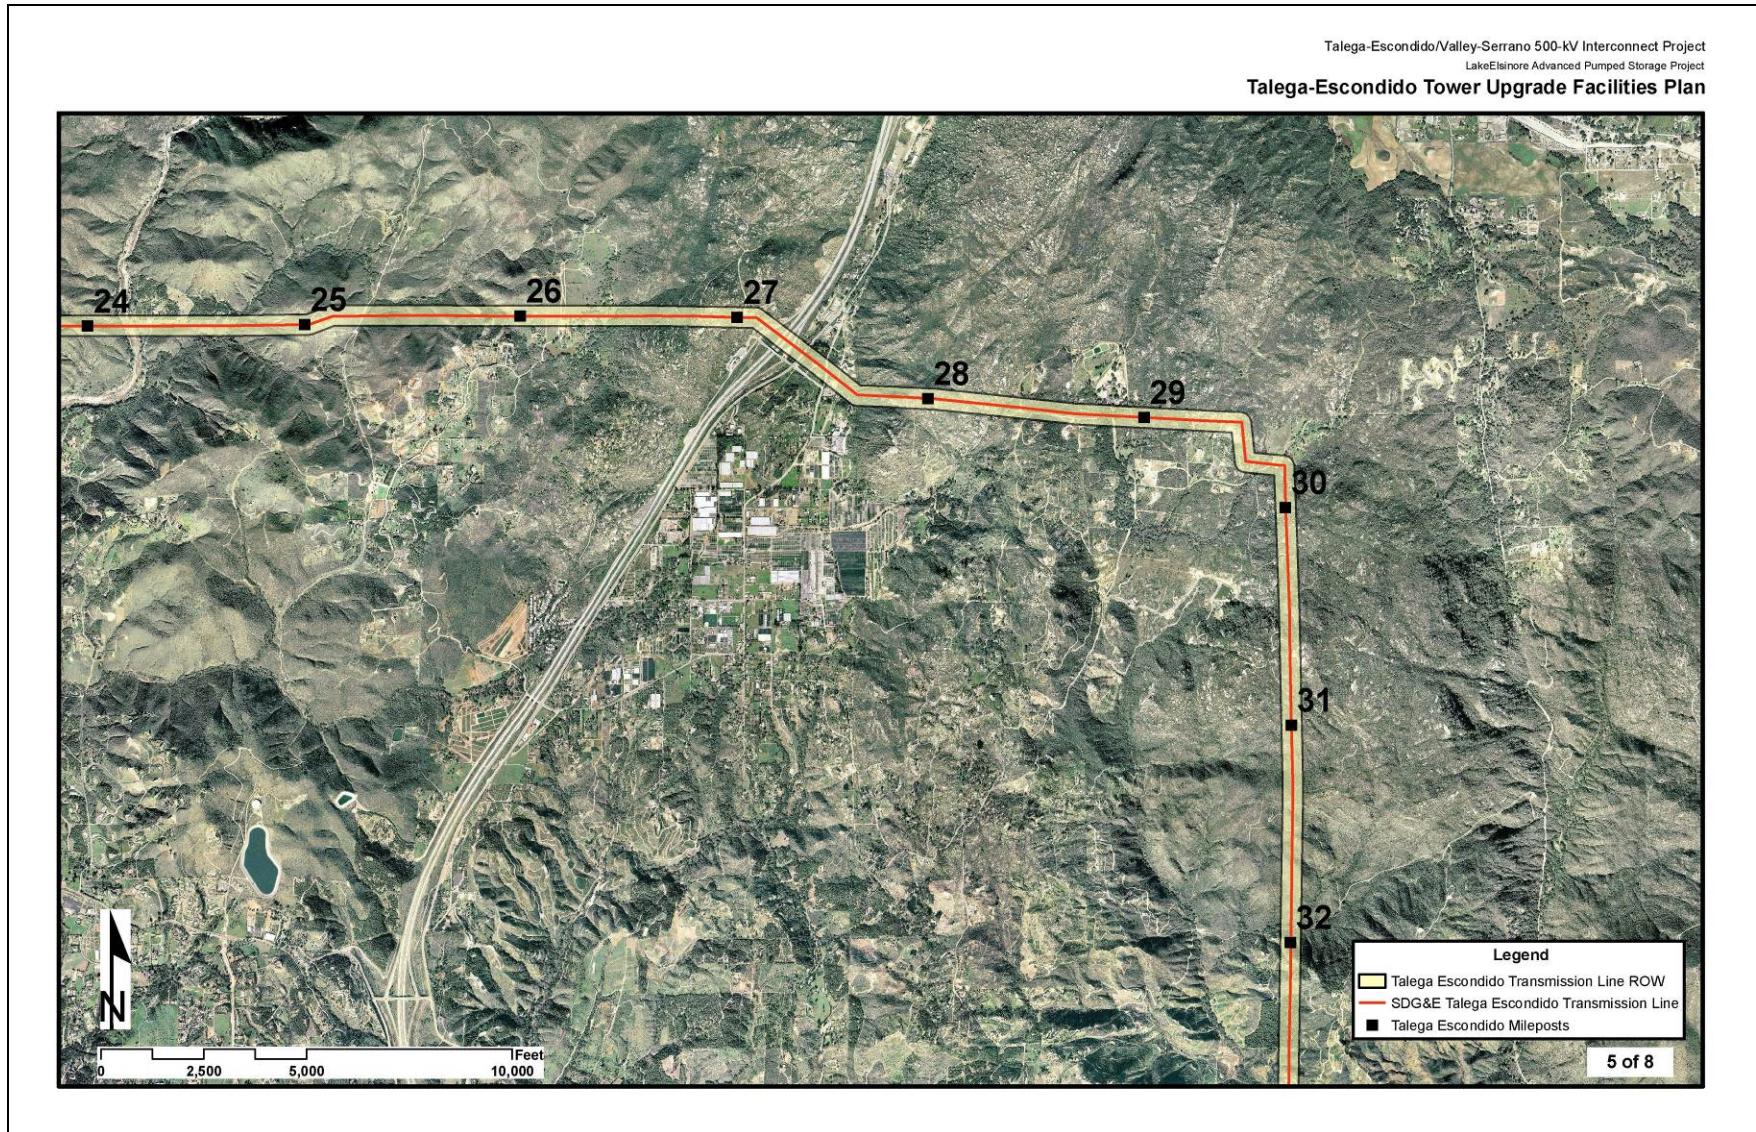


**Figure 3.6.3-2: Talega-Escondido 230 kV Line Upgrade Map (5 of 8)**

Source: The Nevada Hydro Company




Talega-Escondido/Valley-Serrano 500-kV Interconnect Project  
LakeElsinore Advanced Pumped Storage Project  
**Talega-Escondido Tower Upgrade Facilities Plan**

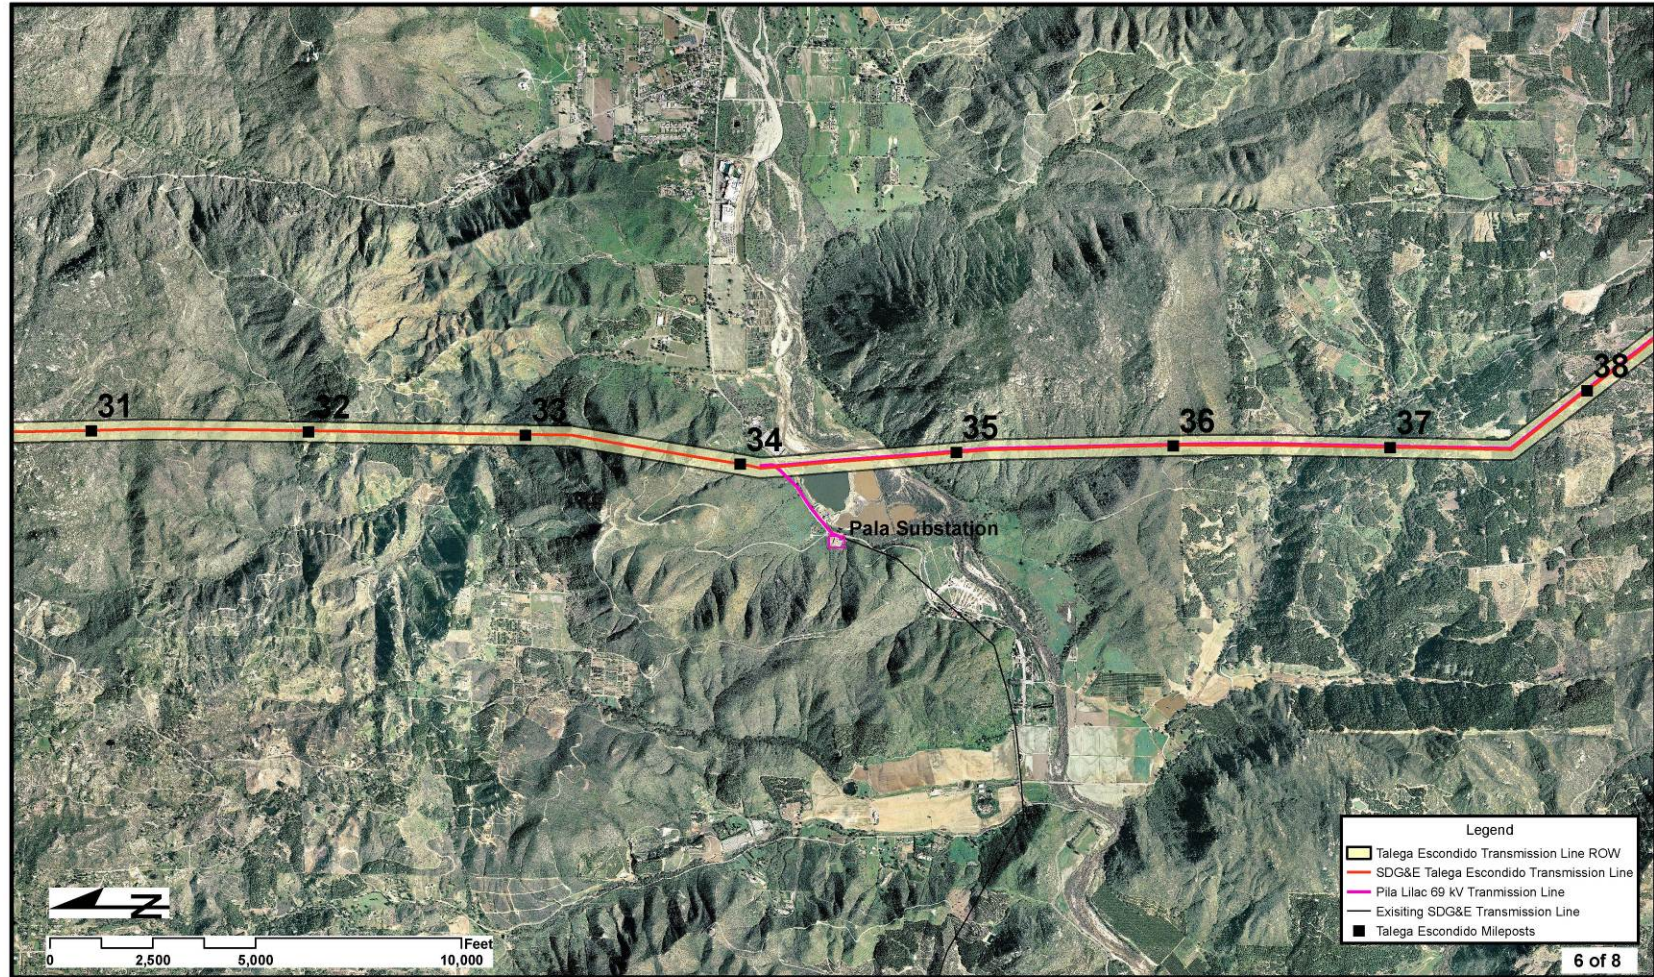

**Figure 3.6.3-2: Talega-Escondido 230 kV Line Upgrade Map (6 of 8)**

Source: The Nevada Hydro Company




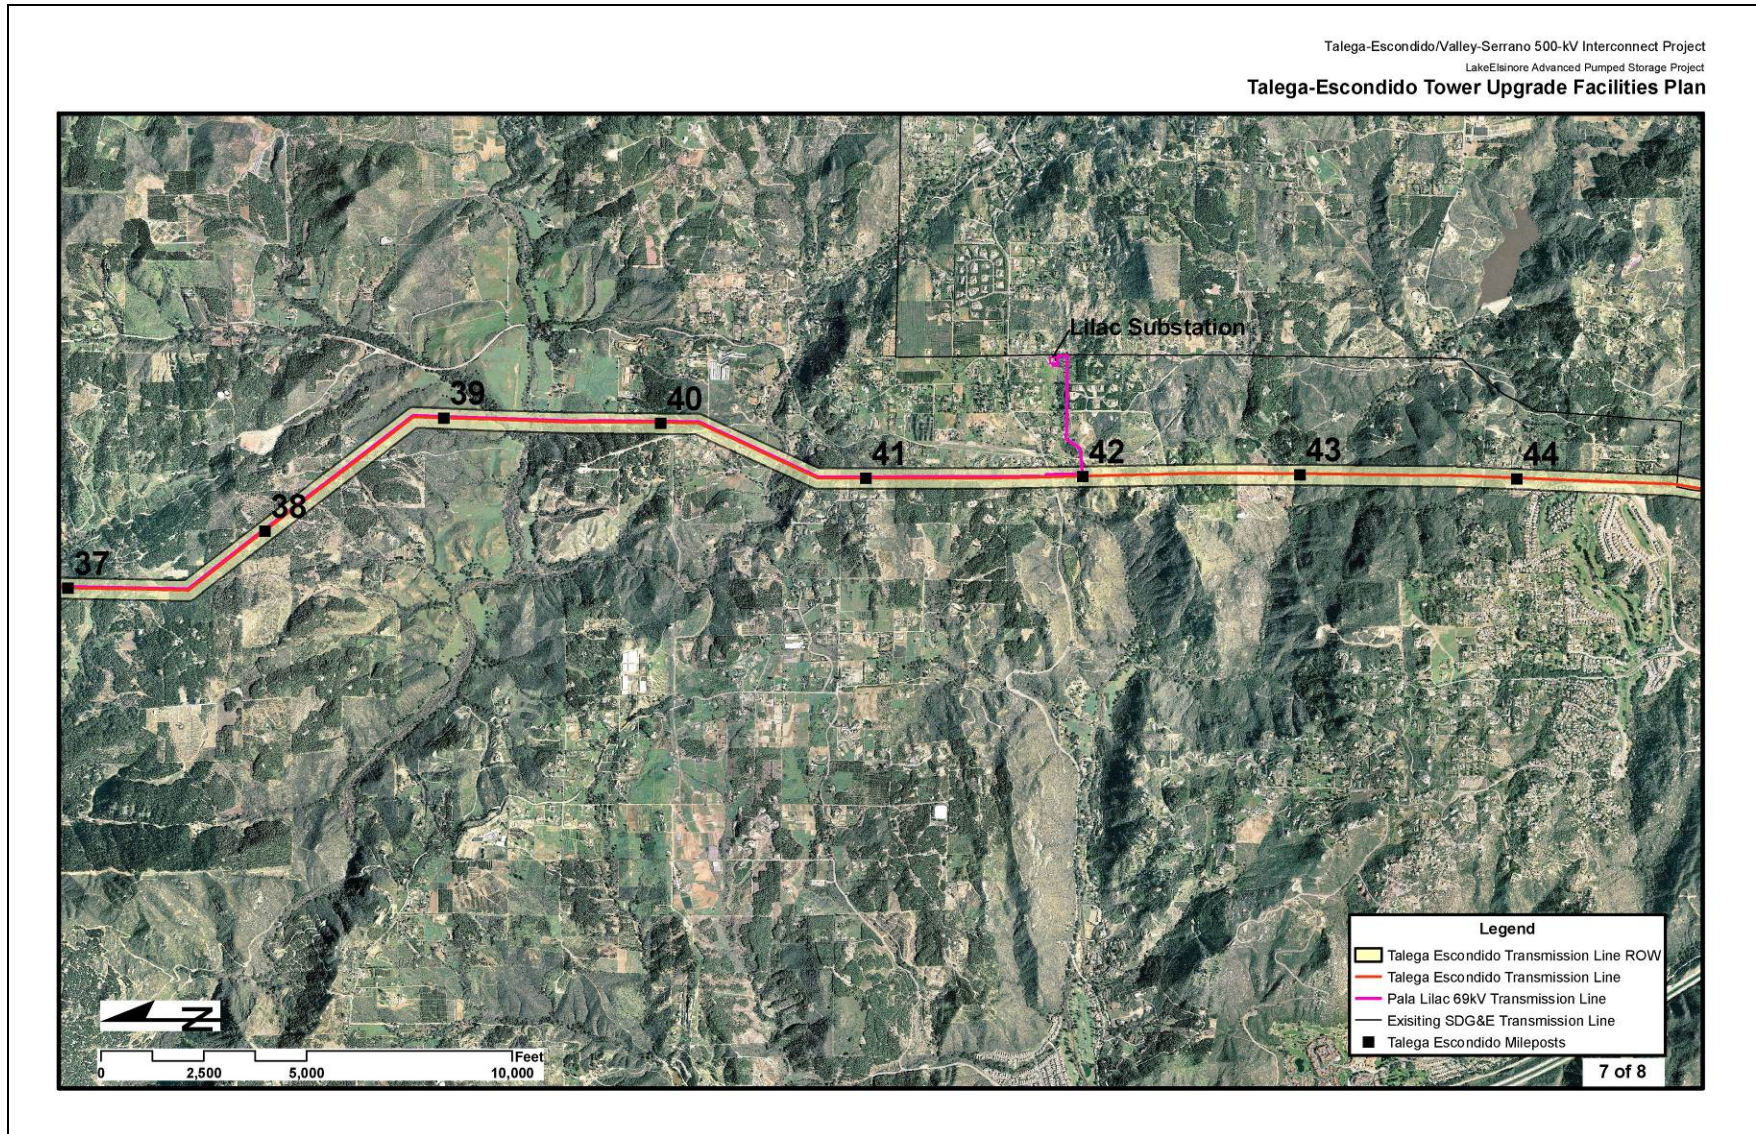

**Figure 3.6.3-2: Talega-Escondido 230 kV Line Upgrade Map (7 of 8)**

Source: The Nevada Hydro Company



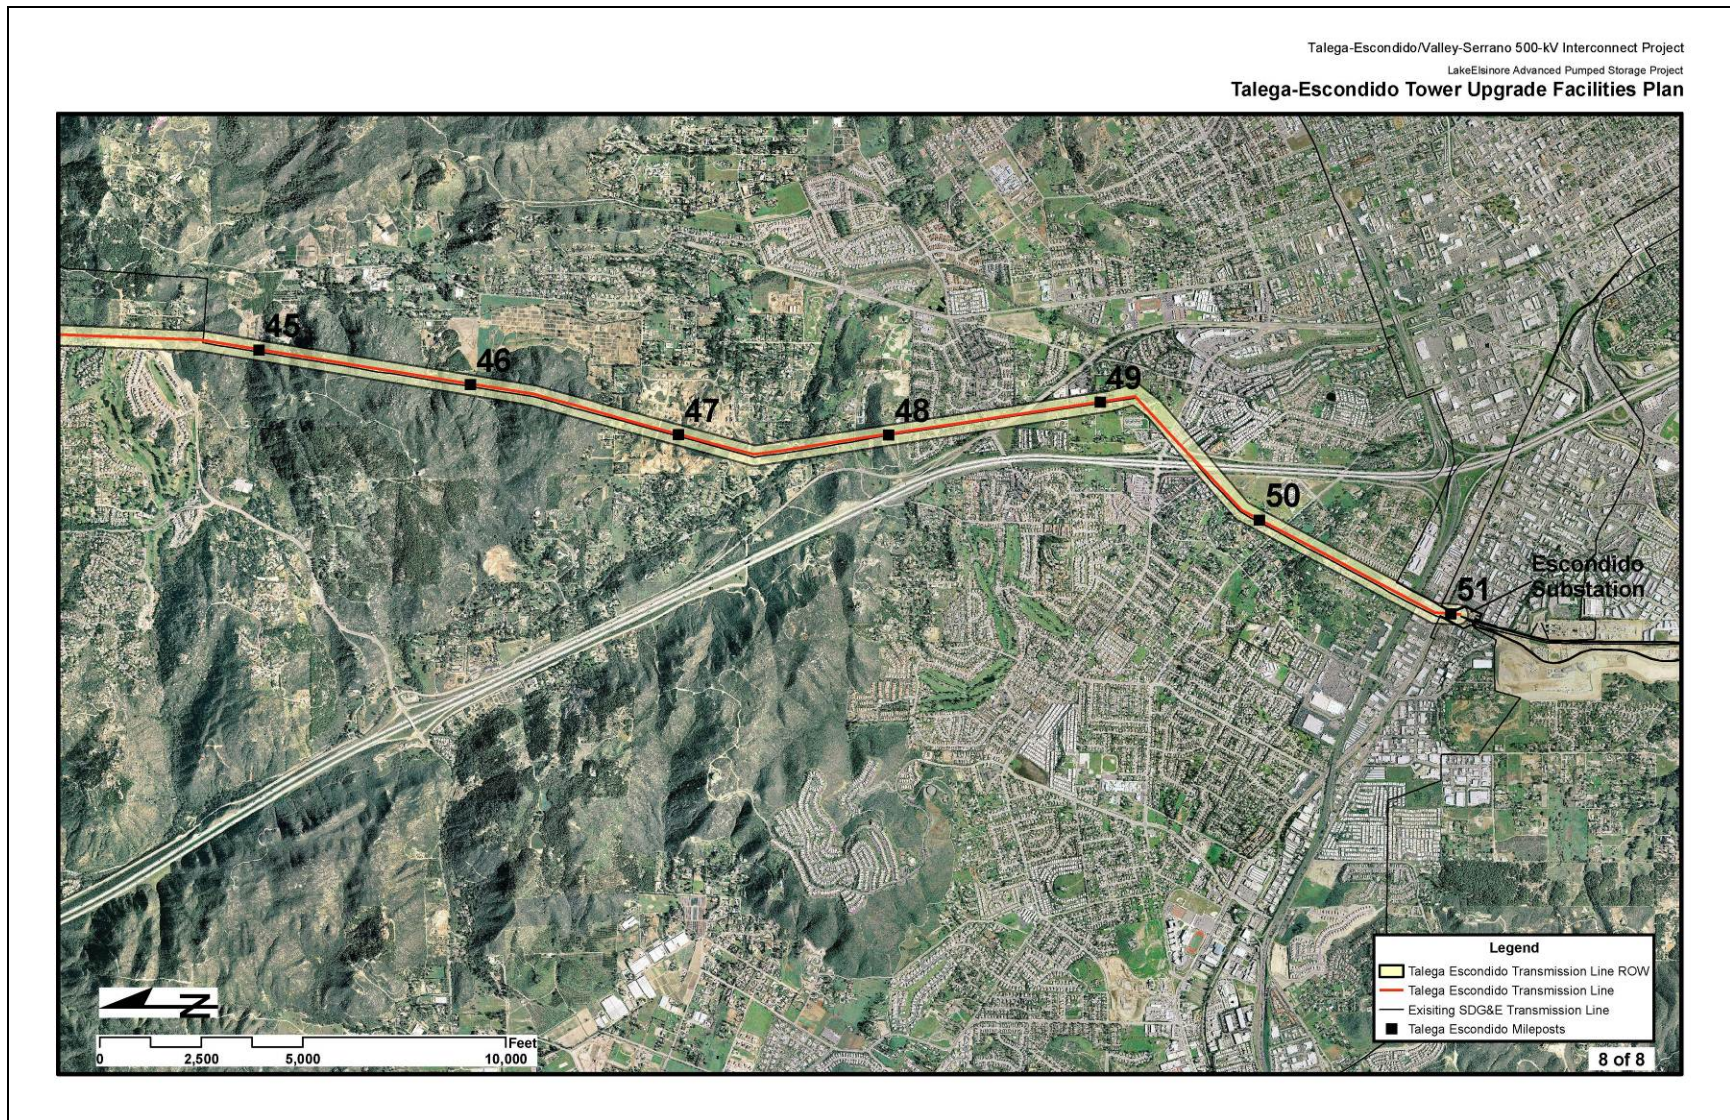

**Figure 3.6.3-2: Talega-Escondido 230 kV Line Upgrade Map (8 of 8)**

Source: The Nevada Hydro Company



This Page Intentionally Blank