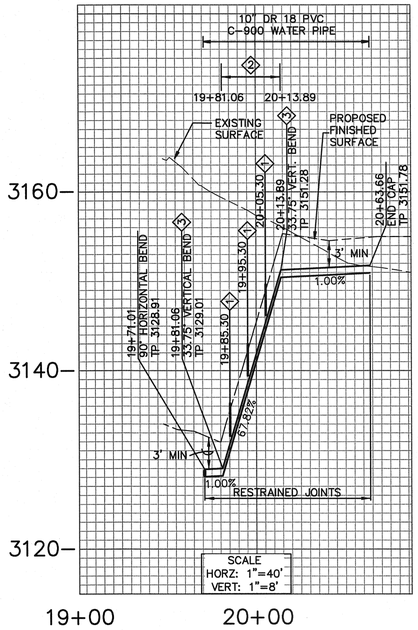

CONSTRUCTION NOTES

1. INSTALL CUTOFF WALL PER WAS DWG WP-05.
2. INSTALL 4" GUNITE BLANKET PER WAS DWG. WP-05.
3. INSTALL 22.5° AND 11.25° FLG. VERTICAL BENDS TOGETHER.

WATER DATA TABLE

SYMBOL	DELTA/BEARING	RADIUS	LENGTH	REMARKS
W1	N08°14'35"E	...	92.65'	10" PVC DR 18 C900

WATER NOTES:

1. ALL WATER PIPELINES SHALL HAVE 3' MINIMUM COVER.
2. INSTALL JOINT RESTRAINT SYSTEM AS REQUIRED AT ALL VALVES, BENDS, TEES AND FITTINGS TO MEET PRESSURE TEST REQUIREMENTS (SEE SPECIFICATION SECTION 1300)

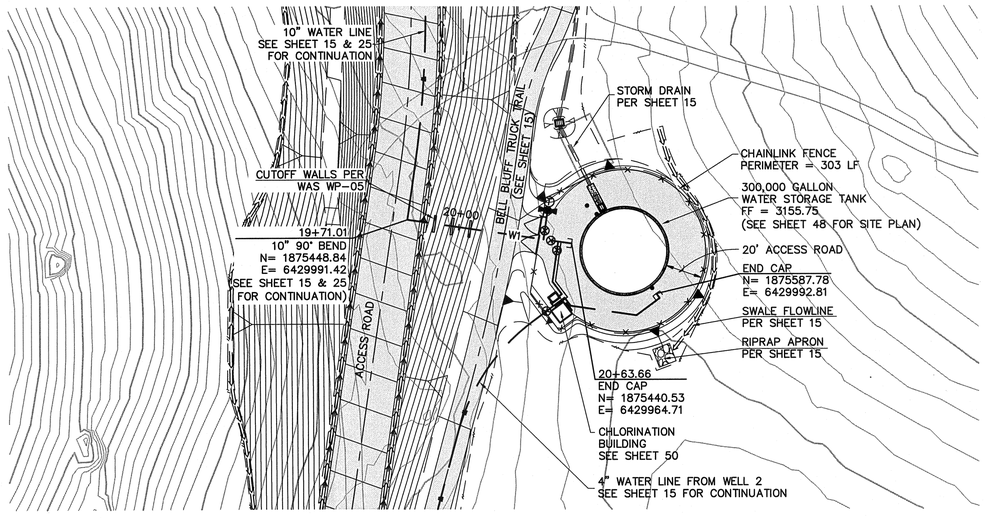

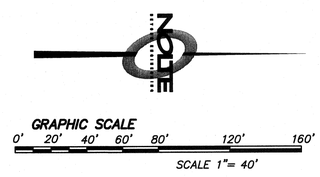

10-INCH WATER LINE PLAN AND PROFILE

3/30/10

NOLTE
BEYOND ENGINEERING

REVISIONS

NO.	WORK DONE	DATE:	BY:	APP'D:	NO.	WORK DONE	DATE:	BY:	APP'D:	NO.	WORK DONE	DATE:	BY:	APP'D:	NO.	WORK DONE	DATE:	BY:	APP'D:

SAN DIEGO GAS & ELECTRIC COMPANY
SAN DIEGO, CALIFORNIA

SUNCREST SUBSTATION

WATER AND WELL SYSTEM DETAILS

DRAWN BY:	APS	DATE: 3/24/10	SCALE: AS SHOWN	W.O.:	–	REV.:	0
CHECKED BY:	RWM	DATE: –					
APPROVED BY:	CR	DATE: –	SHEET 47 OF 66	SCR-C-047			
CAD NO.:	GP47	PLOT SCALE:	1=1				

N:\SDB039600\CADD\USFS\CIVIL\GP\GP47
XREFS: