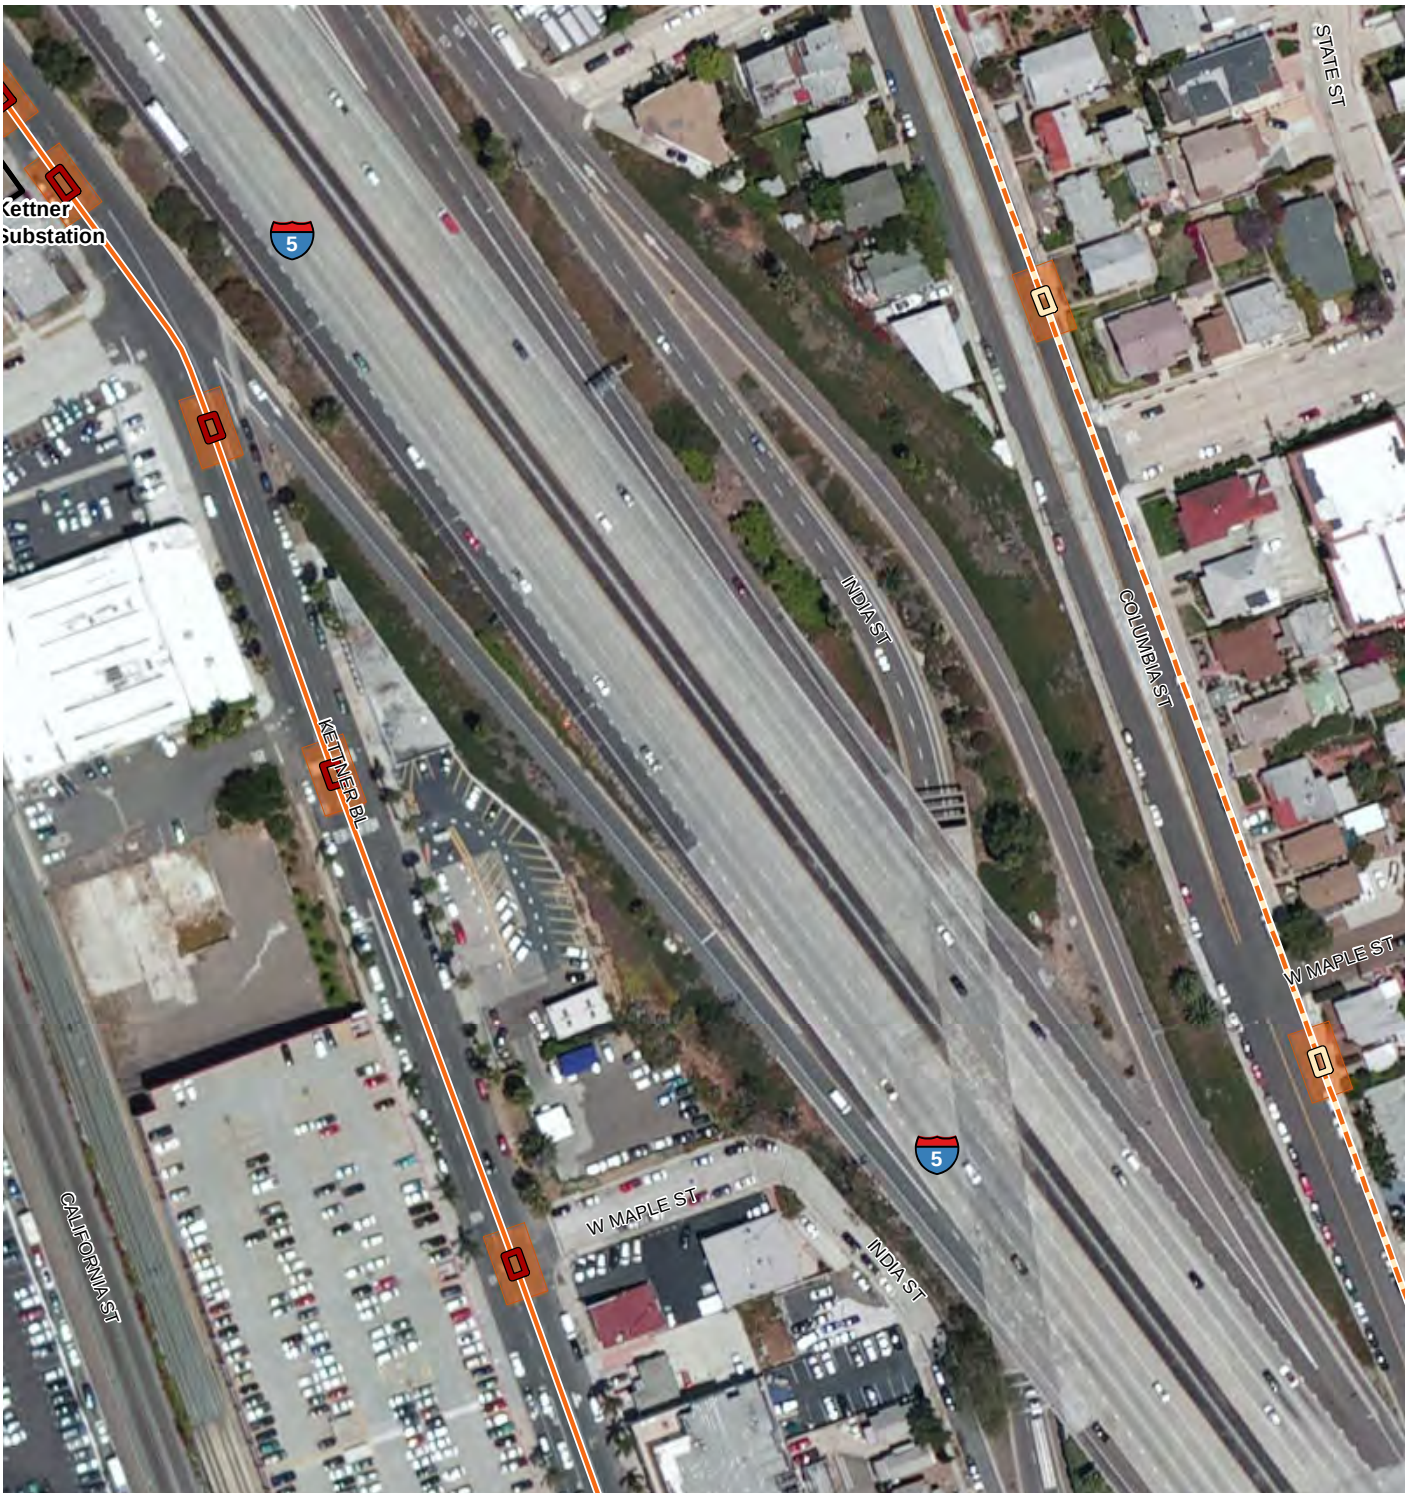

Proposed Vine 69/12 kV Substation
Existing Kettner Substation
Transmission Work Area
Jack-and-Bore Work Area
Existing 12 kV Distribution Vault
Proposed 12 kV Distribution Vault
Proposed Telecommunication Handhole
Proposed 12 kV Distribution Pull Site
Existing Pole
Install New TSP
Replace Existing Pole with TSP
Remove Existing Pole
Remove Existing Stub Guy Pole
Potential AT&T Interconnection Point
Proposed Capacitor Bank
Proposed Switch
Existing 69 kV Overhead
Existing 69 kV Overhead to be Removed
Proposed 69 kV Overhead
Existing 12 kV Duct Bank
Proposed 12 kV Underground
Proposed 12 kV and Telecommunications Duct Bank
Proposed Telecommunications Duct Bank

Source: SDG&E,2015b

1:1,600
0 100 200 Feet

Figure B.1-3e: Detailed Project Components