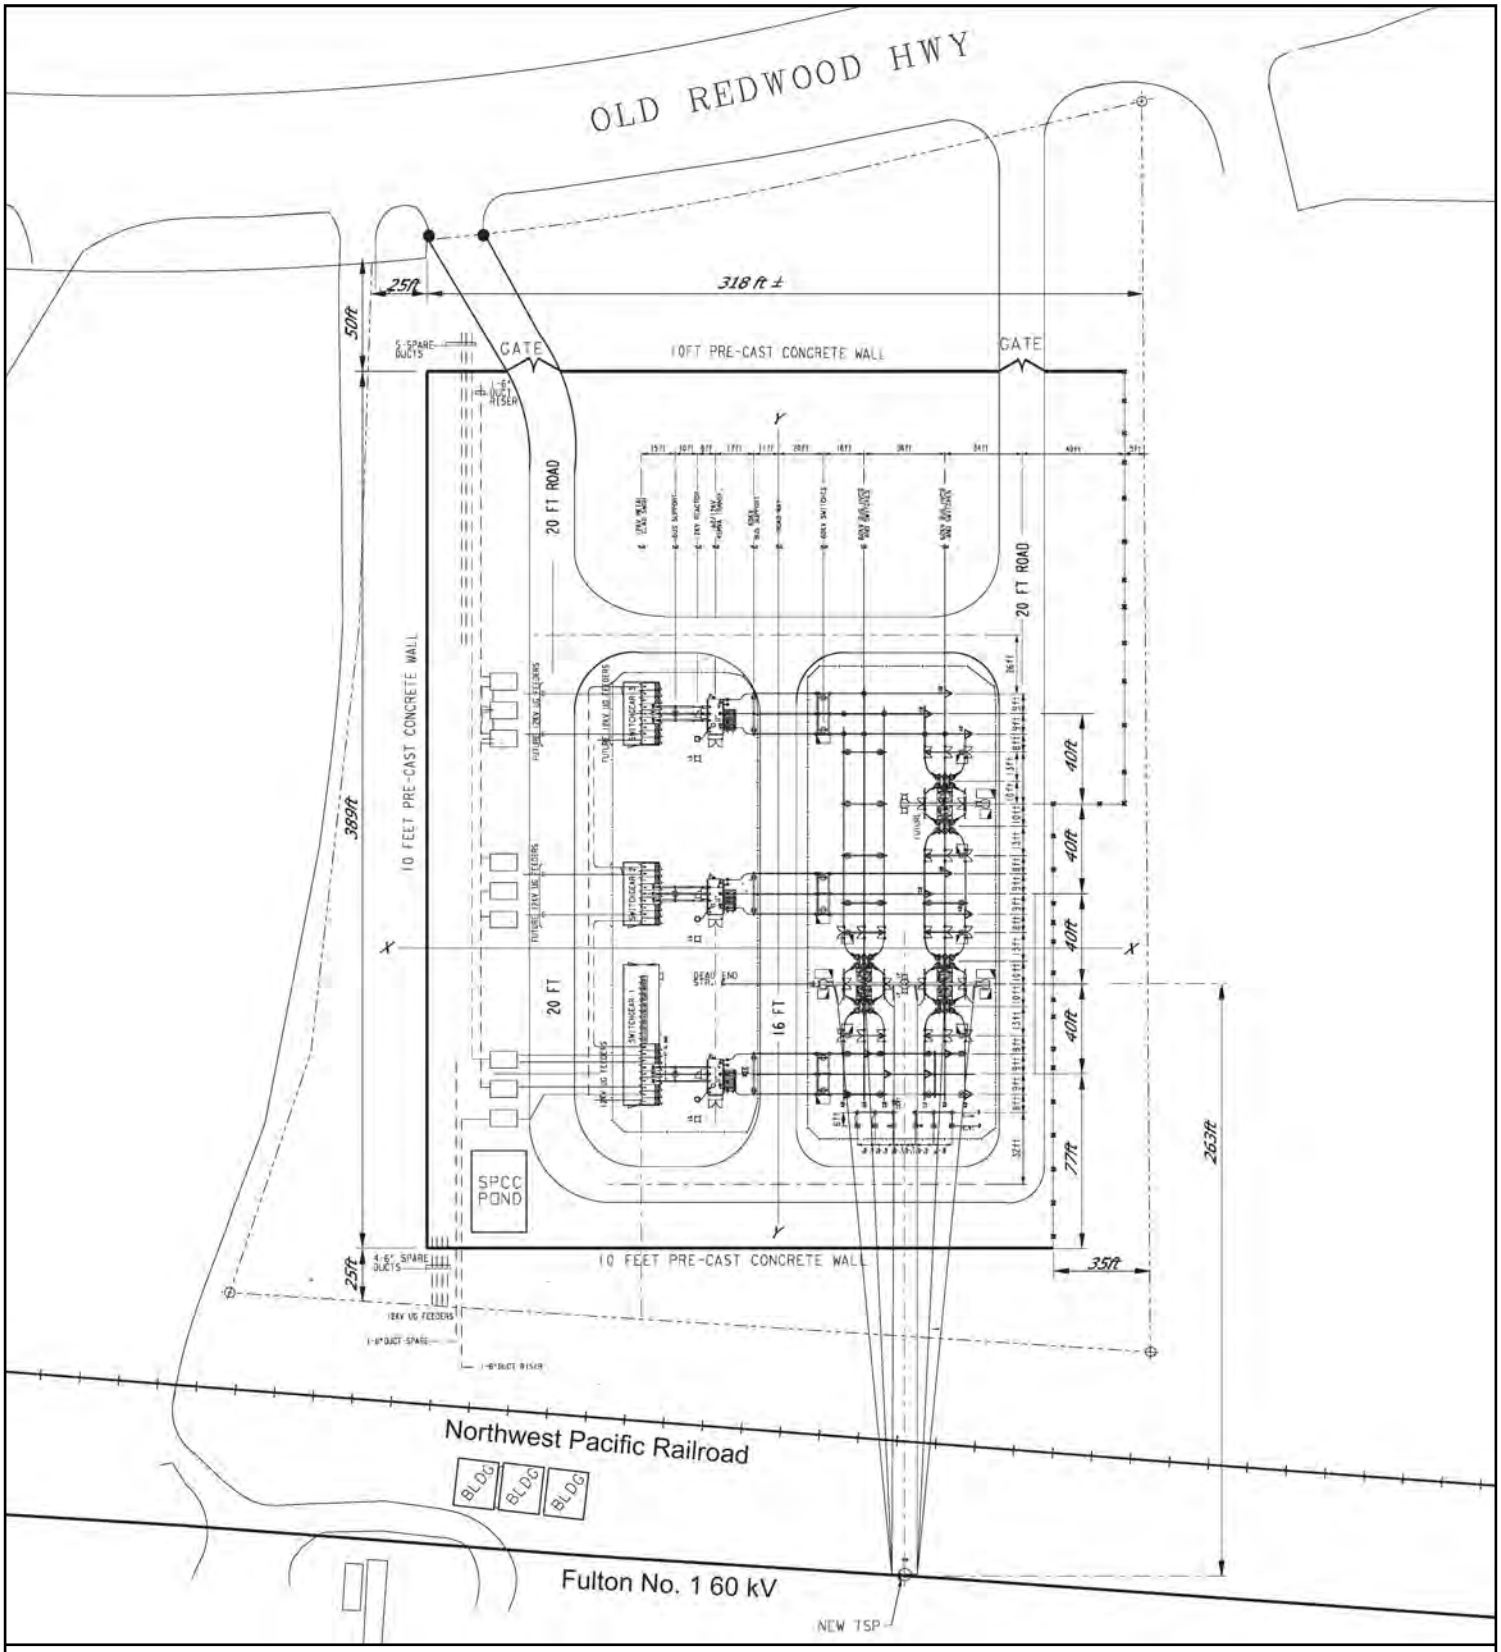

Source: PG&E, 2012.

Aspen Environmental Group

Figure 4-4

Typical Three Bank Substation