


T-121 PROFILE VIEW
(NOT TO SCALE)

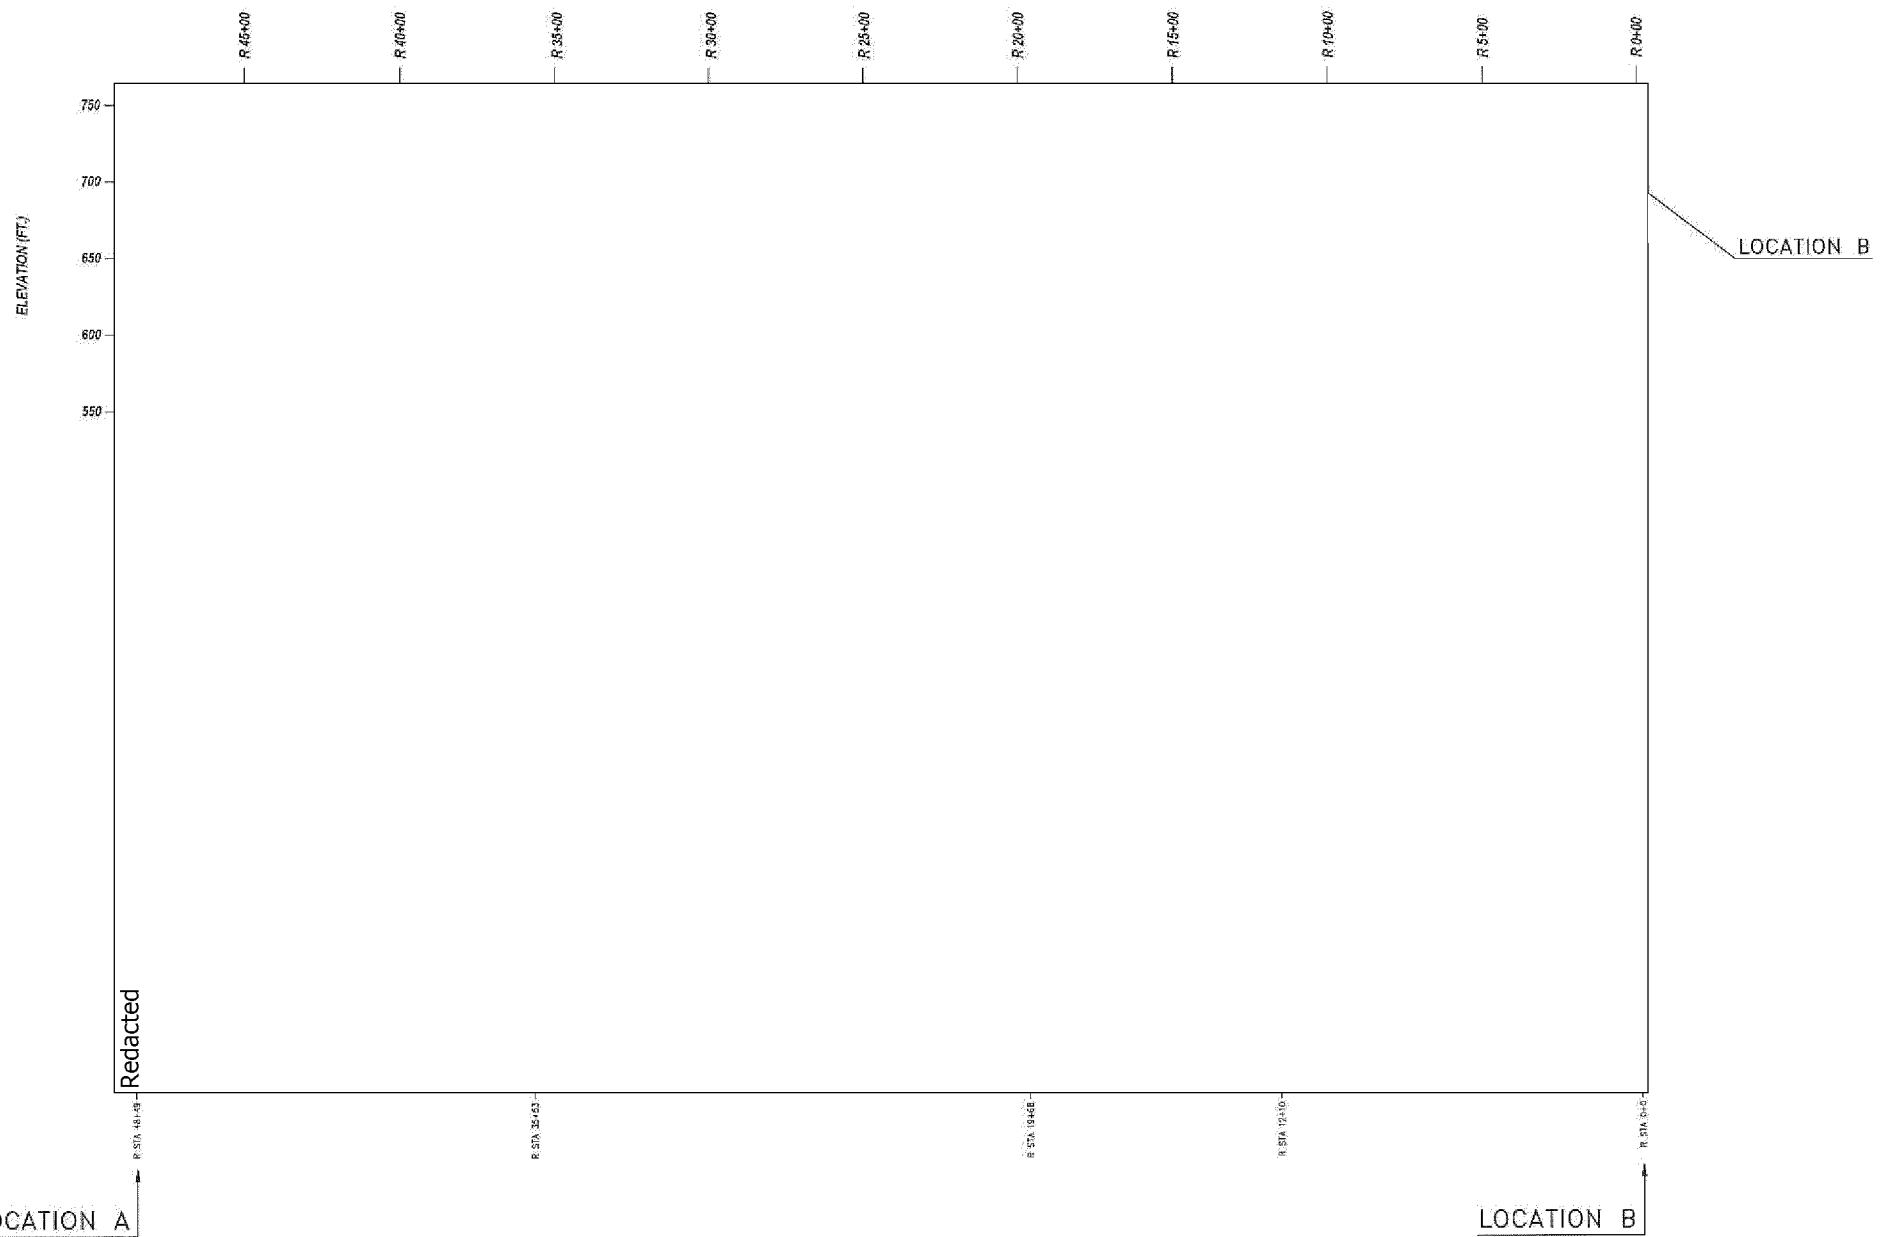

NOTE:
FIELD TO VERIFY WITH
GPS LAT./LONG. WHERE
SPECIFIED.

_____	P STATION
_____	FITTING (MATERIAL OF RECORD)
_____	PIPE (MATERIAL OF RECORD)
_____	GM NUMBER
_____	YEAR INSTALLED (LENGTH)
_____	R STATION

LOCATION A

LOCATION B

PIPELINE FEATURES
SEE MATERIAL OF RECORD ON
SHEET 5 OF 5
(NOT TO SCALE)

LOCATION	R STA.	ELEV.	MIN. PRESS	MAX. PRESS
MIN. PRESSURE CONTROL POINT	0+00	693'	1097 psig	
MAX. PRESSURE CONTROL POINT	48+49	528'		1200 psig
LOCATION A (TEST STATION)	48+49	528'	1169 psig	1200 psig
LOCATION B	0+00	693'	1097 psig	1143 psig

SAFETY

SAFETY PLEDGE

I ALWAYS PUT SAFETY FIRST.
I LOOK FOR AND ACT TO
RESOLVE UNSAFE SITUATIONS.
I HELP AND ENCOURAGE
OTHERS TO ACT SAFELY.



NO.	DATE	ISSUED FOR	DESCRIPTION	CM/SPEC	DWN	CHKD	SUPV	APVD BY
1	10/31/11	ISSUED FOR CONSTRUCTION						

APPROVED BY	CM 41592685
SUPV	
DSCR	
DWN PRC	
CHKD IGH	
OK RAA	
DATE	10/31/11
SCALE	

HYDROTEST 121
LIVERMORE, CALIFORNIA

MP Reaater
LIVERMORE, CALIFORNIA

PACIFIC GAS AND ELECTRIC COMPANY
WALNUT CREEK, CALIFORNIA

MICROFILM	
BILL OF MATL SHEET 05	
DWG LIST	
SUPSDS	
SUPSD BY	
SHEET NO. 03 OF 05 SHEETS	
41592685	0

1 10 0 INCH