



Pacific Gas and Electric Company
Gas Pipeline Facilities Strength Test Pressure Report
(For Pipeline Facilities Designed to Operate over 100 PSIG)

62-4921 (Rev. 2/04)
California Gas Transmission
(Use in Accordance with Gas Standard A-31 and G0 112-D)

Sheet 1 of 2

Redacted




Pacific Gas and Electric Company
Gas Pipeline Facilities Strength Test Pressure Report
(For Pipeline Facilities Designed to Operate over 100 PSIG)


62-4921 (Rev. 2/04)
California Gas Transmission
(Use in Accordance With Gas Standard A-34 and CGO 112-D)

Sheet 2 of 2

Redacted



Redacted



Redacted

Redacted

INDEX PAGE # _____

SHEET _____ OF _____

Redacted

E

D

C

B

A

Redacted

10

9

8

7

6

5

4

3

2

1

E

D

C

B

A

10

9

8

7

6

5


4

3

2

1

Redacted

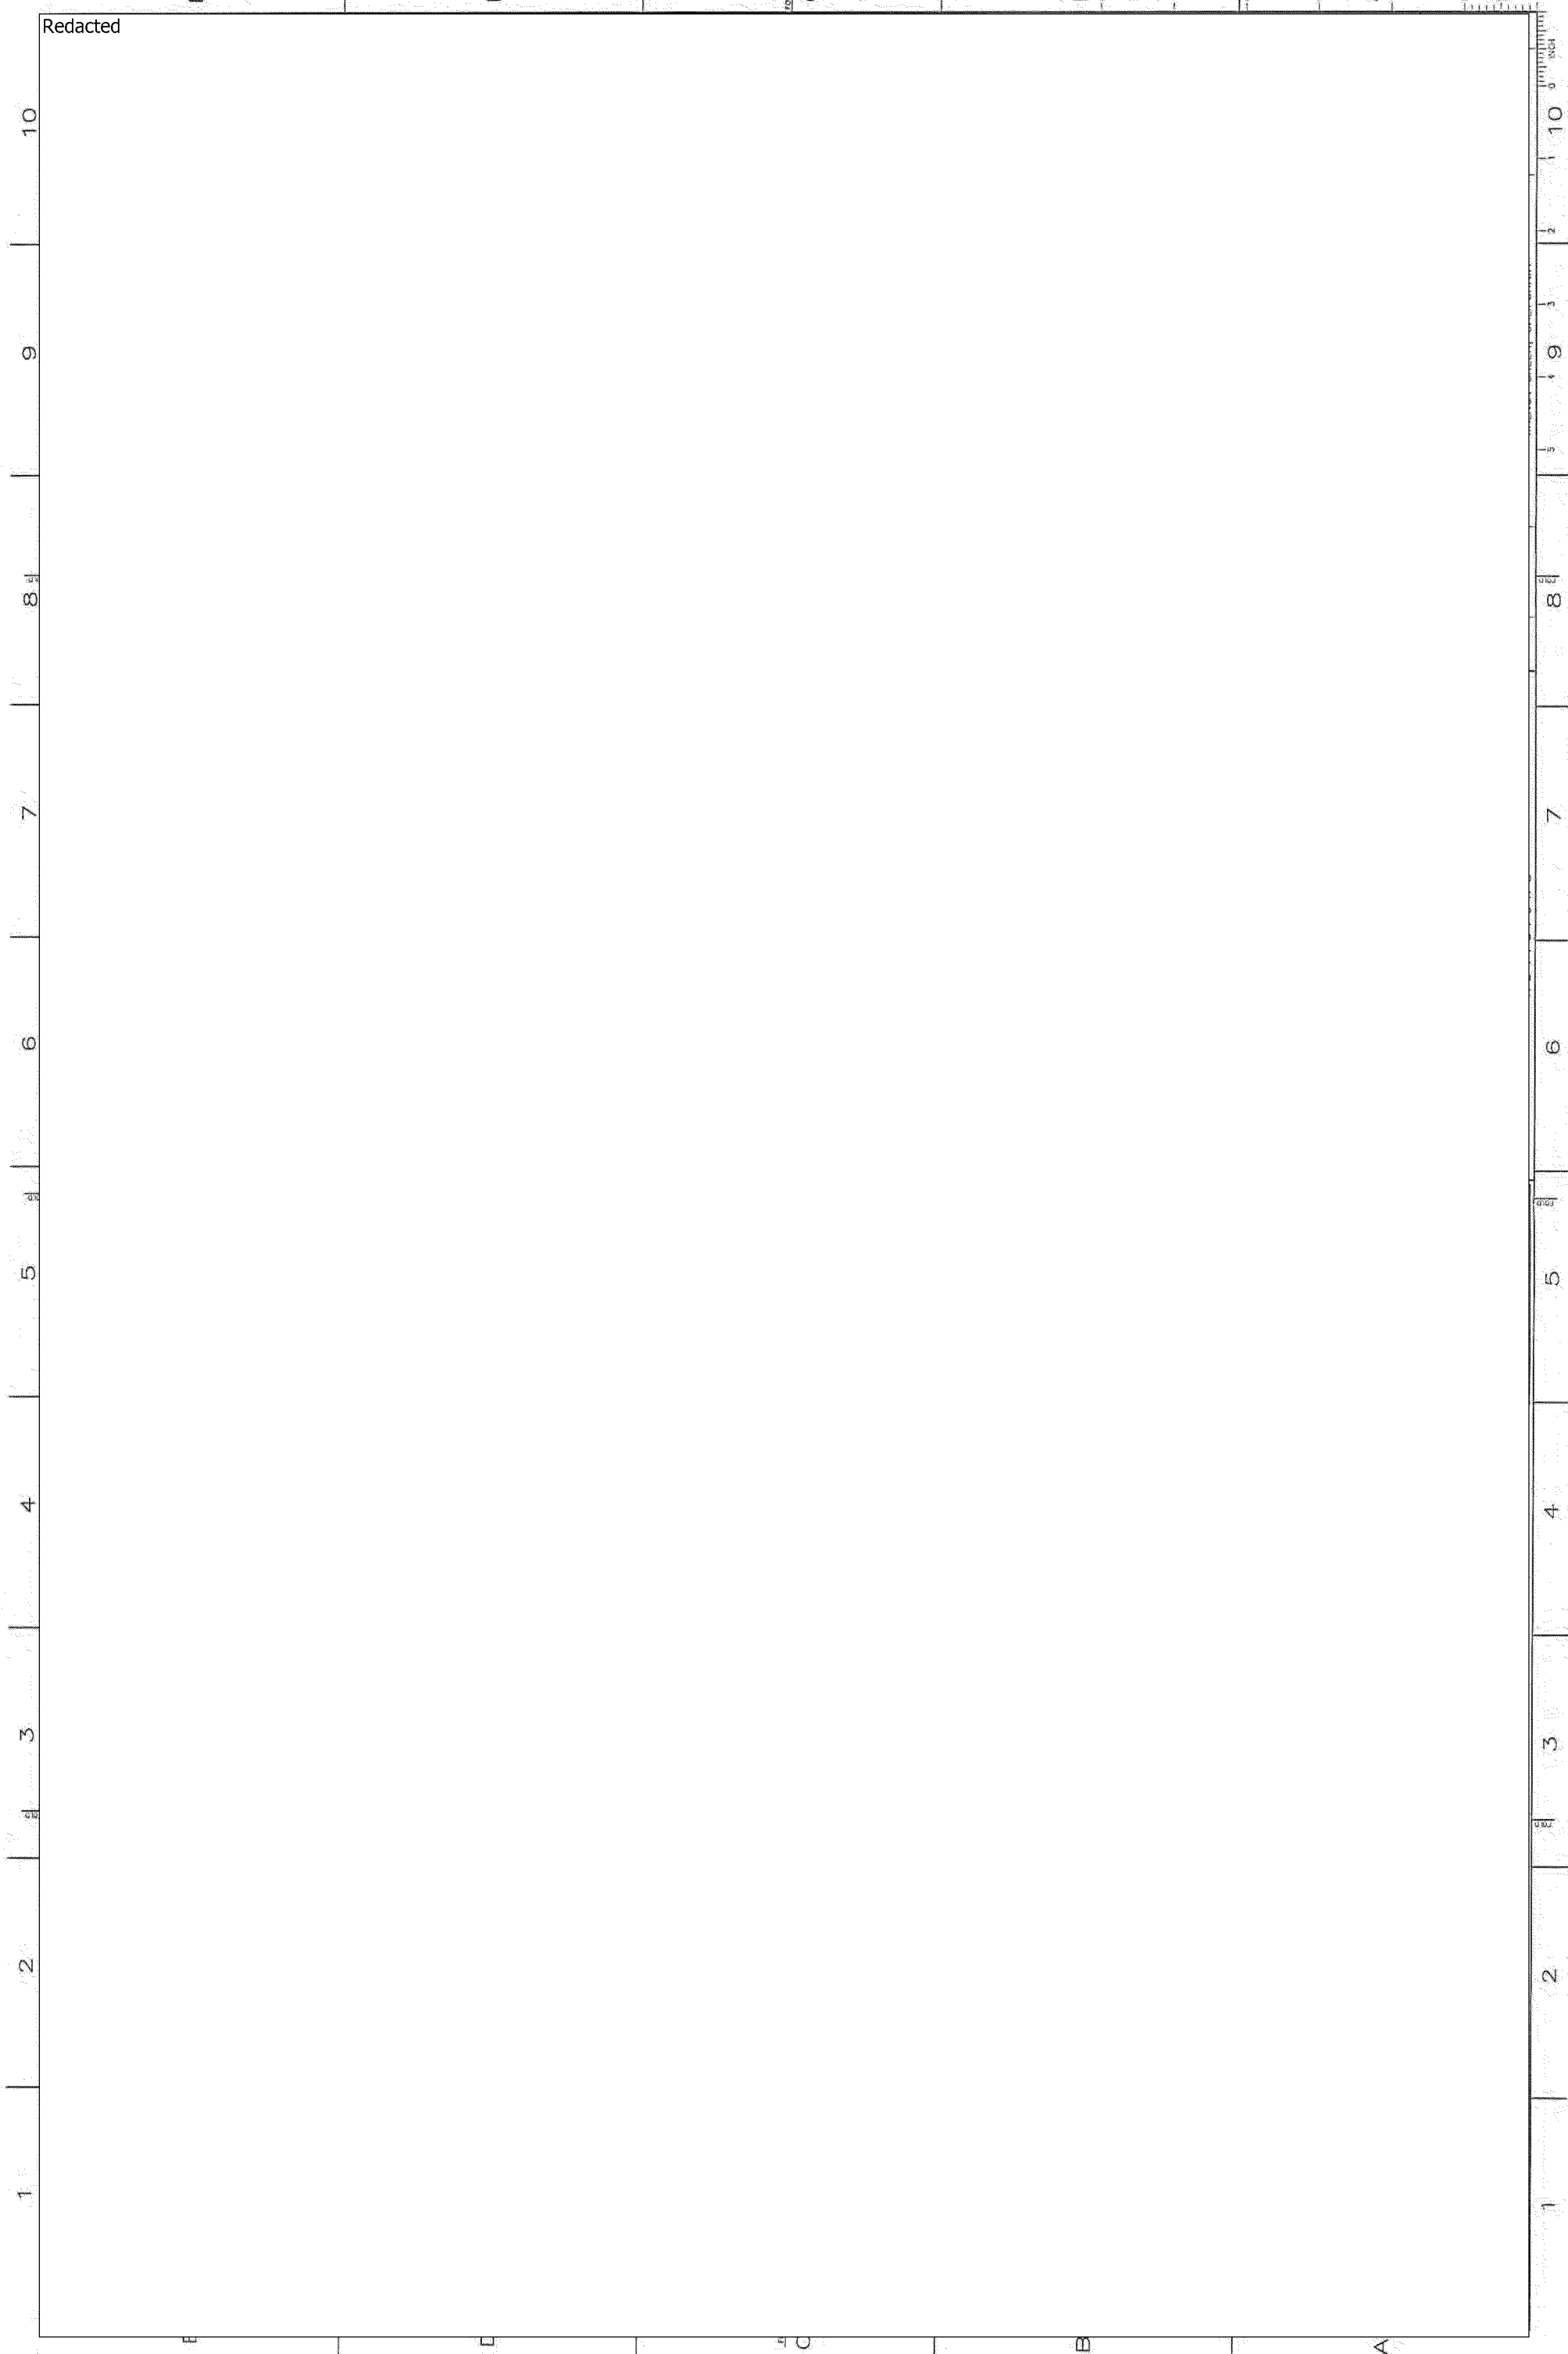

10
9
8
7
6
5
4
3
2
1

10
9
8
7
6
5
4
3
2
1

E D C B A

Redacted



Nitrogen Pressure Test Log

Redacted

RCP

Redacted



Nitrogen Test Certification

Redacted



Nitrogen Pressure Test Dead Weight Log Sheet

Redacted

RCP

Nitrogen Pressure Test Pipe Data Table


Redacted

Redacted

Redacted

Redacted

Redacted



Copyright © and (P) 1988–2008 Microsoft Corporation and/or its suppliers. All rights reserved. <http://www.microsoft.com/streets/>
Certain mapping and direction data © 2008 NAVTEQ. All rights reserved. The Data for areas of Canada includes information taken with permission from Canadian authorities, including: © Her Majesty the Queen in Right of Canada, © Queen's Printer for Ontario. NAVTEQ and NAVTEQ ON BOARD are trademarks of NAVTEQ. © 2008 Tele Atlas North America, Inc. All rights reserved. Tele Atlas and Tele Atlas North America are trademarks of Tele Atlas, Inc. © 2008 by Applied Geographic Systems. All rights reserved.

Exh G-99

SB GT&S_0495991

Redacted

