



Pacific Gas and Electric Company  
**Gas Pipeline Facilities Strength Test Pressure Report**  
(For Pipeline Facilities Designed to Operate over 100 PSIG)

62-4921 (Rev. 2/04)  
California Gas Transmission  
(Use in Accordance with Gas Standard A-31 and G0 112-D)

Sheet 1 of 2

Redacted



Pacific Gas and Electric Company  
**Gas Pipeline Facilities Strength Test Pressure Report**  
(For Pipeline Facilities Designed to Operate over 100 PSIG)

62-4921 (Rev. 2/04)  
California Gas Transmission  
(Use in Accordance With Gas Standard A-34 and CGO 112-D)

Sheet 2 of 2

Redacted

Redacted

Redacted

Redacted

10

11

Redacted

Redacted

E D C B A


Redacted

10  
9  
8  
7  
6  
5  
4  
3  
2  
1

E D C B A



Redacted

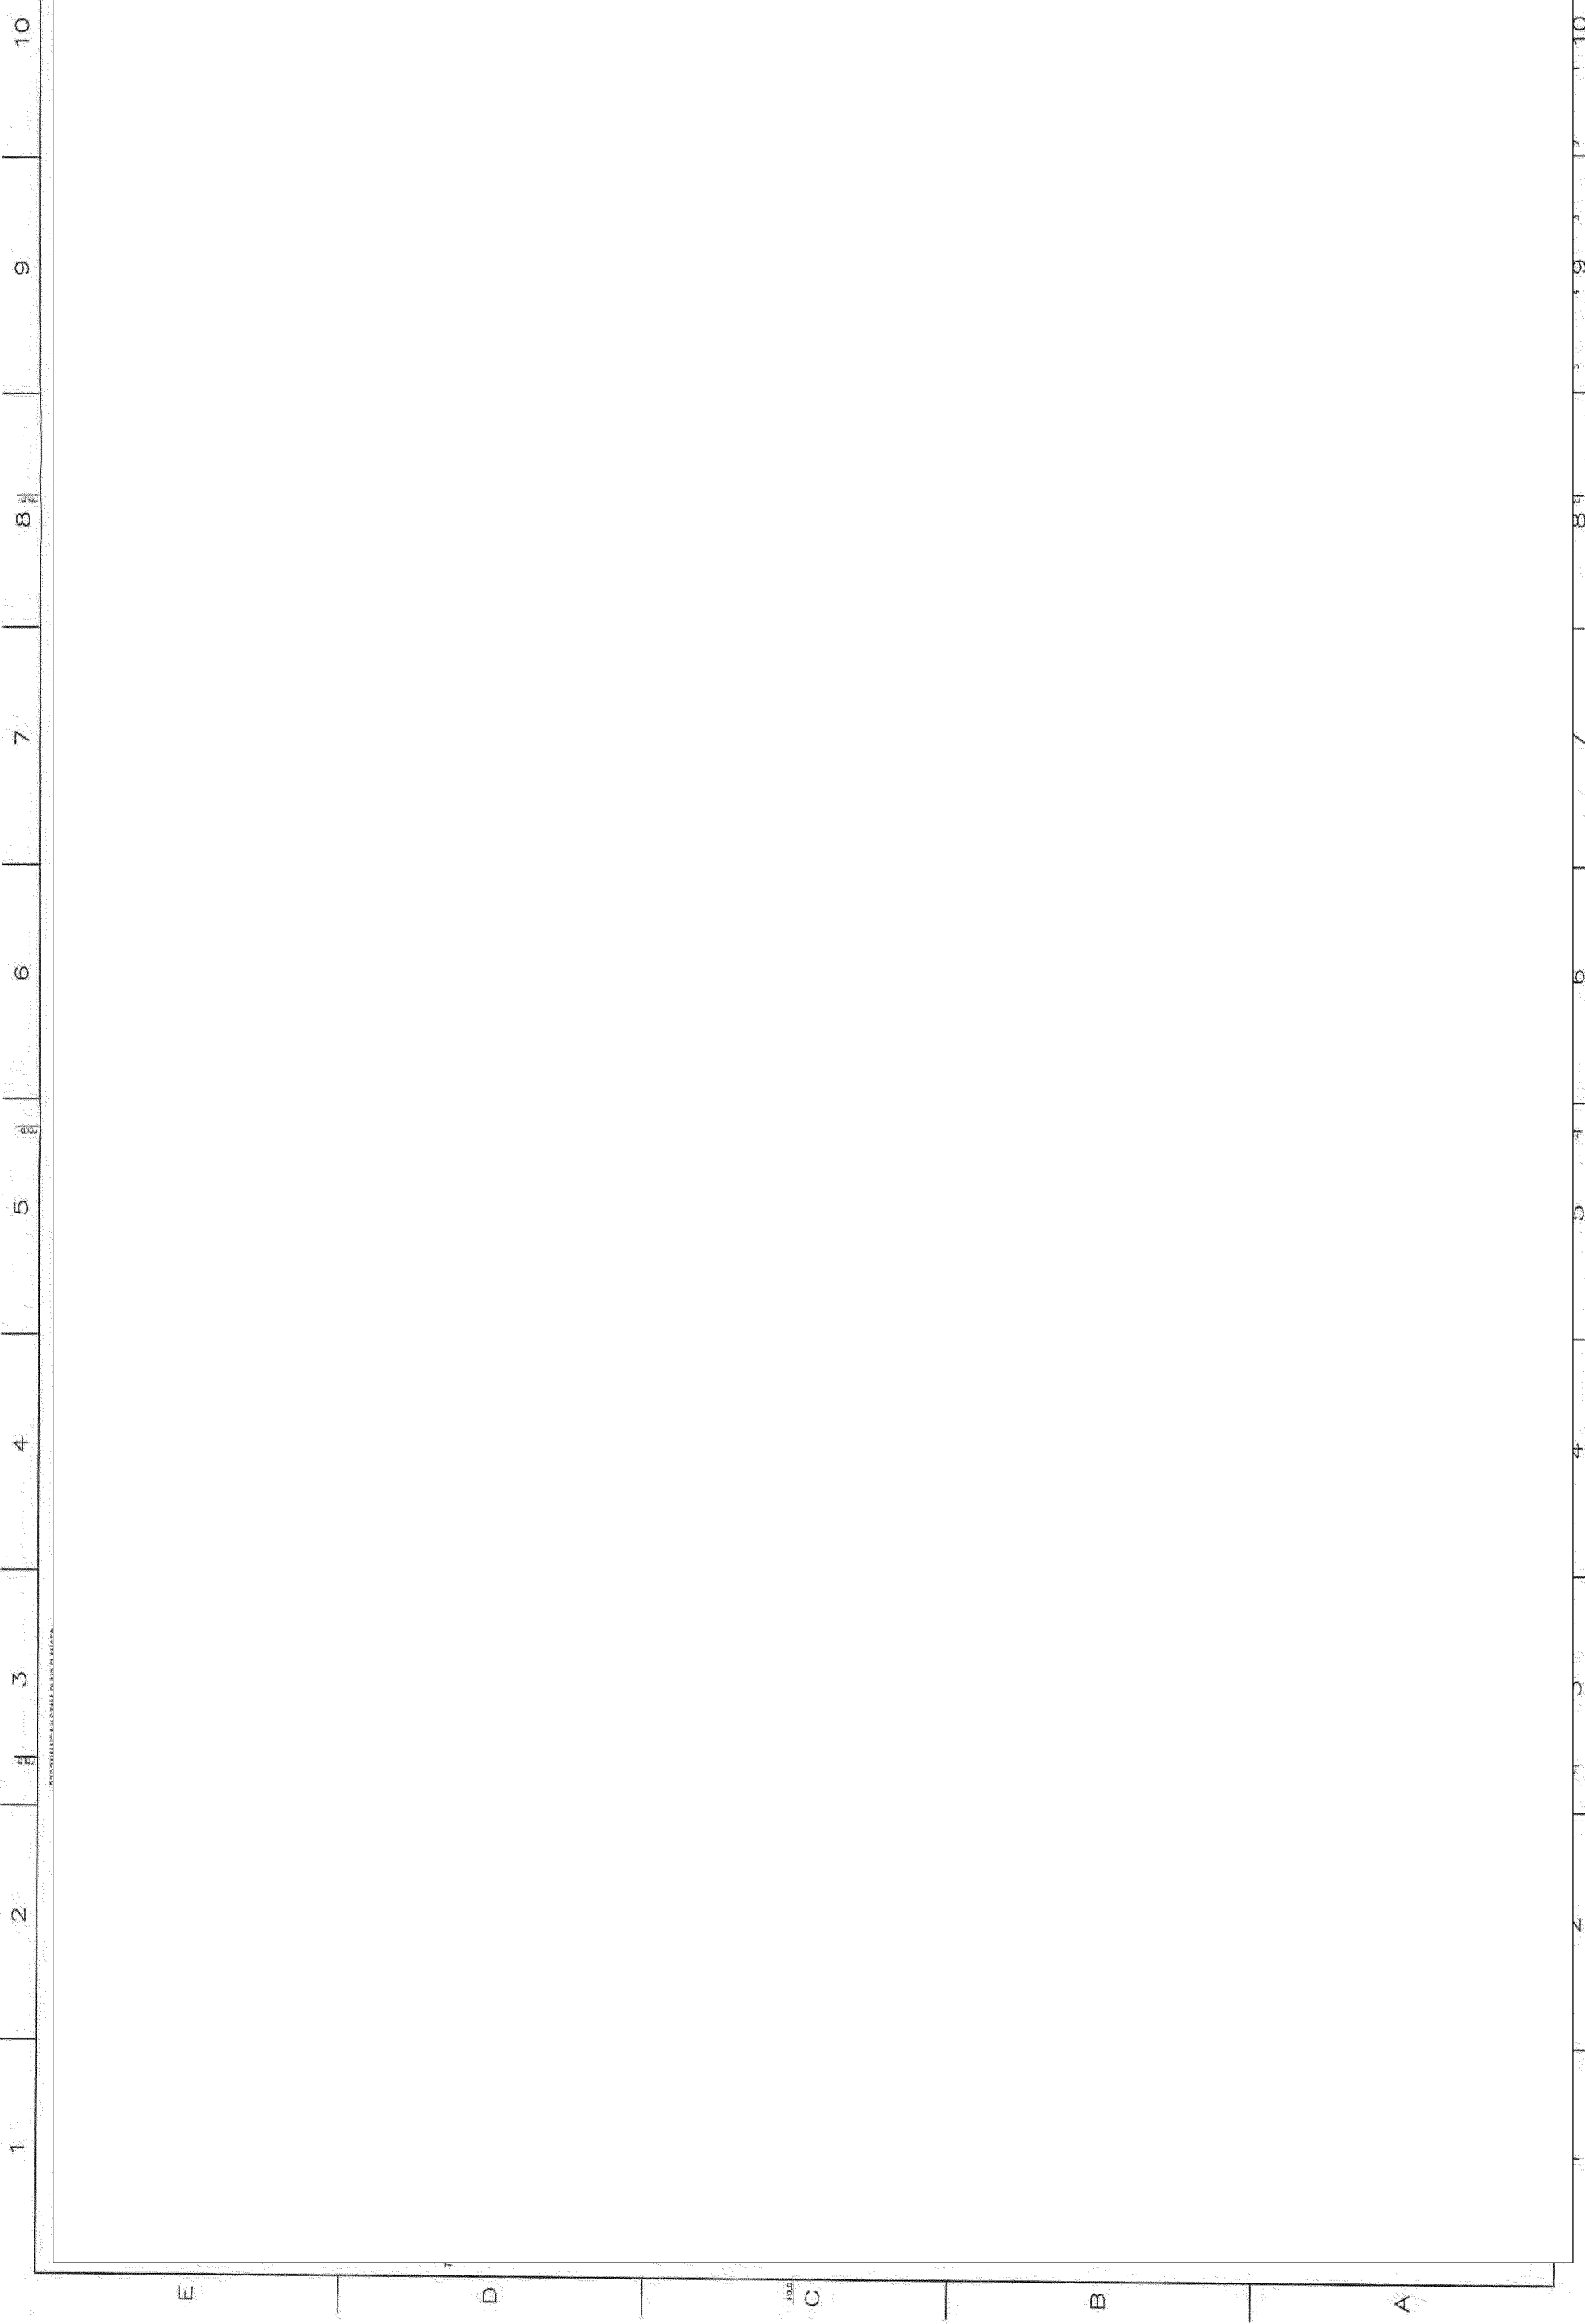

Redacted



# Nitrogen Pressure Test Log

Redacted



Redacted



**Nitrogen Test Certification**

Redacted



# Nitrogen Pressure Test Dead Weight Log Sheet

Redacted

**RCP**

**Nitrogen Pressure Test Pipe Data Table**

Redacted

Redacted




Redacted

Redacted



Redacted

Redacted



Redacted

