



# APPLIED TECHNOLOGY SERVICES



## Nondestructive Examination Unit

3400 Crow Canyon Road, San Ramon, CA 94583

### NONDESTRUCTIVE EXAMINATION DATA


<b>Location and Unit No:</b>	Redacted	<b>Examination Date:</b>	11/02/2010	<b>Job ID#</b>	07592 00I
	Redacted	<b>Examiner(s):</b>	Redacted		
<b>Client:</b>	Gas T&D				
<b>Client Contact:</b>	Redacted				

**COMPONENT EXAMINED:** Gas Line 101 MP 19.99 34" diameter with a 24" reducer, a 6' long section of uncoated and sandblasted pipe was tested

**INSPECTION METHOD:** Magnetic Particle (ATS-MT-200 procedure) Wet Fluorescent, Continuous technique. AC Yoke – with a leg spacing of 5" - Magnaglo 20B. All exposed and sandblasted parts of the pipeline were tested with the MT-AC technique for SCC type indications in the axial orientation of the pipeline.

**EXAMINATION RESULTS:** No Reportable Indications were found in the testing of this pipe segment for SCC.

Redacted

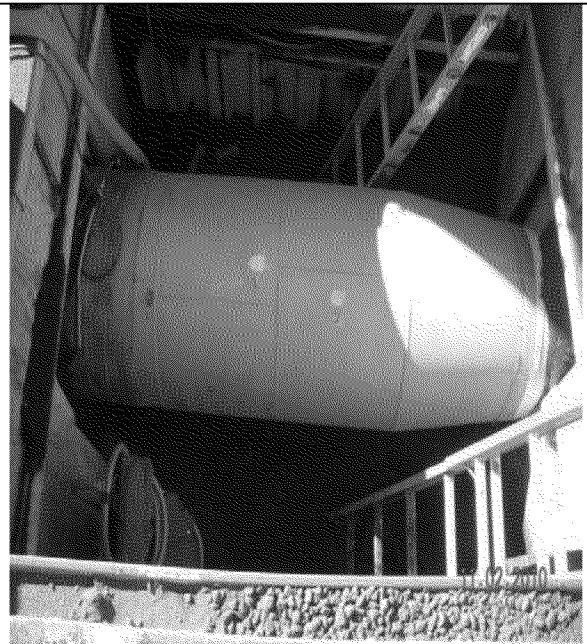

Line 101 Redwood City