



Pacific Gas and Electric Company
Gas Pipeline Facilities Strength Test Pressure Report
(For Pipeline Facilities Designed to Operate over 100 PSIG)

62-4921 (Rev. 2/04)
California Gas Transmission
(Use in Accordance with Gas Standard A-31 and GO 112-D)

Sheet 1 of 2

Redacted




Pacific Gas and Electric Company
Gas Pipeline Facilities Strength Test Pressure Report
(For Pipeline Facilities Designed to Operate over 100 PSIG)

62-4921 (Rev. 2/04)
California Gas Transmission
(Use in Accordance With Gas Standard A-34 and CGO 112-D)

Sheet 2 of 2


Redacted

Redacted




Redacted

Redacted

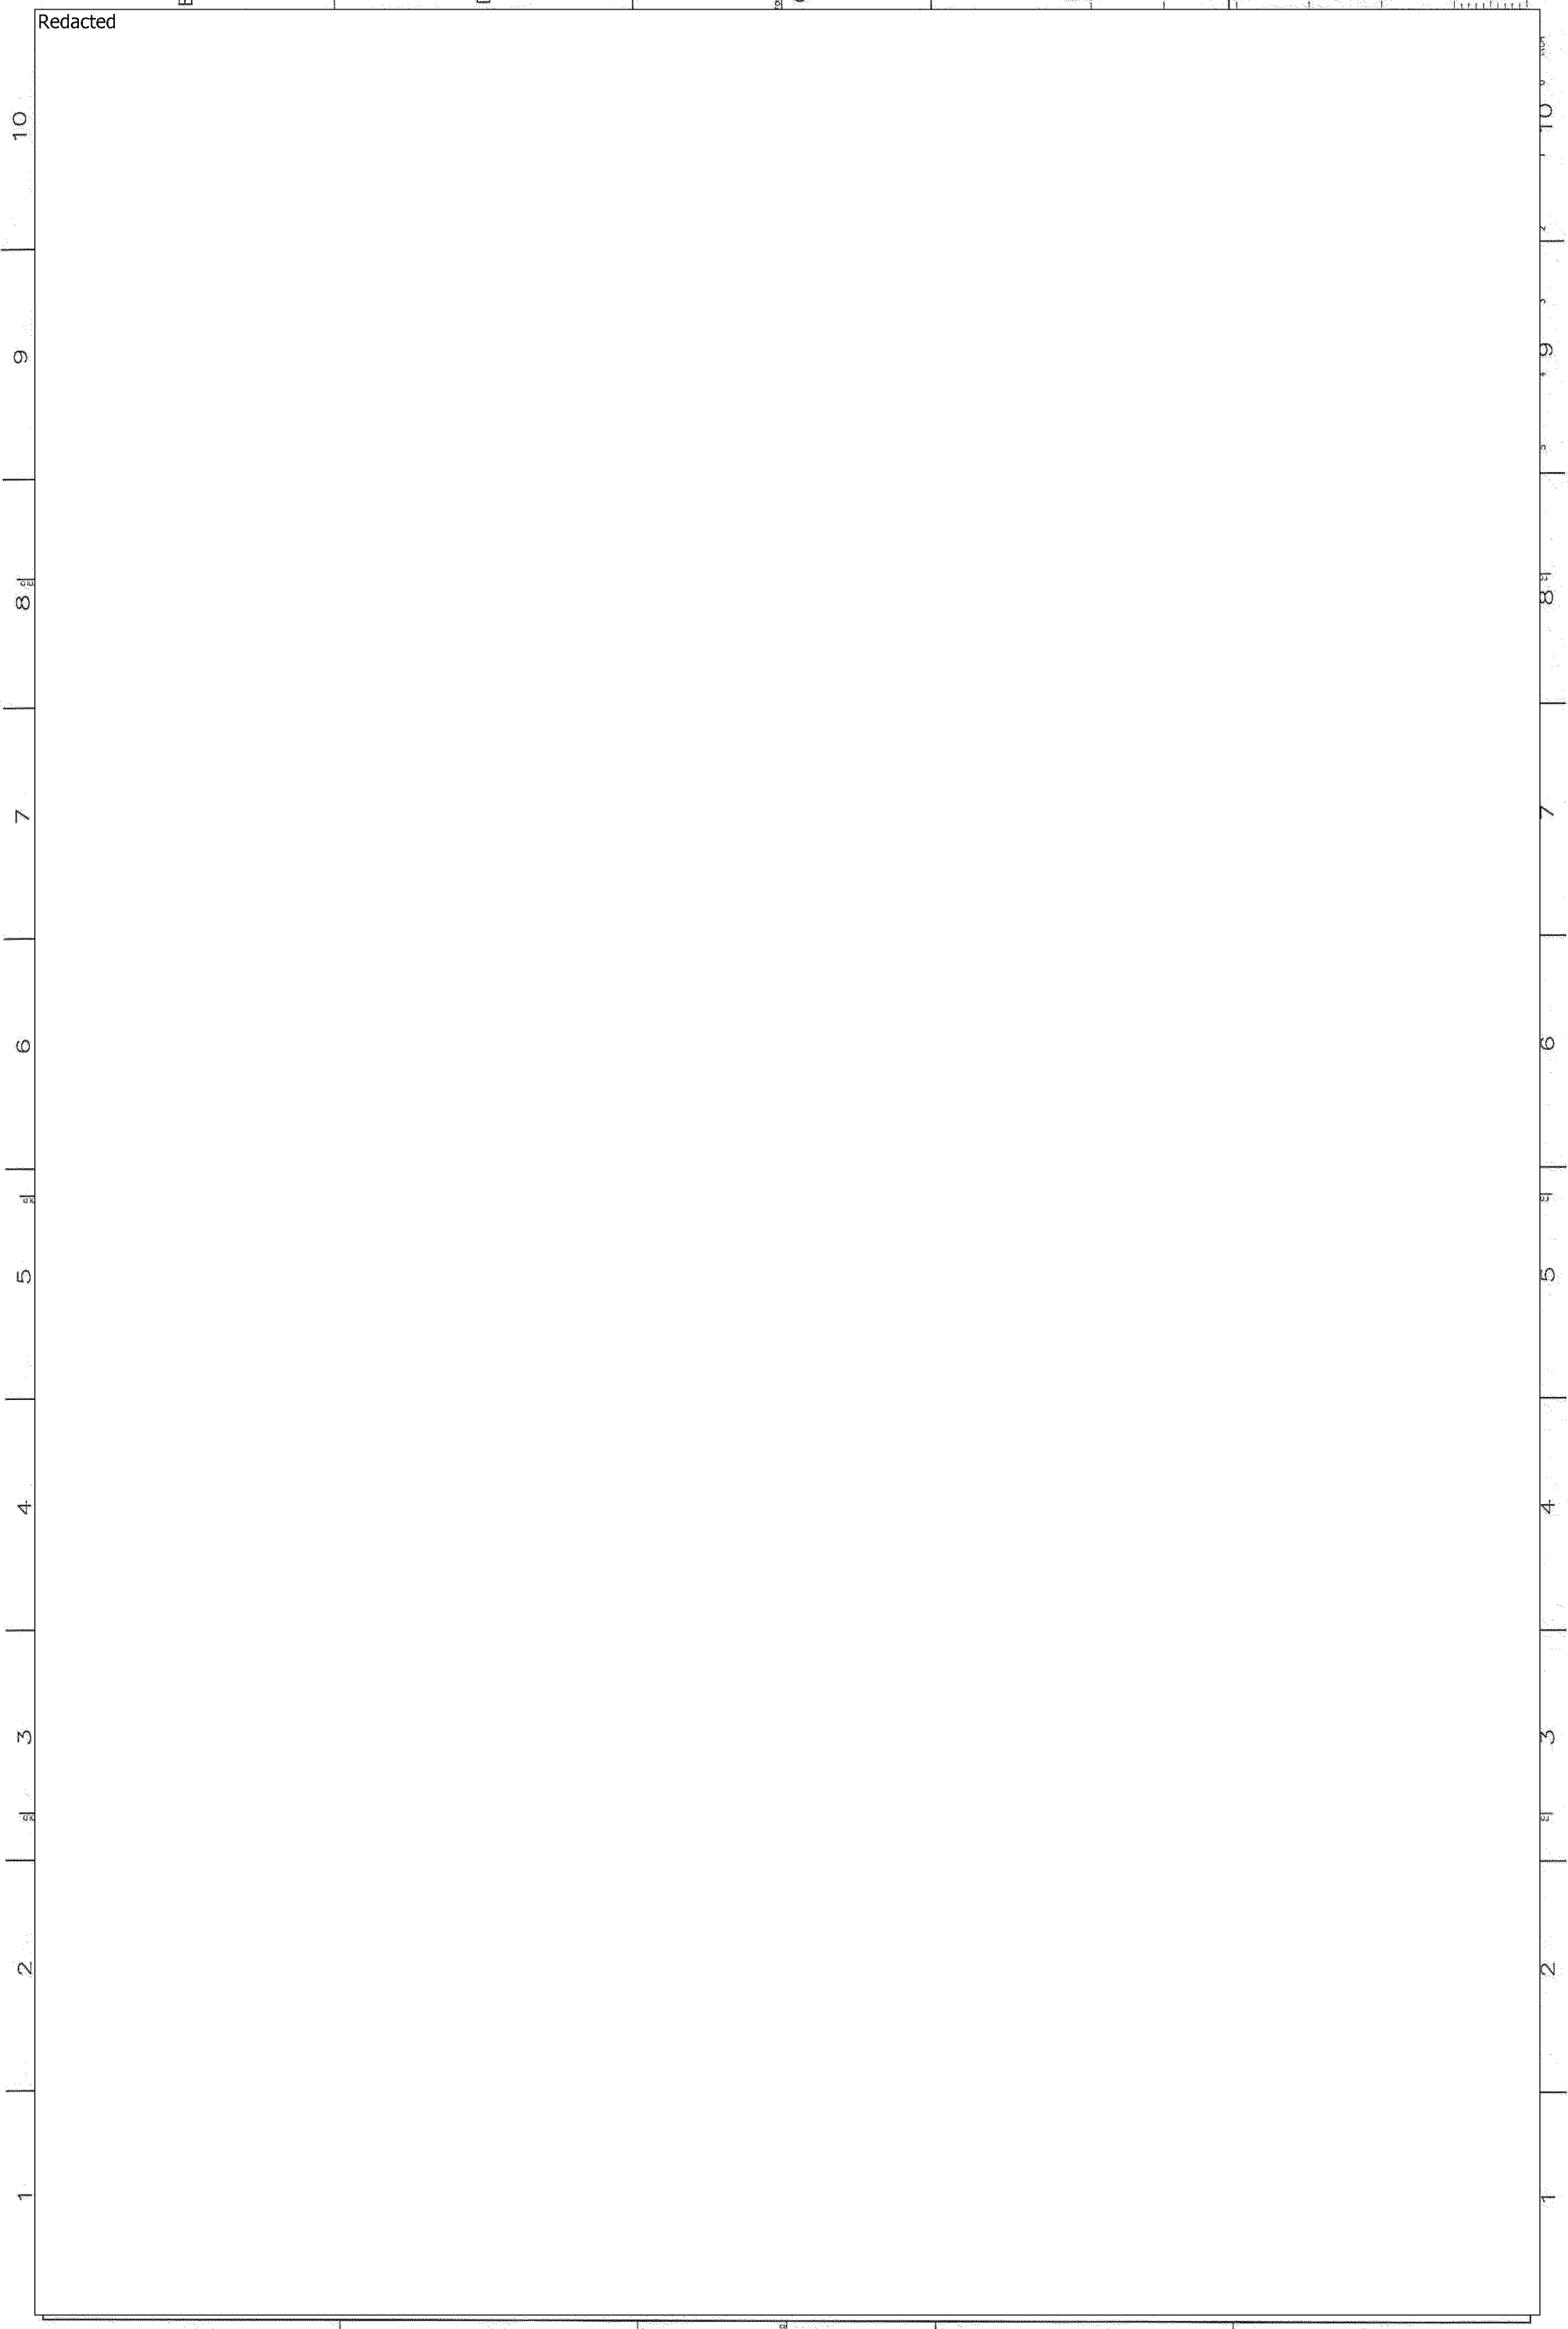

Redacted

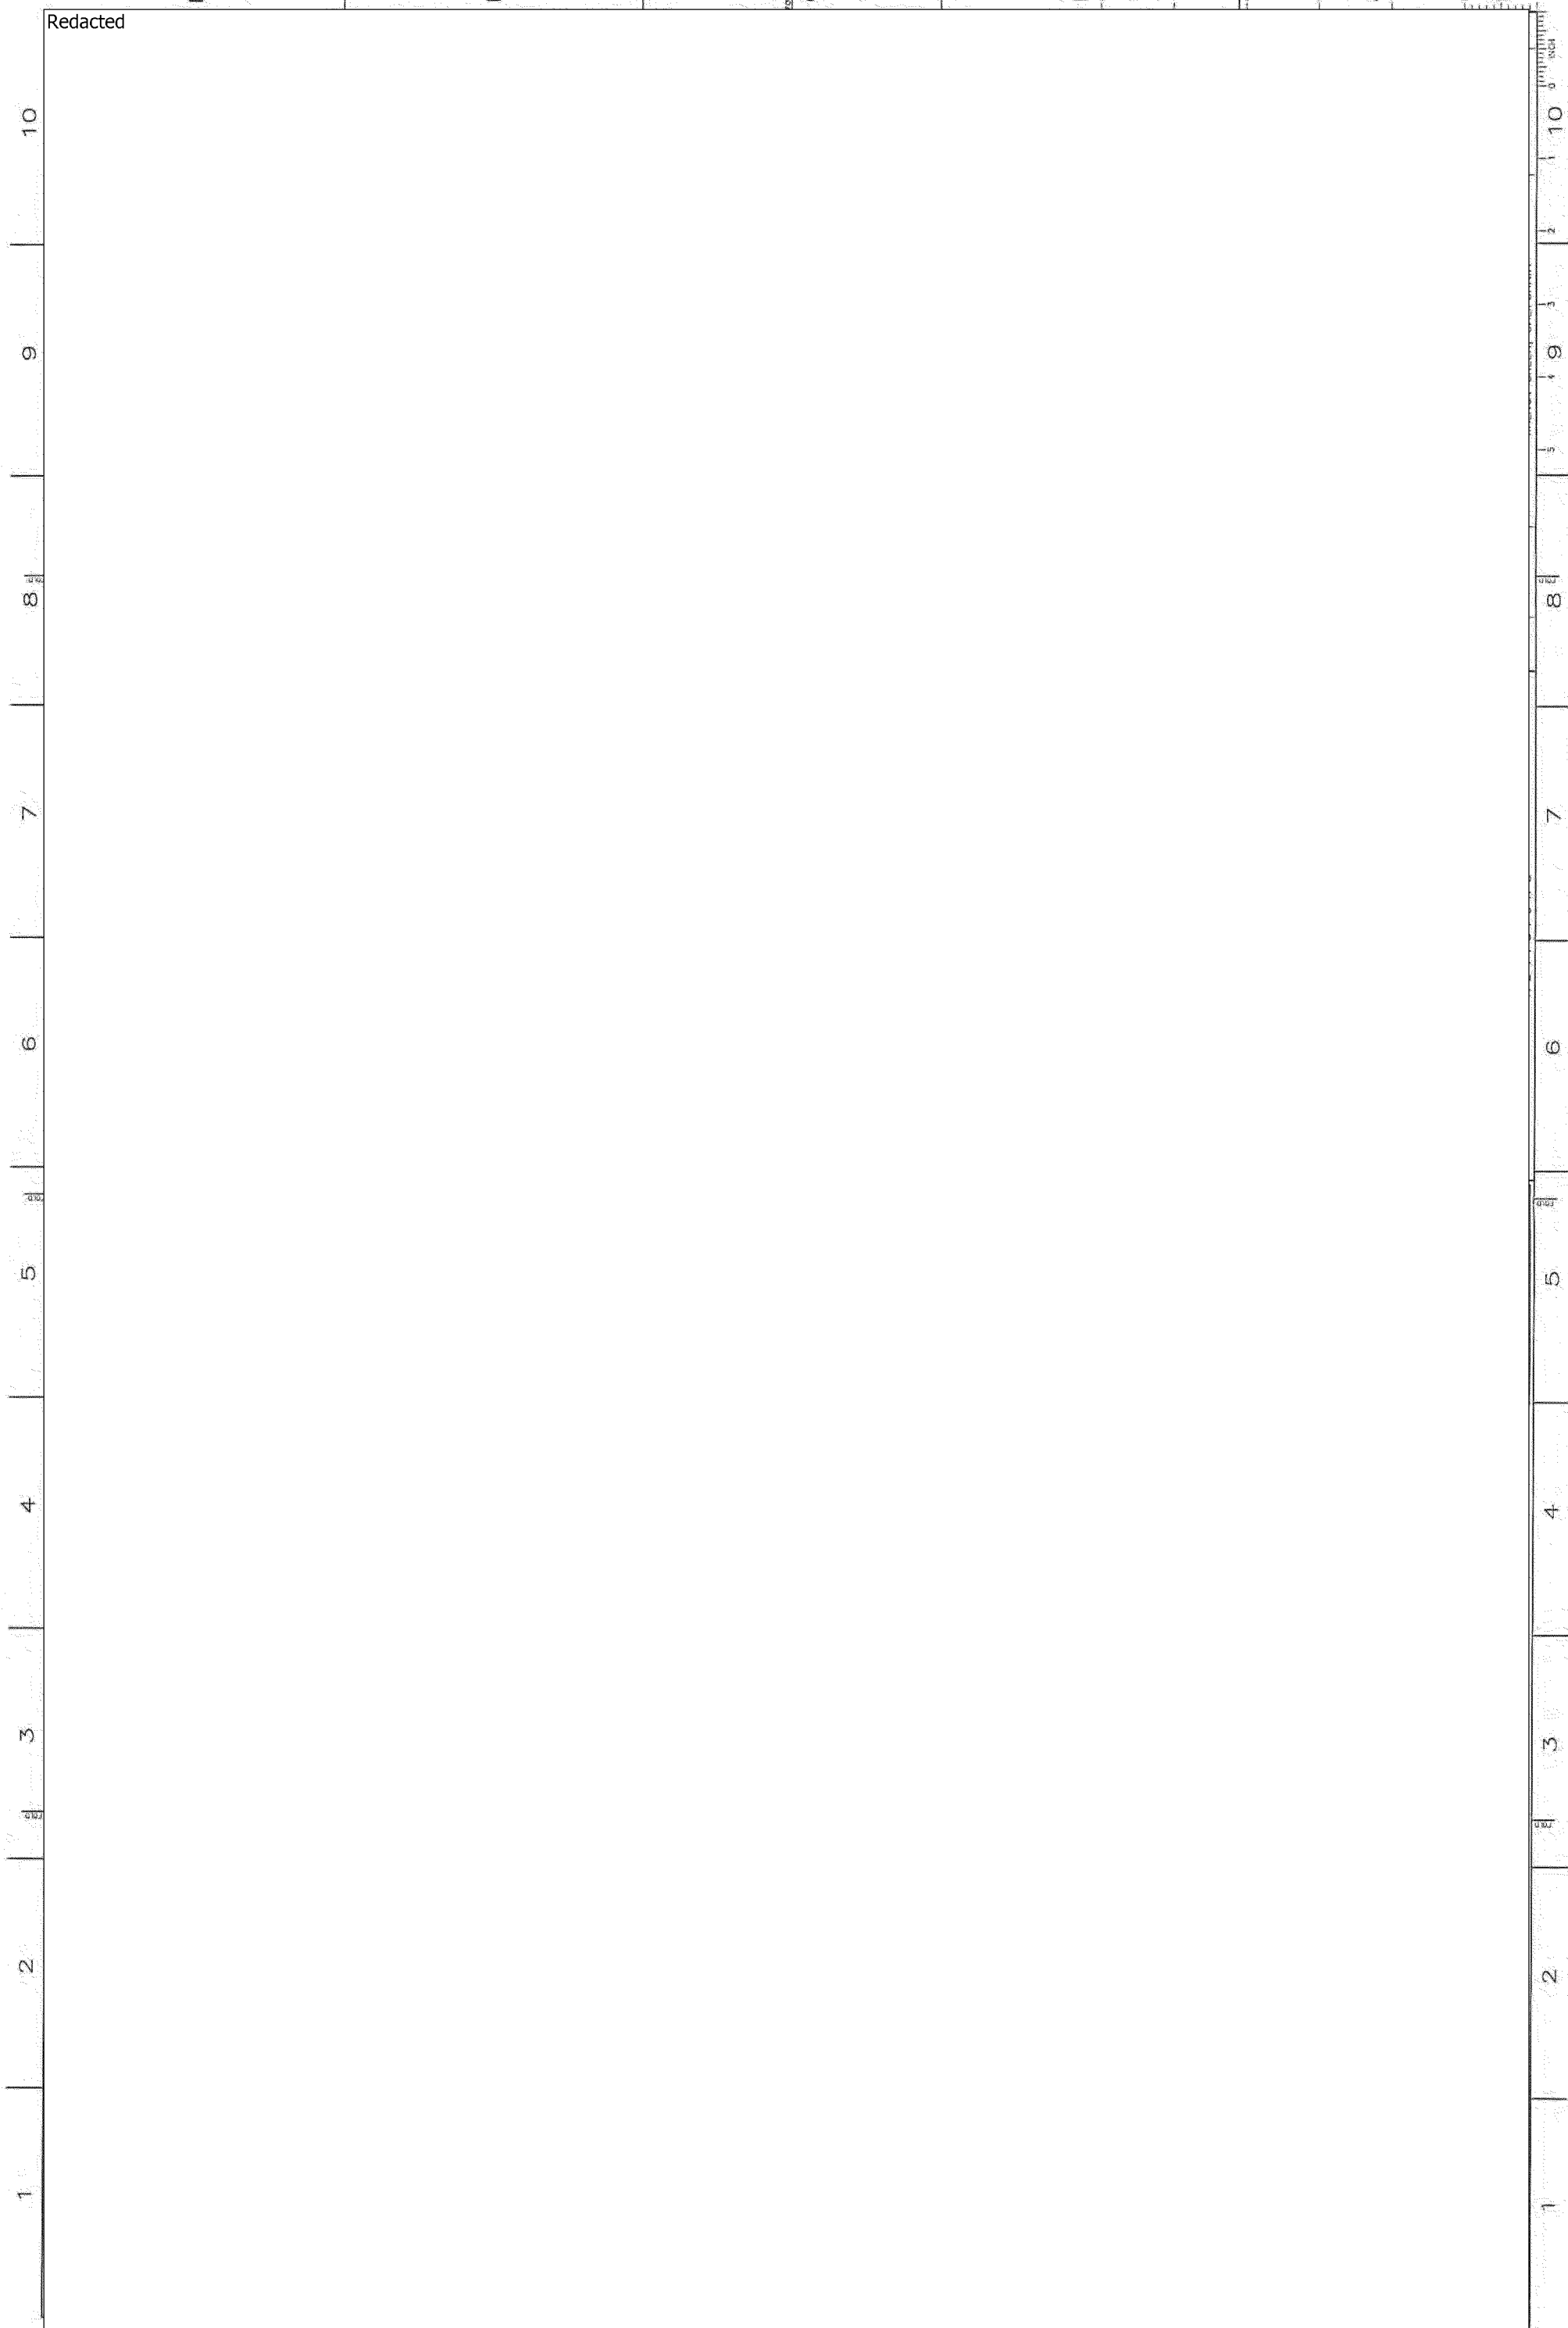

Redacted



Nitrogen Pressure Test Log

Redacted



Redacted



Nitrogen Test Certification

Redacted





Nitrogen Pressure Test Dead Weight Log Sheet

Redacted

[Redacted content]

RCP

Nitrogen Pressure Test Pipe Data Table

Redacted

Redacted

Redacted

Redacted

Redacted



Redacted

