



RCP, Inc

Redacted

Redacted

July 12, 2011

Pacific Gas and Electric Company  
3800 Adobe Rd  
Petaluma, Ca 94954  
Attention: Joel Mannie  
Attention:

Test Contractor: Milbar Hydro-test Incorporated -- FY12-112  
Asset Owner: Pacific Gas and Electric Company -- 41474053  
Construction Contractor: Snelson -- 41474053-T52  
Test Section: PG&E T-52 Line 300A MP 121.8722 - 122.6788  
Test Date: June 6, 2011  
Certificate Number: RCP 61362 - T-52, L-300A

To whom it may concern,

This letter is to certify that the hydrostatic test performed on pipe owned by Pacific Gas and Electric Company and tested by Milbar Hydro-test Incorporated met the requirements of the Code of Federal Regulations, Title 49, Part 192, Subpart J (Class 1).

Upon initiation of the hydrostatic test period, the test segment was subjected to a spike pressure of 940 psig for 30 minutes, without observed leakage or yielding of the pipe segment.

This hydrostatic test was completed successfully. Pressure was maintained on the test facilities in excess of 8 continuous hours without evidence of a leak failure. Water was the test medium. At the highest elevation point in the test section, the calculated test pressure was 882 psig and the established MAOP is 802 psig.

Pressure decreased 57 psi during the test. 10,991.14 ounces of fluid was intentionally released from the test section. Net corrected volumetric change from beginning of the test to the end of the test is calculated to be 2,687.76 ounces, loss, which is equivalent to a 0.7 °F change in pipe temperature and within the error attributed to the temperature measurement instrumentation utilized.

Test pressure did not remain steady even though no leaks were observed. The volumetric loss is attributed to the error characteristic of the temperature measurement instrumentation utilized.

Sincerely,

Redacted

Redacted

cc. file



### Hydrostatic Test Certification

Company	Pacific Gas and Electric Company	Job Number	41474053
Construction Co.	Snelson	Job Number	41474053-152
Hydro. Test Co.	Milbar Hydro Test Incorporated	Project No.	FY12-112
Test Section	PG&E T-52 Line 300A MP 121.8722 - 122.8788		
File Name	RCP 61362 - I-82, L-300A		

#### Hydrostatic Test Pressure

APPLICABLE CODE FOR CERTIFICATION:	Test Date:	6-Jul-11
------------------------------------	------------	----------

Code of Federal Regulations, Title 49, Part 192, Subpart J (Class 1)

This is to certify that the pipeline or pipeline section(s) described below was hydrostatically pressure tested in accordance with the following procedure:

Pipeline:	PG&E T-52 Line 300A MP 121.8722 - 122.8788		
From:	47+45	To:	00+00

#### Pipe Data

Segment	Length	Diameter	Wall Thickness	Specification	100% SMYS
1	4,745.00 ft	34.000 in.	0.313 in.	API 5L X52, DSAW, Arc Weld, Steel	950 psi
2	40.00 ft	34.000 in.	0.505 in.	API 5L X80, DSAW, Arc Weld, Steel	1,782 psi
3	20.00 ft	34.000 in.	0.375 in.	API 5L X80, DSAW, Arc Weld, Steel	1,324 psi
4	22 ft	34.000 in.	0.500 in.	API 5L X80, DSAW, Arc Weld, Steel	1,785 psi

#### Initial Test Conditions

Pressure at Test Point:	940 psig	Date/Time:	06/11 11:40 AM	Pipe Temperature	
Ambient Temperature:	81.0 °F	Elevation @ Test Point:	1,793.0 ft	Unrestrained:	76.0 °F
Pressure @ High Point (Cal/Measure):	940 psig	Elevation @ High Point:	1,794.0 ft	Restrained:	76.0 °F
Pressure @ Low Point (Cal/Measure):	940 psig	Elevation @ Low Point:	1,792.0 ft	Location:	47+45
				Location:	25+00
				Location:	00+00

#### Final Test Conditions

Pressure at Test Point:	883 psig	Date/Time:	06/11 8:01 PM	Pipe Temperature	
Ambient Temperature:	73.0 °F	Elevation @ Test Point:	1,793.0 ft	Unrestrained:	72.0 °F
Pressure @ High Point (Cal/Measure):	883 psig	Elevation @ High Point:	1,794.0 ft	Restrained:	77.0 °F
Pressure @ Low Point (Cal/Measure):	883 psig	Elevation @ Low Point:	1,792.0 ft	Location:	47+45
				Location:	25+00
				Location:	00+00

Total Fluid Injected:		Volume Loss	
Total Fluid Withdrawn:	10991.14 fluid ounces		
Net Change in Volume of the Test Section ± (+ Gain, - Loss):	(2,887.76) oz	Loss	(0.0095)%
			(0.701) °F equivalent

Test Duration:	8 hours					
Maximum Test Pressure:	940 psig					
% SMYS @:	98.3%	Test Point	98.3%	High Point	98.4%	Low Point
Minimum Test Pressure (Calculated/Measured):	883 psig					
Maximum Allowable Operating Pressure:	DOT Part 192	Test Factor = 1.10	802 psig			

Were leaks observed?	No	Explain:
Acceptable Hydrostatic Test?	Yes	<p>Upon initiation of the hydrostatic test period, the test segment was subjected to a spike pressure of 940 psig for 30 minutes, without observed leakage or yielding of the pipe segment.</p> <p>No leaks were observed during the test period. The test section included 4,745 feet of buried and 82 feet of exposed pipe. Pressure lost 57 psi during the test. The buried pipe segment gained 1°F fluid temperature and the exposed pipe segment lost 4°F.</p> <p>10,991.14 ounces of fluid was intentionally released from the test section. Net corrected volumetric change from beginning of the test to the end of the test is calculated to be 2,887.76 ounces, loss, which is equivalent to a 0.7 °F change in pipe temperature and within the error attributed to the temperature measurement instrumentation utilized.</p> <p>Test pressure did not remain steady even though no leaks were observed. The volumetric loss is attributed to the error characteristic of the temperature measurement instrumentation utilized.</p>

Remarks

Redacted

12-Jul-11



# Dead Weight Log Sheet

Owner Company	Pacific Gas and Electric Company	Job Number	41474053
Construction Co.	Snelson	Job Number	41474053-T52
Testing Co.	Milbar Hydro-test Incorporated	Project No.	FY12-112
Test Section	PG&E T-52 Line 300A MP 121.8722 - 122.6788		
File Name	RCP 61362 - T-52, L-300A		

Date: 6-Jun-11

## Test Log

Log No.	Test Period		Test Pressure	Temperature °F			Remarks		
	Date	Time		Ambient	Pipe		Comment	Bleed	Inject
					Unrestrained	Restrained			
1	6/6/11	11:14 AM	646 psig	81 °F	75 °F	76 °F	Start Spike		
2	6/6/11	11:15 AM	650 psig	81 °F	75 °F	76 °F			1,005 oz.
3	6/6/11	11:16 AM	660 psig	81 °F	75 °F	76 °F			1,340 oz.
4	6/6/11	11:17 AM	670 psig	81 °F	75 °F	76 °F			1,808 oz.
5	6/6/11	11:18 AM	680 psig	81 °F	75 °F	76 °F			1,808 oz.
6	6/6/11	11:19 AM	690 psig	81 °F	75 °F	76 °F			1,674 oz.
7	6/6/11	11:20 AM	700 psig	81 °F	75 °F	76 °F			1,808 oz.
8	6/6/11	11:21 AM	710 psig	81 °F	75 °F	76 °F			1,808 oz.
9	6/6/11	11:22 AM	720 psig	81 °F	76 °F	76 °F			1,741 oz.
10	6/6/11	11:23 AM	730 psig	81 °F	76 °F	76 °F			1,808 oz.
11	6/6/11	11:24 AM	740 psig	81 °F	76 °F	76 °F			1,808 oz.
12	6/6/11	11:25 AM	750 psig	81 °F	76 °F	76 °F			1,741 oz.
13	6/6/11	11:26 AM	760 psig	81 °F	76 °F	76 °F			1,808 oz.
14	6/6/11	11:28 AM	770 psig	81 °F	76 °F	76 °F			1,741 oz.
15	6/6/11	11:29 AM	780 psig	81 °F	76 °F	76 °F			1,741 oz.
16	6/6/11	11:30 AM	790 psig	81 °F	76 °F	76 °F			1,808 oz.
17	6/6/11	11:31 AM	800 psig	81 °F	76 °F	76 °F			1,808 oz.
18	6/6/11	11:32 AM	810 psig	81 °F	76 °F	76 °F			1,741 oz.
19	6/6/11	11:33 AM	820 psig	81 °F	76 °F	76 °F			1,808 oz.
20	6/6/11	11:34 AM	830 psig	81 °F	76 °F	76 °F			1,741 oz.
21	6/6/11	11:35 AM	840 psig	81 °F	76 °F	76 °F			1,808 oz.
22	6/6/11	11:36 AM	850 psig	81 °F	76 °F	76 °F			1,808 oz.
23	6/6/11	11:37 AM	860 psig	81 °F	76 °F	76 °F			1,741 oz.
24	6/6/11	11:38 AM	870 psig	81 °F	76 °F	76 °F			1,875 oz.
25	6/6/11	11:39 AM	880 psig	81 °F	76 °F	76 °F			1,808 oz.
26	6/6/11	11:40 AM	890 psig	81 °F	76 °F	76 °F			1,741 oz.
27	6/6/11	11:41 AM	900 psig	81 °F	76 °F	76 °F			1,875 oz.
28	6/6/11	11:42 AM	910 psig	81 °F	76 °F	76 °F			1,808 oz.
29	6/6/11	11:43 AM	920 psig	81 °F	76 °F	76 °F			1,808 oz.
30	6/6/11	11:44 AM	930 psig	81 °F	76 °F	76 °F			1,808 oz.
31	6/6/11	11:45 AM	940 psig	81 °F	76 °F	76 °F			1,942 oz.
32	6/6/11	11:46 AM	940 psig	81 °F	76 °F	76 °F	On Test		
33	6/6/11	11:55 AM	940 psig	81 °F	76 °F	76 °F			
34	6/6/11	12:05 PM	940 psig	82 °F	76 °F	76 °F			
35	6/6/11	12:16 PM	940 psig	82 °F	76 °F	76 °F	End Spike		
36	6/6/11	12:20 PM	937 psig	82 °F	76 °F	76 °F		626 oz.	
37	6/6/11	12:29 PM	878 psig	80 °F	76 °F	76 °F		10,365 oz.	
38	6/6/11	12:39 PM	878 psig	80 °F	76 °F	76 °F			
39	6/6/11	12:45 PM	878 psig	81 °F	76 °F	77 °F			
40	6/6/11	1:00 PM	878 psig	82 °F	77 °F	77 °F			
41	6/6/11	1:15 PM	878 psig	82 °F	77 °F	77 °F			
42	6/6/11	1:30 PM	879 psig	82 °F	77 °F	77 °F			
43	6/6/11	1:45 PM	879 psig	82 °F	77 °F	77 °F			





# Dead Weight Log Sheet

Owner Company	Pacific Gas and Electric Company	Job Number	41474053
Construction Co.	Snelson	Job Number	41474053-152
Testing Co.	Milbar Hydro-test Incorporated	Project No.	FY12-112
Test Section	PG&E T-52 Line 300A MP 121.8722 - 122.6788		
File Name	RCP 61362 - T-52, L-300A		

Date 6-Jun-11

## Test Log

Log No.	Test Period		Test Pressure	Temperature °F			Remarks		
	Date	Time		Ambient	Pipe		Comment	Bleed	Inject
					Unrestrained	Restrained			
44	6/6/11	2:00 PM	880 psig	82 °F	80 °F	77 °F			
45	6/6/11	2:15 PM	880 psig	82 °F	80 °F	77 °F			
46	6/6/11	2:30 PM	880 psig	83 °F	80 °F	77 °F			
47	6/6/11	2:45 PM	881 psig	84 °F	80 °F	77 °F			
48	6/6/11	3:00 PM	881 psig	84 °F	80 °F	77 °F			
49	6/6/11	3:15 PM	881 psig	83 °F	80 °F	77 °F			
50	6/6/11	3:30 PM	882 psig	83 °F	80 °F	77 °F			
51	6/6/11	3:45 PM	882 psig	81 °F	80 °F	77 °F			
52	6/6/11	4:00 PM	882 psig	81 °F	80 °F	77 °F			
53	6/6/11	4:15 PM	882 psig	81 °F	80 °F	77 °F			
54	6/6/11	4:30 PM	882 psig	81 °F	80 °F	77 °F			
55	6/6/11	4:45 PM	883 psig	81 °F	79 °F	77 °F			
56	6/6/11	5:00 PM	883 psig	81 °F	79 °F	77 °F			
57	6/6/11	5:15 PM	883 psig	81 °F	79 °F	77 °F			
58	6/6/11	5:30 PM	883 psig	81 °F	79 °F	77 °F			
59	6/6/11	5:45 PM	883 psig	80 °F	79 °F	77 °F			
60	6/6/11	6:00 PM	883 psig	79 °F	78 °F	77 °F			
61	6/6/11	6:15 PM	883 psig	79 °F	77 °F	77 °F			
62	6/6/11	6:30 PM	883 psig	78 °F	76 °F	77 °F			
63	6/6/11	6:45 PM	883 psig	77 °F	75 °F	77 °F			
64	6/6/11	7:00 PM	883 psig	77 °F	74 °F	77 °F			
65	6/6/11	7:15 PM	883 psig	75 °F	74 °F	77 °F			
66	6/6/11	7:30 PM	883 psig	75 °F	73 °F	77 °F			
67	6/6/11	7:45 PM	883 psig	74 °F	72 °F	77 °F			
68	6/6/11	8:01 PM	883 psig	73 °F	72 °F	77 °F	End of Test		

Spike Test

52,577.3 oz.

Hydrostatic Test

10,991.1 oz.

Were leaks observed during the test period?

Exposed and buried pipe,  
no leaks observed.

High Test Pressure:

940 psig

Low Test Pressure:

878 psig



## Pipe Segment Volume Calculations

Company	Pacific Gas and Electric Company	Job Number	41474051
Construction Co.	Snelson	Job Number	41474053-T52
Hydro. Test Co.	Milbar Hydro-test Incorporated	Project No.	FY12-112
Test Section	PG&E T-52 Line 300A MP 121.8722 - 122.8788	<b>WATER</b>	
File Name	RCP 81362 - T-52, L-300A		

### General Pipe Data

Description	Segment			
	1	2	3	4
Restrained or Unrestrained?	Restrained	Unrestrained	Unrestrained	Unrestrained
Outside Diameter	34.000 in.	34.000 in.	34.000 in.	34.000 in.
Wall Thickness	0.313 in.	0.505 in.	0.375 in.	0.500 in.
Inside Diameter	33.375 in.	32.990 in.	33.250 in.	33.000 in.
Spec./Grade	API5L X52	API5L X60	API5L X60	API5L X60
Length Unrestrained		40 ft	20 ft	22 ft
Length Restrained	4,745 ft			
Temperature - On Test	76 °F	70 °F	76.0 °F	76.0 °F
Temperature - End of Test	77 °F	72 °F	72.0 °F	72.0 °F
Pressure - On Test	940 psig	940 psig	940 psig	940 psig
Pressure - End of Test	883 psig	883 psig	883 psig	883 psig

### Unrestrained Pipe

Sum:	Vo	3,655.78 gal		Vp1	3,670.97 gal		Vp2	3,671.38 gal	
		407,941 oz.			489,884 oz.			460,937 oz.	
Vo Unrestrained		1,776 gal	802 gal	877 gal					
Fwp 1		1.002830	1.002880	1.002880					
Fpp 1		1.002559	1.003473	1.002585					
Fpt 1		1.000291	1.000291	1.000291					
Fwt 1		1.001813	1.001813	1.001813					
Fpwt 1 = Fpt/Fwt		0.998481	0.998481	0.998481					
Vp1 = Vo(Fwp)/(Fpp)(Fpwt)		1,783.13 gal	806.50 gal	981.34 gal					
Fwp 2		1.002705	1.002705	1.002705					
Fpp 2		1.002403	1.003262	1.002428					
Fpt 2		1.000218	1.000218	1.000218					
Fwt 2		1.001283	1.001283	1.001283					
Fpwt = Fpt/Fwt		0.998937	0.998937	0.998937					
Vp2 = Vo(Fwp)/(Fpp)(Fpwt)		1,783.35 gal	806.56 gal	981.46 gal					

### Restrained Pipe

Sum:	Vo	215,644.27 gal		Vp1	216,565.67 gal		Vp2	216,478.38 gal	
		27,802,468 oz.			27,722,956 oz.			27,709,234 oz.	
Vo Unrestrained	215,644 gal								
Fwp 1	1.002880								
Fpp 1	1.003103								
Fpt 1	1.000194								
Fwt 1	1.001813								
Fpwt 1 = Fpt/Fwt	0.998381								
Vp1 = Vo(Fwp)/(Fpp)(Fpwt)	216,586 gal								
Fwp 2	1.002705								
Fpp 2	1.002922								
Fpt 2	1.000206								
Fwt 2	1.001966								
Fpwt = Fpt/Fwt	0.998243								
Vp2 = Vo(Fwp)/(Fpp)(Fpwt)	216,478 gal								

### Combined Pipe

Sum:	Vo	219,309.05 gal		Vp1	220,256.64 gal		Vp2	220,148.77 gal	
		28,070,407 oz.			28,192,850 oz.			28,179,171 oz.	



## Pipe Segment Volume Allowance Calculations

Company	Pacific Gas and Electric Company	Job Number	41474053
Construction Co.	Snalson	Job Number	41474053-152
Hydro. Test Co.	Milbar Hydro-test Incorporated	Project No.	FY12-112
Test Section	PG&E T-52 Line 300A MI# 121.8722 - 122.6788	<b>WATER</b>	
File Name	RCP 61362 - T-52, L-300A		

### General Pipe Data

Description	Segment			
	1	2	3	4
Restrained or Unrestrained?	Restrained	Unrestrained	Unrestrained	Unrestrained
Outside Diameter	34.000 in.	34.000 in.	34.000 in.	34.000 in.
Wall Thickness	0.313 in.	0.505 in.	0.375 in.	0.500 in.
Inside Diameter	33.375 in.	32.990 in.	33.250 in.	33.000 in.
Spec./Grade	API5L-X52	API5L-X60	API5L-X60	API5L-X60
Length Unrestrained	40.00 ft		20.00 ft	22 ft
Length Restrained	4,745 ft			
Temperature - On Test	76 °F	73 °F	73 °F	73 °F
Temperature - End of Test	77 °F	74 °F	74 °F	74 °F
Pressure - On Test	911 psig	911 psig	911 psig	911 psig
Pressure - End of Test	911 psig	911 psig	911 psig	911 psig

### Unrestrained Pipe

Sum:	Vo	Vtp1		Vtp2
	3,695.79 gal	3,071.36 gal		3,671.18 gal
	467,941 oz.	460,959 oz.		469,911 oz.
Vo Unrestrained	1,776 gal	902 gal	977 gal	
Fwp 1	1.002791	1.002791	1.002791	
Fpp 1	1.002480	1.003366	1.002509	
Fpl 1	1.000237	1.000237	1.000237	
Fwt 1	1.001423	1.001423	1.001423	
Fpwt 1 = Fpl/Fwt	0.998815	0.998815	0.998815	
Vip 1 = Vo(Fwp)(Fpp)(Fpwt)	1,783.43 gal	908.82 gal	981.50 gal	
Fwp 2	1.002791	1.002791	1.002791	
Fpp 2	1.002480	1.003366	1.002509	
Fpl 2	1.000255	1.000255	1.000255	
Fwt 2	1.001542	1.001542	1.001542	
Fpwt 2 = Fpl/Fwt	0.998715	0.998715	0.998715	
Vip 2 = Vo(Fwp)(Fpp)(Fpwt)	1,783.25 gal	906.53 gal	981.40 gal	

### Restrained Pipe

Sum:	Vo	Vtp1		Vtp2
	215,644.27 gal	216,546.15 gal		216,516.54 gal
	27,602,466 oz.	27,717,907 oz.		27,714,118 oz.
Vo Restrained	215,644 gal			
Fwp 1	1.002791			
Fpp 1	1.003009			
Fpl 1	1.000194			
Fwt 1	1.001813			
Fpwt 1 = Fpl/Fwt	0.998384			
Vip 1 = Vo(Fwp)(Fpp)(Fpwt)	216,546 gal			
Fwp 2	1.002791			
Fpp 2	1.003012			
Fpl 2	1.000206			
Fwt 2	1.001968			
Fpwt 2 = Fpl/Fwt	0.998243			
Vip 2 = Vo(Fwp)(Fpp)(Fpwt)	216,517 gal			

### Combined Pipe

Sum:	Vo	Vtp1		Vtp2
	219,300.06 gal	220,217.70 gal		220,187.73 gal
	28,070,407 oz.	28,187,866 oz.		28,184,029 oz.
1 °F Change	29.08 gal	3,838.81 oz.		





## Hydrostatic Test Pipe Data Table



Pipe Type	Length	Restrained / Unrestrained	Outside Diameter	Wall Thickness	Specification & Grade	Pipe Yield Pressure	Material	Joint Type	Seam Type
1	4,745 ft	Restrained	34.000 in.	0.3125 in.	API5L-X52	956 psig	Steel	Arc Weld	DSAW
2	40 ft	Unrestrained	34.000 in.	0.5050 in.	API5L-X60	1,782 psig	Steel	Arc Weld	DSAW
3	20 ft	Unrestrained	34.000 in.	0.3750 in.	API5L-X60	1,324 psig	Steel	Arc Weld	DSAW
4	22 ft	Unrestrained	34.000 in.	0.5000 in.	API5L-X60	1,765 psig	Steel	Arc Weld	DSAW

### Hydrostatic Test Project Owner & Participants

Owner Company	Pacific Gas and Electric Company	Job Number
Address	3600 Adobe Rd Petaluma, Ca 94954 Attention: Joel Manne	41474053
Construction Company	Snelson	Job Number
Address	601 West State Street Sedro-Woolley, WA 98284 Attention: Redacted	41474053-T52
Hydrostatic Test Co.	Milbar Hydro-test Incorporated	Project No.
Address	P. O. Box 7701 Shreveport, Louisiana 71137-7701 Attention: Redacted	FY12-112
Test Section	PG&E T-52 Line 300A MP 121.8722 - 122.6788 From: 47+45 To: 00+00	
File Name	RCP 61362 - T-52, L-300A	




# PG&E T-52 Line 300A MP 121.8722 - 122.6788

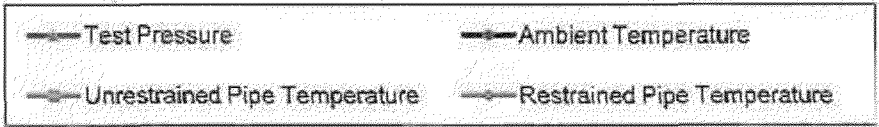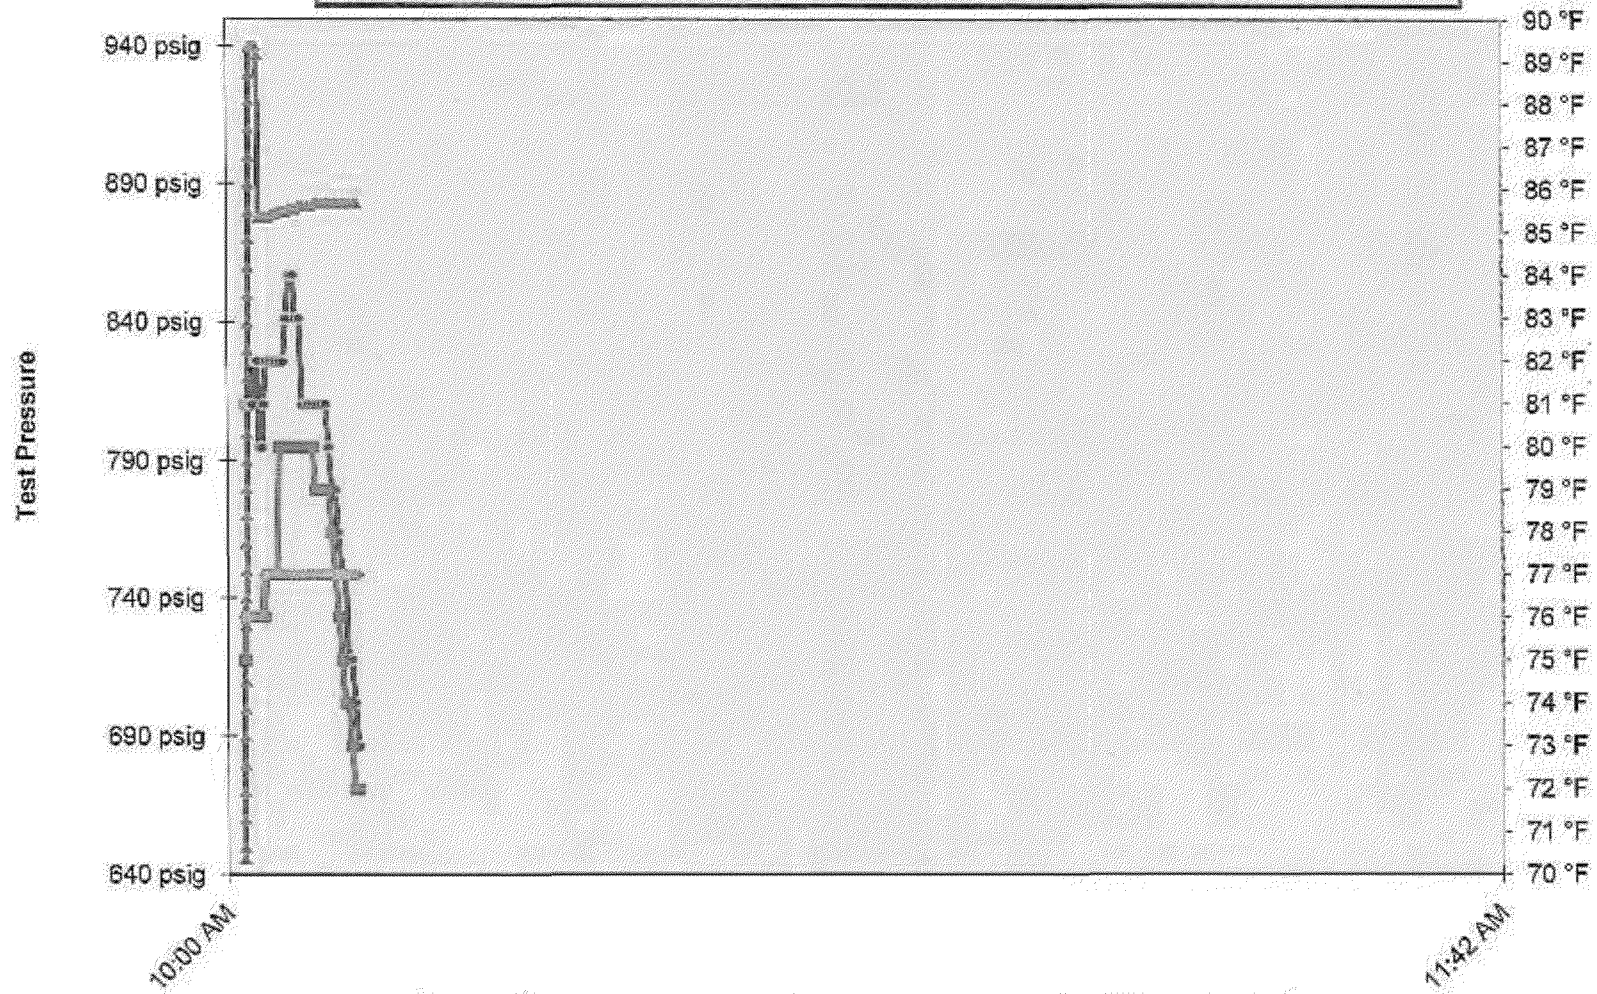



**Spike Pressure Test**  
**Stress Strain Curve -- PG&E T-52 Line 300A MP 121.8722 - 122.6788**

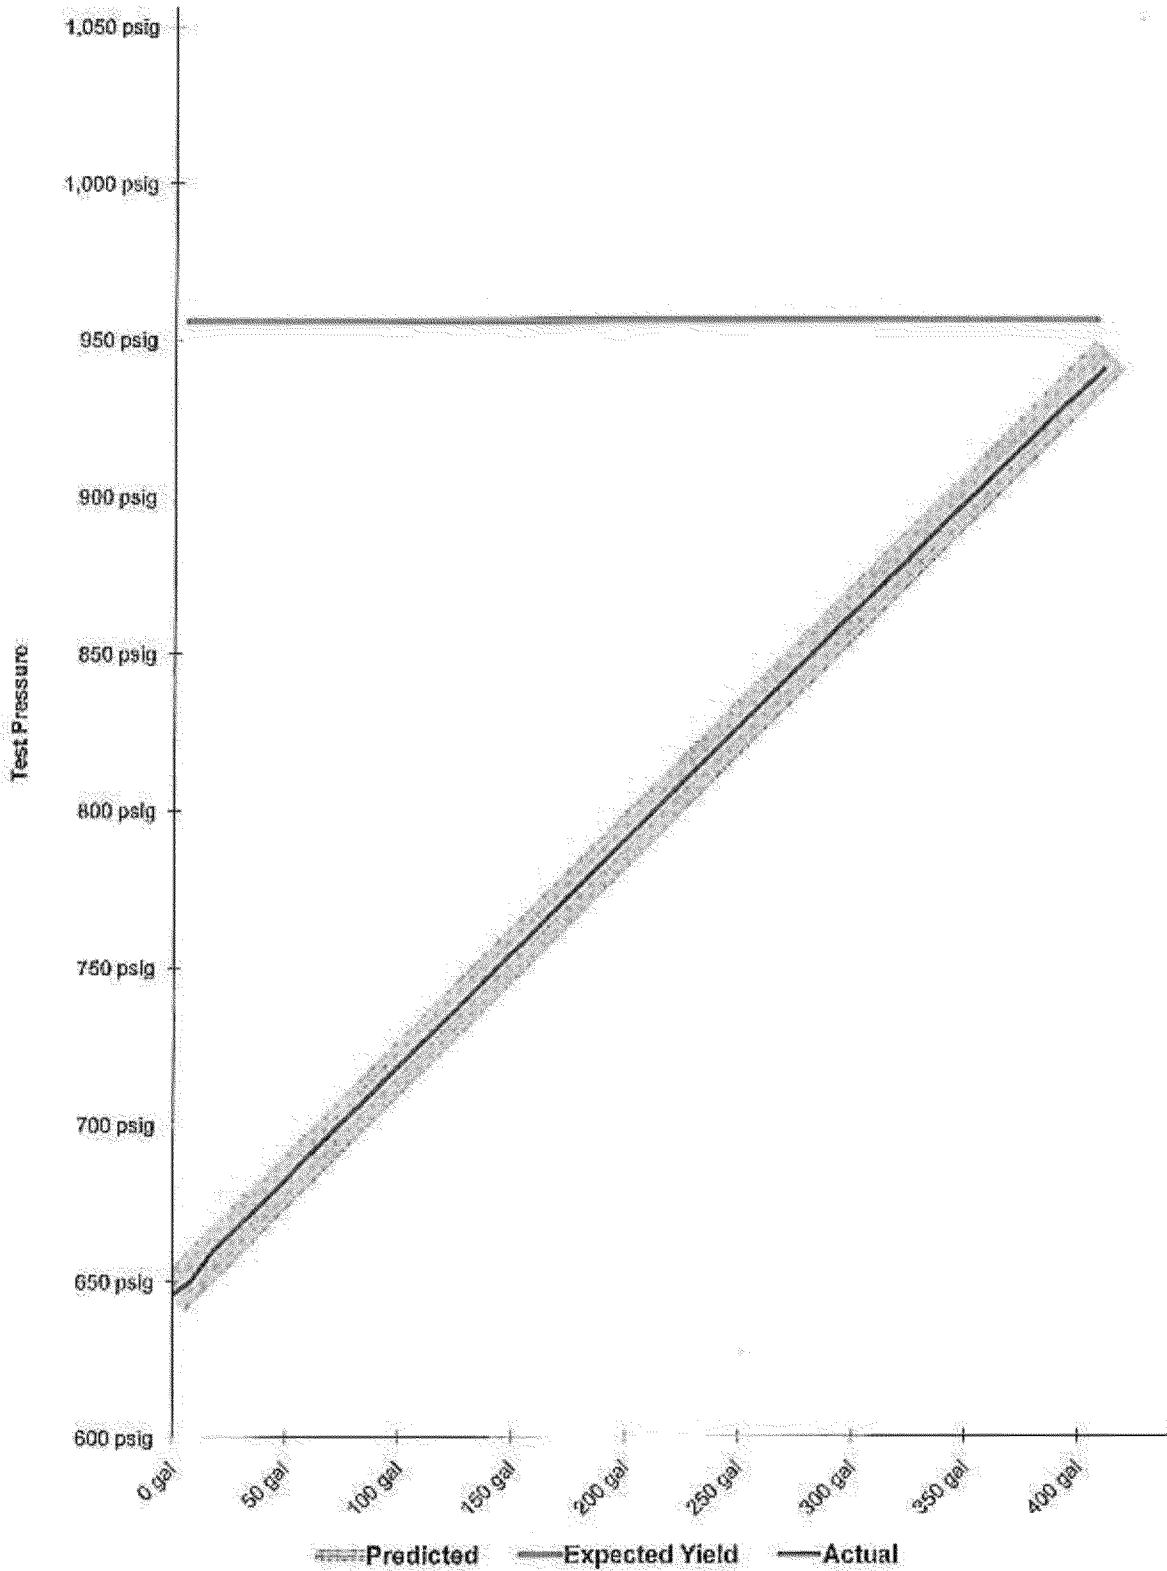



Redacted

Test Header and Exposed Pipe Segments



Redacted

Redacted