

December 12, 2011

**CPUC Energy Storage Proceeding R.10-12-007**  
**Energy Storage Framework Staff Proposal**

*Elizaveta Malashenko*

*Rebecca Lee*

*Chris Villarreal*

*Ted Howard*

**Contents**

1. Introduction ..... 3

    1.1. Background ..... 3

    1.2. Executive Summary ..... 3

2. Energy Storage Adoption Barriers..... 4

    2.1. Lack of definitive operational needs ..... 4

    2.2. Lack of cohesive regulatory framework ..... 5

    2.3. Evolving markets and market product definition ..... 6

    2.4. Resource Adequacy accounting ..... 6

    2.5. Lack of cost-effectiveness evaluation methods ..... 7

    2.6. Lack of cost recovery policy ..... 7

    2.7. Lack of cost transparency and price signals (w/ wholesale and retail) ..... 8

    2.8. Lack of utility operating experience ..... 8

    2.9. Lack of well-defined interconnection process . ..... 9

    2.10. Energy Storage Adoption Barriers Summary ..... 9

3. Energy Storage Analysis Framework ..... 11

    3.1. Framework Introduction ..... 11

    3.2. Potential Framework Applications ..... 13

4. Continued Analysis and Next Steps ..... 14

    4.1. Analysis Process ..... 14

    4.2. Key Next Steps ..... 15

5. Conclusion ..... 17

December 12, 2011

## 1. Introduction

This proposal outlines the California Public Utilities Commission (CPUC or “the Commission”) Staff approach to addressing energy storage policy considerations, including an analysis framework and a plan for developing policies and guidelines pertaining to energy storage. This proposal is based on the analysis of barriers to adoption of electric energy storage that have been identified thus far in the course of the electric energy storage proceeding (R.10-12-007). The purpose of the CPUC Staff proposal is not to resolve any of the barriers at this point in time, but rather to outline a roadmap for how they can be addressed. Additionally, the CPUC Staff proposal defines the steps to be taken in the next phase of this proceeding.

### 1.1. Background

On December 16, 2010, the Commission opened Rulemaking (R.) 10-12-007 to implement the provisions of Assembly Bill (AB) 2514 (Stats. 2010, ch. 469). AB 2514 directs the Commission to determine appropriate targets, if any, for each load-serving entity as defined by Pub. Util. Code § 380(j) to procure viable and cost-effective energy storage systems (ESS) and sets dates for any targets deemed appropriate to be achieved. On May 31, 2011, the Assigned Commissioner and Administrative Law Judge (ALJ) issued a Ruling and Scoping Memo (Scoping Memo) which identified the issues to be considered in this proceeding and set a procedural schedule. Since the issuance of the Scoping Memo, the CPUC Staff facilitated two workshops to obtain additional information pertaining to energy storage. The first workshop, held on June 28, 2011, was a general discussion of energy storage systems and the second workshop, held on July 31, 2011, focused on barriers and impediments to widespread use of energy storage. Following the second workshop, the ALJ issued a ruling seeking additional comments from the parties. Based on the discussion during the workshops and the comments filed by parties, CPUC Staff has developed a proposal for an approach to address energy storage considerations.

### 1.2. Executive Summary

The parties in R.10-12-007 have identified a number of barriers and impediments to widespread use of electric energy storage technologies. Some of the identified barriers are under direct CPUC jurisdiction and may be addressed in existing or future proceedings. For those barriers and impediments that are under the jurisdiction of other state or federal agencies, the CPUC may be able to use its technical expertise as a stakeholder in those forums to address the barriers in a coordinated fashion. CPUC Staff has summarized these barriers and has identified best forums for these barriers to be addressed. In order to support the analysis of energy storage issues going forward, CPUC Staff proposes the adoption of an energy storage ‘end use’ framework. This framework will be utilized in a number of future activities, including defining the cost-effectiveness evaluation methods and defining Resource Adequacy value. Staff believes that this analysis framework, along with a plan for addressing identified barriers, will set a foundation for expanding the ability of energy storage to gain wider adoption. Specifically, Staff believes that the creation of a Resource Adequacy value and development of other rules allowing storage providers to participate more effectively in the utilities’ procurement programs will mitigate many of the identified barriers. This effort will need to be coordinated with the California Independent System Operator (CAISO) to encourage policies and define products to enable electric energy storage systems to participate in its markets similar to other generation facilities. In parallel, the CPUC will continue to evaluate electric energy storage to make a determination whether or when an energy storage portfolio standard could be adequate.

December 12, 2011

## 2. Energy Storage Adoption Barriers

Following a series of staff-facilitated workshops, the assigned ALJ issued a ruling on July 21, 2011, requesting comments from parties regarding barriers to electric energy storage deployment. Parties offered a wide range of distinct challenges for consideration, which CPUC Staff has grouped into nine broad categories. The purpose of this categorization is to provide an organized process to inform how challenges to electric energy storage deployment could be addressed, either within this proceeding, in conjunction with other CPUC proceedings, or in coordination with other state and federal agencies. The nine categories are:

1. Lack of definitive operational needs
2. Lack of cohesive regulatory framework
3. Evolving markets and market product definition
4. Resource Adequacy accounting
5. Lack of cost-effectiveness evaluation methods
6. Lack of cost recovery policy
7. Lack of cost transparency and price signals (wholesale and retail)
8. Lack of commercial operating experience
9. Lack of well-defined interconnection process

Each barrier category is discussed in the following subsections, including summary of parties' comments and proposed next steps.

### 2.1. Lack of definitive operational needs

#### 2.1.1 Summary of Party Comments

The CPUC is currently assessing electric system operational needs in year 2020 within the CPUC's long-term procurement planning (LTPP) proceeding (R.10-05-006). As part of the LTPP proceeding, the CPUC and the CAISO are conducting a study to determine the likely capacity and operating characteristics needed to meet renewable integration requirements, with a focus on the newly established 33% renewable portfolio standard (RPS)<sup>1</sup>. Results so far indicate a wide range of potential needs, or lack thereof, under various scenarios.<sup>2</sup> The lack of a definitive conclusion to the study presents a challenge to determining to what extent energy storage technologies can indeed play a part in addressing grid system needs, including integration.<sup>3</sup>

---

<sup>1</sup> The CPUC is currently implementing SB 2, which established the 33% Renewable Portfolio Standard, in R.11-05-005.

<sup>2</sup> See CAISO [presentation](#) at joined IOU/E3 [presentation](#)

<sup>3</sup> Brookfield August 29, 2011 comments at 2; PG&E August 29, 2011 comment at 5; and Sierra Club August 29, 2011 comments at 7.

December 12, 2011

### 2.1.1 Proposed Next Steps

CPUC Staff will continue to collaborate with other entities, including CAISO, to identify electric system needs and where electric energy storage could play a role to fill those needs. As system needs are identified in the LTPP proceeding, the CPUC should consider whether energy storage technologies could address these needs. The CPUC plans on issuing a decision regarding system needs in R.10-05-006 in 2012 and after that point we will solicit comments from the parties on how to best proceed.

## 2.2. Lack of cohesive regulatory framework

### 2.2.1 Summary of Party Comments

California's electricity markets are currently operated under the premise that energy cannot be stored in a practical cost-effective manner. This operational limitation can be traced to the history of energy market development and the way jurisdictional boundaries are drawn between regulatory agencies. Since energy storage has multiple uses across the electric system value chain, it is difficult to adopt a comprehensive policy within any one of the energy agencies such as the CPUC, the California Energy Commission (CEC), CAISO, and the Federal Energy Regulatory Commission (FERC).<sup>4</sup> Coordination is therefore especially needed both across policy proceedings at the CPUC, as well as between regulatory agencies.

### 2.2.1 Proposed Next Steps

CPUC Staff has begun the process of identifying proceedings which have implications for energy storage (see Figure 1: Storage Barriers Regulatory Matrix). Going forward, CPUC Staff will continue to identify proceedings both within the CPUC and other agencies that have implications for energy storage and encourage collaboration on energy storage issues. Staff will also use the 'end use' framework outlined in Section 3 of this proposal to facilitate discussion among the agencies of how address the multiple-use nature of energy storage.

In particular, the CPUC will monitor and participate in the CAISO "Pay for Performance" stakeholder initiatives, including CAISO's current proceeding, Renewable Integration: Market and Product Review (Phase 2), which addresses renewable integration policies such as Pay for Performance, load-following, and daily market settlements. A related effort includes FERC's two-part frequency regulation compensation for capacity held in reserve, and performance.

Other proceedings which could impact energy storage in California include FERC's Orders 890 and 719, enabling non-generation technologies such as storage to compete with generation technologies to provide grid reliability and ancillary services. Commission Staff will also monitor a current FERC Notice of Inquiry that addresses third party sales of ancillary services and accounting and financial reporting requirements for increased transparency of cost allocation for energy storage. This proceeding seeks to

---

<sup>4</sup> Brookfield August 29, 2011 comments at 4; SDG&E August 29, 2011 comments at 5; SCE September 16, 2011 comments at 5.

December 12, 2011

facilitate competitive markets for ancillary services and is considering classification of energy storage assets.

Furthermore, from a broad policy perspective, the CPUC will collaborate with the CEC to ensure that energy storage policy from this proceeding is in alignment with the Integrated Energy Policy Report.

## 2.3. Evolving markets and market product definition

### 2.3.1 Summary of Party Comments

There are many vehicles by which regulations affect the energy markets, but energy storage is often not consistently considered across the corresponding proceedings. For example, the CPUC set rules governing utility transactions for short-term to multi-year energy, capacity, fuel, and energy financial services in the LTPP proceeding. At the same time, the CPUC set rules on how utilities purchase renewable power, which are predominantly transactions of highly structured long-term energy products in the RPS proceedings. The Resource Adequacy (RA) program, in comparison, drives the one-year forward capacity market. In addition, the CAISO operates an integrated day ahead forward market for energy and ancillary services and a real-time imbalance market. The CAISO is currently reviewing how to define market products that are technology/resource neutral and more accurately reflect the value of grid balancing when the penetration of intermittent resources increases.<sup>5</sup> Energy storage often does not clearly fall under market products as they are defined and evolving markets provide an opportunity to better incorporate energy storage.

### 2.3.2 Proposed Next Steps

CPUC Staff has begun the process of identifying proceedings which have implications for energy storage (see Figure 1: Storage Barriers Regulatory Matrix). As wholesale markets and market definitions evolve, a policy framework for energy storage can guide how energy storage fits into each layer of the electric system value chain, irrespective of how specific market products are ultimately defined. CPUC Staff will continue to participate in CAISO's stakeholder processes to encourage policies and market design that is technology neutral.

## 2.4. Resource Adequacy accounting

### 2.4.1 Summary of Party Comments

A large number of parties have identified RA accounting rules as a barrier to broader energy storage deployment.<sup>6</sup> The current process of requiring load-serving entities to purchase generic RA capacity does not account for grid operational characteristics necessary to operate the grid with an expected high penetration of intermittent renewable resources.

---

<sup>5</sup> See CAISO webpage on the [Renewables Integration Market Product Review](#).

<sup>6</sup> Brookfield August 29, 2011 comments at 5; CESA September 16, 2011 comments at 4; DRA August 29, 2011 comments at 2; PG&E August 29, 2011 comments at 6; PG&E September 16, 2011 comments at 6; SCE August 29, 2011 comments at 3; Sierra Club August 28, 2011 comments at 4; Sierra Club September 16, 2011 comments at 1; SDG&E August 29, 2011 comments at 5.

December 12, 2011

## 2.4.2 Proposed Next Steps

The first important outcome of this rulemaking should be to begin the process of having RA value assigned to energy storage as part of the new RA rulemaking (R.11-10-023). The 'end use' framework outlined in Section 3 of this proposal identifies the broad uses for storage. The CPUC will need to determine whether and how RA can be attributed to each of the 'end uses' or their combinations. The RA treatment for energy storage is preliminary in the scope of R.11-10-023.<sup>7</sup> CPUC Staff anticipates close coordination between R.10-12-007 and R.11-10-023 regarding the RA rules for energy storage.

## 2.5. Lack of cost-effectiveness evaluation methods

### 2.5.1 Summary of Party Comments

Many parties identified uncertainty around cost-effectiveness evaluation methods as a major barrier to adoption of storage.<sup>8</sup> In particular, they state that the unique operational aspects of energy storage pose a challenge in recognizing all relevant benefits and quantifying them. Parties express a concern that some of the benefits, particularly environmental, are not part of the current calculation methods and the total benefits of energy storage, therefore, end up being significantly underestimated.

### 2.5.2 Proposed Next Steps

Phase 2 of this proceeding will consider the appropriate methodology for evaluating costs and benefits of energy storage. The Commission has utilized cost-benefit tests in previous energy efficiency<sup>9</sup>, distributed generation<sup>10</sup>, and demand response<sup>11</sup> proceedings. The Commission will seek general consistency with these decisions, while recognizing that modifications to these methodologies will be required to reflect the unique attributes of energy storage.

## 2.6. Lack of cost recovery policy

### 2.6.1 Summary of Party Comments

Because energy storage could potentially provide transmission, distribution, and generation services, it is possible for it to recover cost under both cost-based and market-based rates.<sup>12</sup> Thus, without a clear way to fit energy storage into the existing regulatory and cost recovery structure, it will be difficult to both value and pay for energy storage.<sup>13</sup> Certain parties have proposed a long-term contracting mechanism similar to the RPS to help energy storage projects financing, as the CAISO market dynamic is

---

<sup>7</sup> R.11-10-023 Appendix A at 2. See [http://docs.cpuc.ca.gov/word\\_pdf/FINAL\\_DECISION/146362.pdf](http://docs.cpuc.ca.gov/word_pdf/FINAL_DECISION/146362.pdf)

<sup>8</sup> CFC August 29, 2011 comments at 10; DRA August 29, 2011 comments at 6; PG&E August 29, 2011 comments at 4.

<sup>9</sup> The avoided cost methodology adopted in D.05-04-02 4, as modified by D.06-06-063.

<sup>10</sup> The avoided cost methodology adopted in D. 09-08-0 26.

<sup>11</sup> The avoided cost methodology adopted in D. 10-12-0 24.

<sup>12</sup> PG&E August 29, 2011 comments at 7.

<sup>13</sup> Sierra Club August 29, 2011 comments at 3.

December 12, 2011

insufficient to attract investments.<sup>14</sup> Other parties, however, believe that the Commission should first clearly define cost responsibility and ownership structure, which could then make it easier to determine cost allocation.<sup>15</sup>

### 2.6.2 Proposed Next Steps

This proceeding should consider how storage applications across different grid functions can inform cost recovery policy that falls within the Commission's ratemaking jurisdiction (distribution service and energy commodity procurement).

## 2.7. Lack of cost transparency and price signals (wholesale and retail)

### 2.7.1 Summary of Party Comments

Parties helped to identify three aspects of today's energy market where more cost transparency and price signals could "level the playing field" such that energy storage could be a potential solution to grid operational problems. The three areas where cost/price transparency could be improved are: (1) within the CAISO energy and ancillary market design; (2) within utility procurement planning and contract evaluation process; and (3) in retail rate design.

### 2.7.2 Proposed Next Steps

Of the three areas listed, the latter two fall within the CPUC jurisdiction and can be addressed in coordination with other proceedings (see Figure 1: Storage Barriers Regulatory Matrix).

## 2.8. Lack of utility operating experience

### 2.8.1 Summary of Party Comments

Electric energy storage represents a nascent set of technologies, which have yet to be utilized on a commercial scale. PG&E, SCE and SDG&E are currently evaluating the value propositions and useful lifetime for advanced energy storage assets.

### 2.8.2 Proposed Next Steps

This particular challenge will be resolved over time, as utilities gain additional operating experience with energy storage. The Commission can assist this process by pursuing a policy framework that promotes a technology-neutral competitive environment where energy storage can be a viable commercial option. Additionally, utilities should get more operating experience through tests and pilots that are part of the

---

<sup>14</sup> Brookfield August 29, 2011 comments at 5; CESA September 16, 2011 at 5; DRA August 29, 2011 comments at 2.

<sup>15</sup> CFC August 29, 2011 comments at 10; SCE September 16, 2011 comments at 12.



December 12, 2011

Smart Grid deployment and ARRA-funded stimulus programs.<sup>16</sup> As such, the Commission will also ensure that the Smart Grid Deployment Plans<sup>17</sup> currently under review adequately incorporate energy storage.

## 2.9. Lack of well-defined interconnection process

### 2.9.1 Summary of Party Comments

Parties have identified the lack of well-defined interconnection processes as a barrier to energy storage deployment.<sup>18</sup> This challenge arises both as the result of overlapping tariffs (CPUC Rule 21 and FERC WDAT) and evolving technical standards.

### 2.9.2 Proposed Next Steps

The storage rulemaking should defer the consideration of distribution-level energy storage interconnection issues to R.11-09-011 (which includes the Rule 21 Working Group). For transmission level interconnection issues, the CPUC remains an active participant in the CAISO's Generation Interconnection Procedures initiative.

## 2.10. Energy Storage Adoption Barriers Summary

CPUC Staff summarized parties' comments into nine underlying barriers to energy storage adoption. Several of the identified barriers are the subject to either existing Commission proceedings or soon-to-start Commission proceedings, such as RA, LTPP and others. Additionally, others rely on work from entities other than the CPUC, such as the CAISO, or are cross-jurisdictional in nature and will require ongoing collaboration across the agencies to address. As the first step to help advancement of energy storage, CPUC Staff has developed a matrix (see Figure 1: Storage Barriers Regulatory Matrix) to outline how the barriers are to be addressed in different proceedings and by different agencies. Going forward, this matrix will need to be refined and updated to reflect additional information and new developments.

While addressing barriers within the existing frameworks will be a significant step towards supporting energy storage, there are considerations that still need to be addressed within this proceeding. Mainly, there is a need for clarity around cost-effectiveness evaluation methods and for determination of next steps pertaining to an energy storage procurement target suggested in AB 2514. Subsequent sections will further outline the CPUC Staff proposal for Phase 2 of this proceeding.

---

<sup>16</sup> For example, SCE is testing a 4 MW/16MWH battery located at a substation to firm wind production from the Tehachapi. PG&E also received funding to begin testing the feasibility of a Compressed Air Energy Storage project at a location to be determined in the Central Valley.

<sup>17</sup> Applications by utilities pursuant to SB17: A.11-06-006; A.11-06-029; A.11-07-001

<sup>18</sup> Placeholder

Energy Storage Framework Staff Proposal

December 12, 2011

		CPUC RULEMAKING PROCESSES						INTERAGENCY COORDINATION		
		Energy Storage	LTPP	RPS	RA	SGIP, CSI	DSM	FERC	CAISO	CEC
		Sec. 2835, 9620	Sec. 454.5	Sec. 399.11-399.20	Sec. 380	Sec. 2851-2, 379.6	Sec. 379.6, 454.5(c), 743.1. etc			
BARRIERS TO ENERGY STORAGE DEPLOYMENT	[1] Lack of definitive system need	Considers setting a storage "need" or procurement target per AB 2514	Determine long-term grid operational need for flexible resources with CAISO analysis	R.11-05-005 establishes RPS procurement needs and compliance target	Determine annual LCR for local RA need for LSEs with CAISO input	"Need" and program budgets are set by the legislature	Program targets are currently base on potential and goals studies	n/a	Conducts Renewable Integration (RI) modeling with 33% renewable	Forecasts demand via IEPH process
	[2] Lack of cohesive regulatory framework	Identify regulatory barriers, map action items across proceedings	Set input assumptions across resource types for long-term planning	Goal is to meet RPS target in a LCBF manner	Program goal is to ensure reliability on a year-ahead basis	Program goals is to promote DG deployment given program budget	Provides input parameters into the LTPP process	n/a	n/a	n/a
	[3] Evolving markets and market product definitions	Takes input from procurement-related policy initiative	Sets short- to long-term procurement rules and market for multi-year products	Sets RPS rules (mostly long-term energy contracts), and tradeable RECs.	Sets one-year forward RA market, criteria RA eligibility and NQC for resource types	CSI program participants can participate in tradeable REC market	R.07-01-041 looks at transition DR programs to fit into wholesale market design	Set rules on transmission development and transmission market products	Renewable Integration Market Product Review, etc.	Sets RPS eligibility and REC accounting. Q: Should storage be eligible for generating RECs?
	[4] Resource Adequacy (RA) accounting	Determines set of uses where storage can be eligible for RA; coordinate with R.11-10-032	Determines long-term capacity and operational need; coordinates with R.11-10-032	Takes IOU-specific treatment of how capacity is valued in contracts; actual RA value may differ	Determine RA methods and values across storage applications	Program penetration is factored into long-term load forecast set by CEC	Program effects are factored into load forecasts in procurement planning	n/a	RI study may inform changes to RA accounting at CPUC to reflect more attributes	Q: demand-side energy storage in IEPH demand forecast?
	[5] Lack of cost-effectiveness (C/E) evaluation method	Determines a cost-effectiveness framework for energy storage	CAIS study results will likely affect parameter input to C/E framework	Uses LCBF and TOD factors to account for energy storage value	RA value for energy storage likely a parameter input into C/E methodology	Has program-specific C/E methodologies	Uses SPM-type evaluation process with ex ante and ex post reviews	n/a	n/a	n/a
	[6] Lack of cost recovery policy (cost- vs. market-based)	Sets policy on how storage can be valued and paid for	Sets "market-based" cost recovery for utility power transactions	Sets "market-based" RPS procurement cost recovery for RPS energy	RA cost recovery is subsummed under LTPP cost recovery framework	Sets incentive levels based on market studies	Sets "cost-based" cost recovery policy based on program budget review	Considering accounting rules for cost recovery across grid operations	Considering RI cost allocation and changes to ancillary service market	n/a
	[7] Lack of cost transparency and price signals	Takes cost and pricing input as exogenous factors	CAISO study re locational and operational needs will clarify cost	Fair market price determinant for RPS energy is still in flux and evolving	Capacity products currently transacted bilaterally via periodic utility RFOs	Sets program rules on net metering for CSI customers	Provides incentives rather than setting rates	Considering transmission-level storage cost recovery	Determines who should bear the cost of intermittency	[not applicable?]
	[8] Lack of commercial operating experience	Considers targeted RD&D; coordinate with R.11-03-012 and R.11-10-003	Sets procurement rules but does not consider individual projects	Project viability test assess commercial maturity used in RFOs	NQC is calculated for facilities that are already operating commercially	Eligible technology types are commercial available	A.11-03-001 targets PLS energy storage for expanded incentive program	n/a	n/a	Storage 2020 Study reviews status of storage technology development
	[9] Lack of well-defined interconnection processes	Within the scope of R.11-09-011 (for distribution level resource)						Informal staff effort to assess DSM resources at busbar level for RA telemetry	sets FERC-jurisdictional interconnection rules	Generation Interconnection Process reform

Figure 1: Storage Barriers Regulatory Matrix

December 12, 2011

### 3. Energy Storage Analysis Framework

The purpose of the Energy Storage Analysis Framework is to set a foundation for how to approach energy storage. In its basic form, the framework is a decomposition of energy storage into manageable components that can be used in a variety of ways to assist with analysis. This section describes how this framework was developed and how it will be used going forward.

#### 3.1. Framework Introduction

Electric energy storage is a highly complex area and many analysts in the industry have come to the conclusion that a framework that decomposes storage into more manageable and discrete areas is needed to support analysis in this space. An example of such a framework was submitted by Southern California Edison (SCE) in comments on August 29, 2011. SCE proposes an application and operational usage approach, which decomposes energy storage by looking at physical location and operating profile across the value chain. The approach taken by SCE acknowledges that actual energy storage implementations may have several operational uses and, therefore, groups operational uses into 12 applications to facilitate a better understanding of benefits.<sup>19</sup> There are also several other similar frameworks, including one outlined by Electric Power Research Institute (EPRI) in the Electricity Energy Storage Technology Options whitepaper.<sup>20</sup> Leveraging work done by SCE and EPRI, among others, CPUC Staff has developed a similar framework that decomposes energy storage into 20 'end uses' across the energy value chain. This list (Figure 2: Energy Storage 'End Uses') is intended to be used as a foundation for further framework development and subsequent analysis of energy storage related issues.

---

<sup>19</sup> Southern California Edison, *Moving Energy Storage from Concept to Reality*

<sup>20</sup> Electric Power Research Institute, *Electricity Energy Storage Technology Options*, December 2010

December 12, 2011

Category	Storage 'End Use'
<i>Describes at what point in the value chain storage is being used</i>	<i>Describes what storage is being used for i.e. its application</i>
<b>ISO/Market</b>	<ol style="list-style-type: none"> <li>1 Ancillary services: frequency regulation</li> <li>2 Ancillary services: spin/non-spin/replacement reserves</li> <li>3 Ancillary services: ramp</li> <li>4 Black start</li> <li>5 Real time energy balancing</li> <li>6 Energy price arbitrage</li> <li>7 Resource adequacy</li> </ol>
<b>Generation</b>	<ol style="list-style-type: none"> <li>8 Intermittent resource integration: wind (ramp/voltage support)</li> <li>Intermittent resource integration: photovoltaic (time shift,</li> <li>9 voltage sag, rapid demand support)</li> <li>10 Supply firming</li> </ol>
<b>Transmission/Distribution</b>	<ol style="list-style-type: none"> <li>11 Peak shaving: off-to-on peak energy shifting (operational)</li> <li>12 Transmission peak capacity support (upgrade deferral)</li> <li>Transmission operation (short duration performance, inertia,</li> <li>13 system reliability)</li> <li>14 Transmission congestion relief</li> <li>15 Distribution peak capacity support (upgrade deferral)</li> <li>16 Distribution operation (Voltage Support/VAR Support)</li> <li>17 Outage mitigation: micro-grid</li> </ol>
<b>Customer</b>	<ol style="list-style-type: none"> <li>18 Time-of-use (TOU) energy cost management</li> <li>19 Power quality</li> <li>20 Back-up power</li> </ol>

**Figure 2: Energy Storage 'End Uses'**

The 'end uses' identified above are intended to be a comprehensive set of ways in which energy storage can be used and, therefore, provide value. As the understanding of the ways that energy storage can be used evolves, the above list can be adjusted to reflect new developments.

December 12, 2011

### 3.2. Potential Framework Applications

There are many ways in which the energy storage 'end use' framework can be utilized. The decomposition of energy storage subject matter into more manageable areas can be useful across many areas of analysis. For example, the energy storage 'end use' framework can serve as the basis for:

- RA value: The recently opened RA proceeding should consider creating an RA value for storage. Parties in that proceeding should make use of the identified 'end uses' of storage and be able to calculate the RA value, where appropriate, of those identified 'end uses.' Parties and CPUC Staff should work with the RA proceeding to facilitate a discussion around the creation of an RA model and value for storage that can be used in a timely manner.
- Further barriers analysis: Barriers can be aligned to specific 'end uses'. This way, the more challenging applications of energy storage can be better understood. Additionally, barriers can be better prioritized and managed if considered in relationship to particular 'end uses' and consequently goals and benefits.
- Technology analysis: Aligning energy storage solutions to 'end uses' is a critical step in understanding both the functional requirements and maturity of technology required to enable 'end use' functionality.
- Value proposition: 'End uses' have corresponding benefit streams. In some cases, it will make sense to combine 'end uses' into applications in order to capture not just stand-alone benefits, but also synergies. 'End uses' and applications will have corresponding costs and through understanding both benefit and cost drivers value proposition for storage can begin to emerge.
- Roadmap development: The workshops and comments provided by the parties demonstrate that there are too many considerations, barriers, issues and uncertainties to be dealt with at the same time. Therefore, CPUC Staff proposes developing an energy storage roadmap that captures a vision for energy storage adoption based on policy goals, priorities and constraints. This roadmap can then serve as a tool to prioritize issues pertaining to energy storage and lay a foundation for developing a plan to address them.

It is also important to note that the proposed framework is not intended to eliminate analysis of energy storage from a unified perspective. Rather, by focusing on the specific 'end uses' it will become apparent which aspects of energy storage are unique to specific applications and which aspects of storage are common across all uses.

December 12, 2011

## 4. Continued Analysis and Next Steps

### 4.1. Analysis Process


The end goal of this proceeding is to determine what procurement targets, if any, should be established for energy storage. Also to be considered in this proceeding are the policies to encourage cost effective energy storage. Through the work conducted so far, CPUC Staff has identified several key themes:

- The best practice for analyzing energy storage is to use a framework based on ‘application’ and/or ‘operational use’ of storage. Such frameworks have been developed by several entities in the market, including SCE and EPRI, for the analysis of the energy storage market.
- The variety of possible applications and operational uses of energy storage makes cost/benefit analysis particularly challenging.
- There are many different points of view regarding whether procurement targets, or including energy storage in the IOU loading order, would be beneficial.
- Different types of energy storage add another layer of complexity, as maturity varies drastically depending on the technology. Additionally, not only do different types of storage enable different applications and operational uses, but where energy storage is located on the grid also increases the complexity of defining benefits and uses.

Since energy storage is a very large and complex subject, the preferred approach for achieving progress is to incrementally manage the policy analysis. Therefore, it is proposed that the analysis approach going forward focuses on incremental steps and that the approach and framework be revised as issues become more precise. Also, CPUC Staff proposes that the energy storage issues are prioritized based on system needs and technology maturity to ensure that solutions with most potential are identified and supported.

The proposed analysis approach consists of four major categories: regulatory framework, cost effectiveness, procurement objectives and energy storage roadmap (Figure 3: Energy Storage Analysis Approach).

December 12, 2011

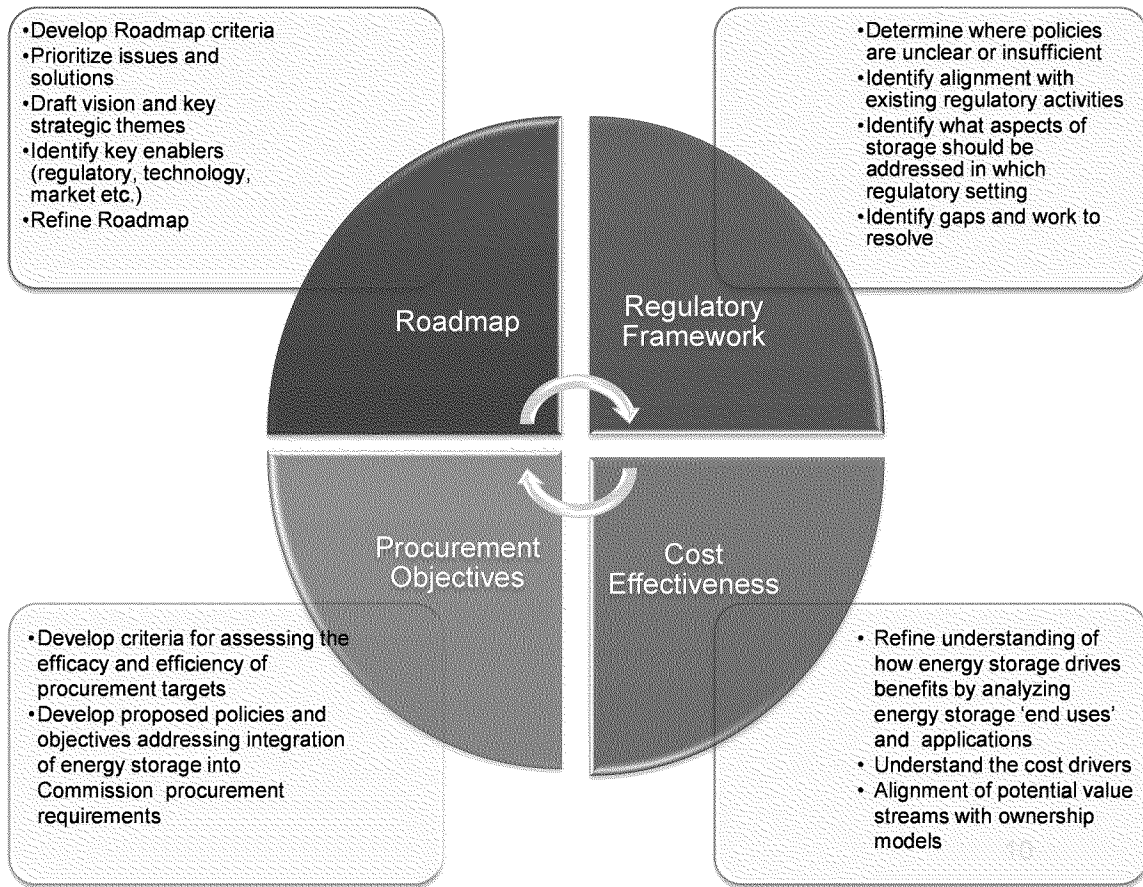

**Figure 3: Energy Storage Analysis Approach**

Notably, there are issues that fall outside of these four main categories. As our analysis progresses, these issues will either be addressed as part of these four focus areas or the framework will be adjusted to accommodate them. For example, assessing engineering and operations implications of introducing a significant amount of energy storage to the distribution network currently do not fall into any of the categories, as it remains to be seen to what extent this question needs to be addressed in this proceeding.

The analysis framework proposed would address the four analysis categories in an iterative manner. In other words, a draft roadmap and regulatory framework would be developed and then refined as value proposition and procurement objectives become better defined. The end result is that the four elements would come together synergistically to help frame energy storage policy direction.

#### 4.2. Key Next Steps

As a next step, CPUC Staff proposes to perform a preliminary assessment across the four categories, with a goal of defining initial thinking and direction. In order to support this assessment, CPUC Staff seeks input from parties concerning the following:

December 12, 2011

- Regulatory Framework: CPUC Staff wants to ensure that the draft storage barriers regulatory matrix (see Figure 1: Storage Barriers Regulatory Matrix) is complete and that all proceedings relevant to electric energy storage are taken into consideration. If there are other proceedings that have impact on electric energy storage, the parties are requested to identify those and describe how they propose energy storage should be addressed. This should include efforts by other entities, such as CEC, CAISO and FERC.
- Cost Effectiveness: CPUC Staff would like to leverage the 'end use' framework outlined in Section 3 of this proposal to assess cost effectiveness methods for energy storage. The parties are requested to suggest how the Commission can use this framework to determine the cost-effectiveness of a project and what additional information is needed to do that.

Parties are also invited to provide general comments regarding the relative usefulness of the four primary Standard Practice Manual alternatives utilized by the Commission to evaluate cost-effectiveness, namely:

- 1) Participant Test;
- 2) Ratepayer Impact Measurement Test;
- 3) Total Resource Cost Test (including the Societal Cost Test);
- 4) Program Administrator Cost Test.

- Roadmap: The parties are requested to provide potential goals or milestones in adoption of energy storage to be incorporated into the energy storage roadmap. The goals or milestones should be focused on the near term (1-3 years), medium term (3-5 years) and long term (5 years and beyond). The proposed goals or milestones should be based on reality of current state energy storage adoption and technology maturity. For each one of the proposed goals or milestones the party should identify key enablers that are needed in order to make this goal or milestone achievable. An example can be ability for stand-alone energy storage solutions to get RA value by 2015, with a corresponding key enabler being adjustment to RA value calculation rules. CPUC Staff envisions the Roadmap will be reflective of priorities of energy storage uses and corresponding issues. A priority is to be reflective of system needs and technology maturity, among other considerations, and CPUC Staff encourages the parties to submit proposed priorities as part of their comments. An example of a priority is to increase the amount of distributed energy storage that functions to meet peak demand.
- Procurement Objectives: The parties are requested to submit proposed criteria for evaluating procurement targets. CPUC Staff will leverage these criteria to ensure that the analysis is comprehensive and that procurement requirements are effective.

The feedback from the parties will be used to develop several work products, including updated storage barriers regulatory matrix, cost-effectiveness methodology proposal and energy storage adoption



December 12, 2011

roadmap. The outcomes of the analysis outlined above will be used to evaluate a possible procurement target or other policy options to meet the objectives of AB 2514.

## **5. Conclusion**

Energy storage is an evolving area and there are many barriers to adoption, including gaps related to how energy storage should be addressed from a regulatory perspective. To move forward with the analysis, CPUC Staff proposes that an RA value be identified for energy storage systems and that LTPP develop a process for energy storage to participate in utility procurement practices. Additionally, CPUC Staff recommends utilizing an energy storage 'end use' framework, which frames the energy storage subject area into discrete energy storage uses, as a basis for understanding the attributes of energy storage across program areas. In Phase 2 of this proceeding the analysis will continue to focus on the four major categories: roadmap, regulatory framework, cost-effectiveness and procurement objectives. CPUC Staff is supportive of energy storage technologies and will continue to resolve barriers to adoption of viable and cost-effective energy storage.