




Valve Automation Decision Tree August, 2011

2. Earthquake Fault Crossings

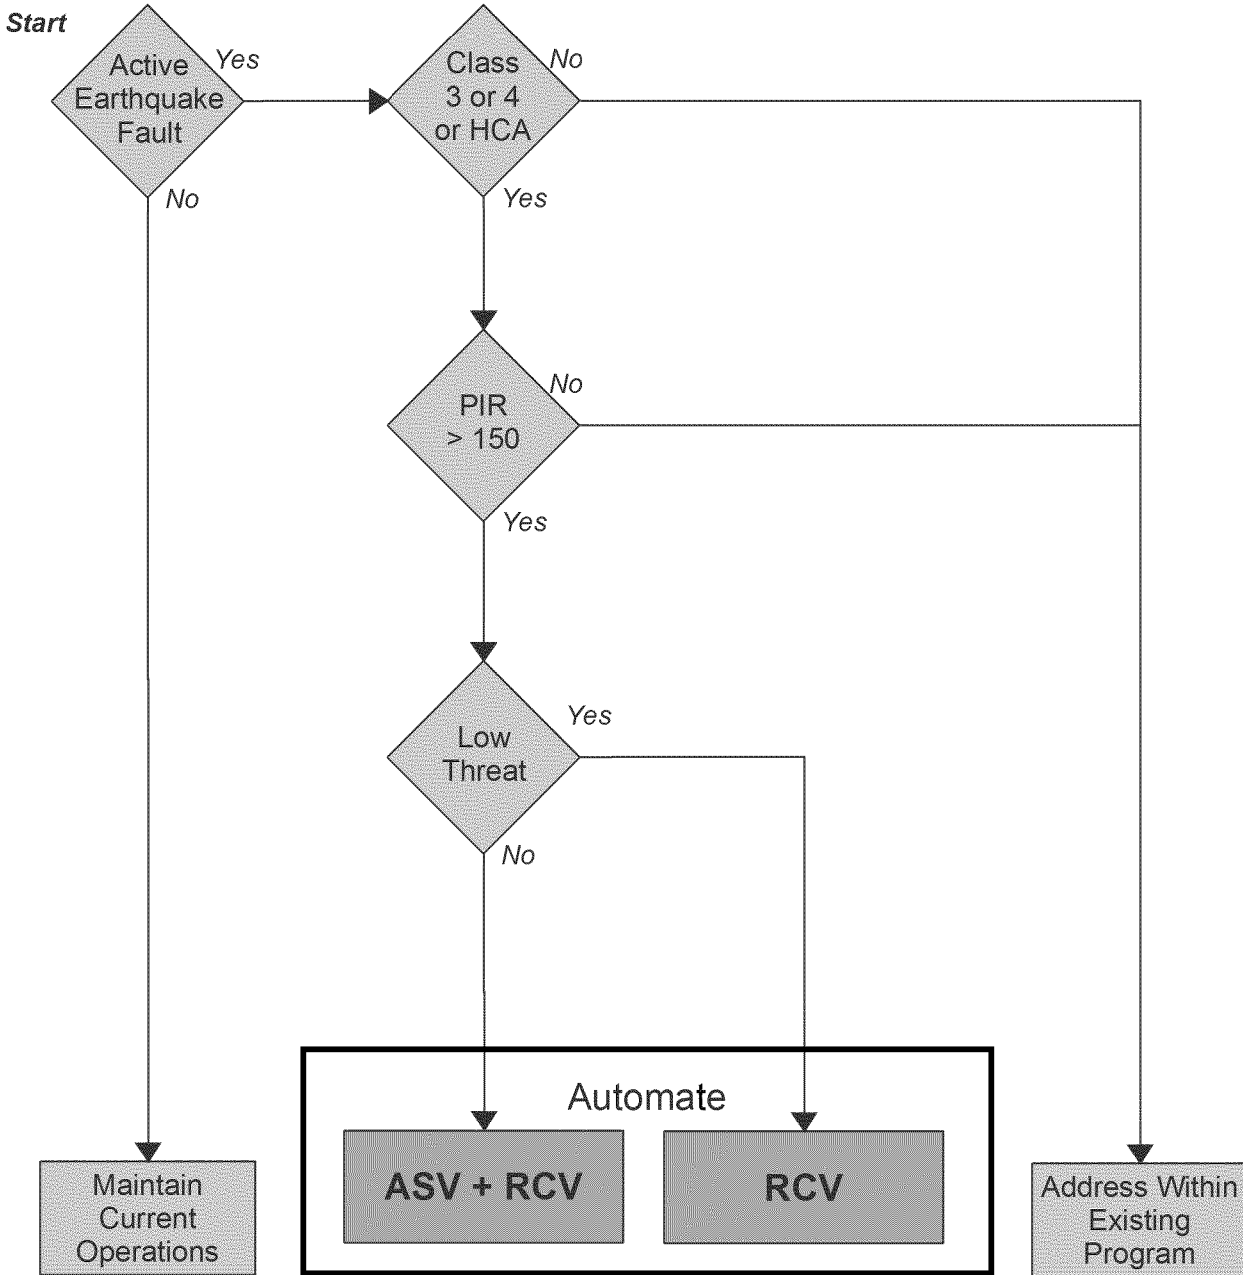

*Note: $PIR = 0.685 * \sqrt{pd^2}$

Decision Trees Do Not Imply Final Decisions. Should Always be Combined with Practical Judgment