

PG&E Emergency Plan Review

Electric Operations Emergency Management





Life Safety

- **Sign in Sheet**
- **Evacuation Plan and Assembly Point**
- **911 Notification**
- **CPR Certified**
- **Earthquake Response**



Objectives

To provide an overview of PG&E's Electric Emergency Response plans and to provide an opportunity for questions and feedback in compliance with Public Utility Code (PUC) 768.6




Agenda

- **Welcome and Introductions**
- **Overview of requirements of PUC 768.6**
- **PG&E's Electric Emergency Operations Plan**
- **2013 Fire Prevention Plan**
- **Questions**



PG&E

- 4 Regions, 19 Divisions, 70,000 square miles, 113,000 miles of overhead line
- Electric system is very sensitive to weather
 - 30,000 unplanned power outages per year
 - wind, rain, snow, lightning, heat are primary concerns
 - each division has a unique outage climatology

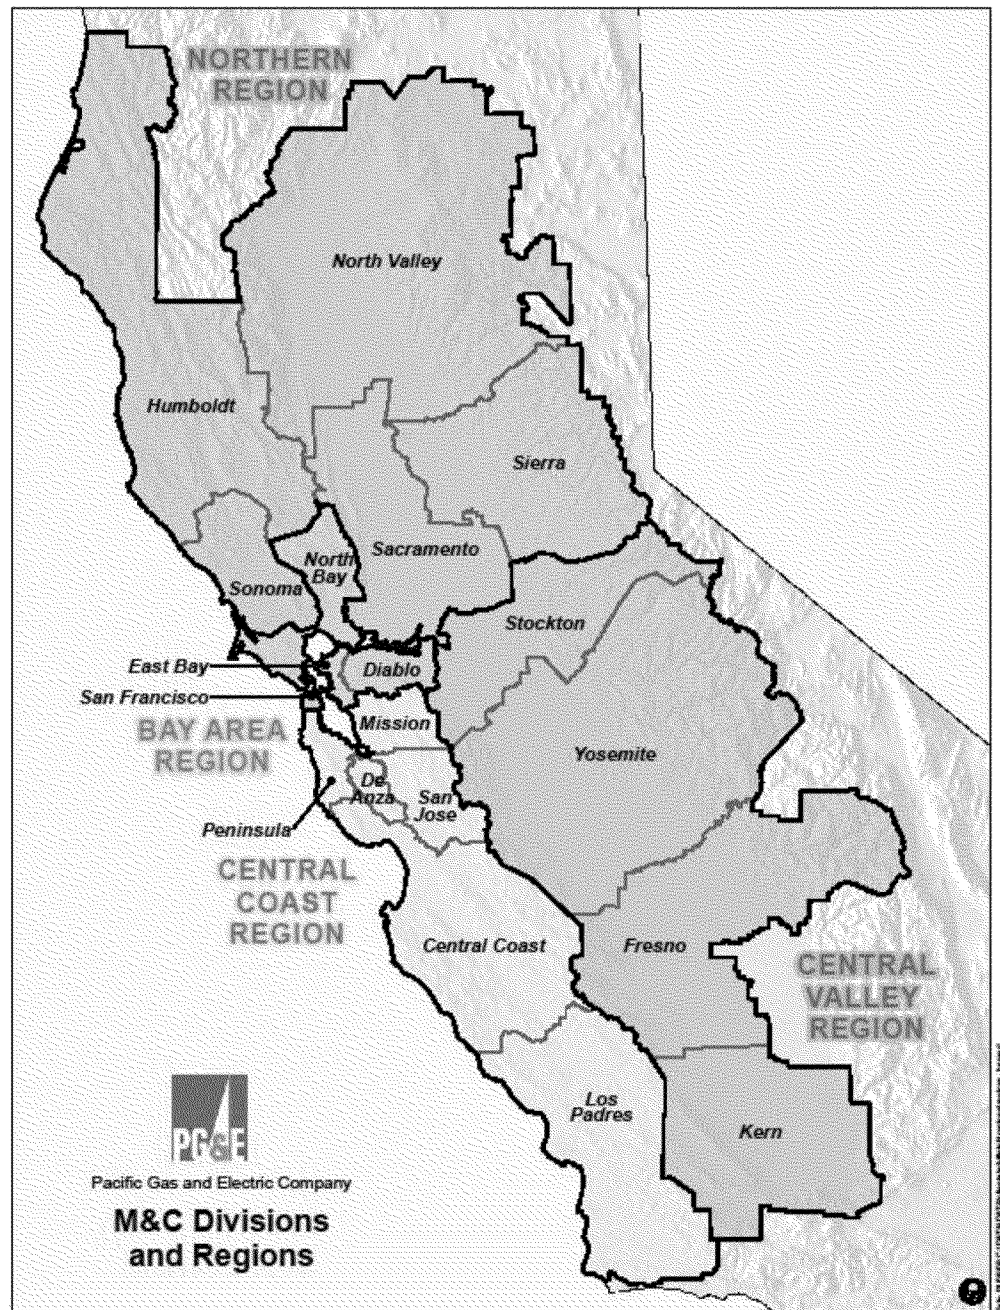

Overview of PUC 768.6





PUC 768.6 Requirements

Requires PG&E to:

- **Solicit counties and cities within the service territory for points of contact (POC) to review all electric emergency plans**
- **Provide these POCs with copies of electric emergency plans to review**
- **Hold public meetings with the POCs to obtain feedback and answer questions about the plans**
- **Notify the CPUC of the schedule of meetings**
- **File a report confirming the completion of the scheduled meetings by April 1st**
- **Complete this process every 2 years**
- **Requires the CPUC to update General Order (GO) 166**



2013 Engagement

- Initiated request for the POC's from all city and counties within the service territory
- Sent electronic copies of EEOP and Fire Prevention Plans (with minor redactions)
- Scheduled 8 public meetings to be held throughout the service territory:

Date	Place	Hotel	Hotel Street	City	Time
Thursday, 2/28	San Ramon	San Ramon Marriott	2600 Bishop Ranch Dr	San Ramon	0900-1200
Tuesday, 3/5	Santa Rosa	Santa Rosa Courtyard	175 Railroad Street	Santa Rosa	0900-1200
Thursday, 3/7	Salinas	Holiday Inn Express	195 Kern Street	Salinas	0900-1200
Tuesday, 3/12	Fresno	LM-Holiday Inn	1055 Van Ness Ave	Fresno	0900-1200
Thursday, 3/14	Bakersfield	Hilton Garden Inn	3625 Marriott Dr	Bakersfield	0900-1200
Thursday, 3/14	Sacramento	Red Lion Woodlake	500 Leisure Lane	Sacramento	0900-1200
Tuesday, 3/19	SLO	Courtyard SLO	1605 Calle Joaquin	San Luis Obispo	0900-1200
Tuesday, 3/19	Redding	Red Lion	1830 Hilltop Dr	Redding	0900-1200

- Meetings are held in public venues to facilitate access
- Meeting schedule and confirmation of the completion must be communicated to the CPUC by 4/1/2013

PG&E's Emergency Operation Plan





Electric Emergency Operations Plan

1 Emergency Operations Plan Overview

2 Emergency Plan Activation

3 Emergency Management Organization (EMO)

4 Emergency Response Process

4.1 Readiness

4.2 Pre-Event

4.3 Assessment, Restoration and 911 Emergency Response

4.4 Resource Management Process

5 Communications

6 Performance Indicators

7 Training and Exercises

8 After-Action Reports, Event Logs and Records

9 OIS/OMT Workaround Process



Overall Priorities

- Protect health and welfare of the public, PG&E responders and other response personnel
- Protect property (both the public and utility)
- Safely restore gas and electricity
- Keep customers, local/state agencies, government reps, news media, and others informed
- Re-establish critical business functions and move towards business as usual.



PG&E's Emergency Levels

Activation Matrix			
	Level 1	Level 2	Level 3
Description	Local Incident Day to Day	OEC/REC Activation	EOC Activation
Incident	Local Incidents	Division/Region Wide Incident	Multiple Divisions/Region wide Incidents and High Profile Events
DSO SOPP MODEL FORECAST Outage Conditions	CAT 1 Assume normal outage and crew expectations	Requires resources beyond routine 24/7 operations CAT 2 & 3 Triggers weather advisories, watches or warnings, crew and Tman estimates are forecast	Major storms, wildfire, flooding, earthquake, pandemic, DCPD incident, terrorist attack, major media event Cat 4 & 5 Triggers weather advisories, watches or warnings, crew and Tman estimates are forecast
Work Resources	Local Resources Resources moved within the Division	Resources moved within the Region Resources may move between Divisions within the Region ¹	Resources moved between Regions Significant need for outside resources such as; IBEW contractors, Mutual Aid (CUEA/WEI)
Electric System Incident			
Sustained Outages	N/A	SEE OEC Activation Guidelines	Multiple Divisions and Regions Impacted
Customers Out	N/A	>30,000 customers out at one time	>100,000 customers out at one time
Outage Restoration Duration Expected	1 Day	1-3 Days	>3 Days
Load Shed-EEP	N/A	Localized EEP	Localized EEP/System-wide EEP Event
Materials Inventory	Existing inventory adequate	Forecasted storm inventory may or may not be adequate. May need escalated support to procure material	Storm inventory monitoring requires escalating support to procure and deliver materials
News Media Incident			
Customer Experience	Normal	Increased attention with a Division or several Regions with potential national news attention	Increased attention local or Company-wide with national news exposure (e.g. manhole explosion, Super Bowl, Election Day)
<p>¹ Resource requests across Divisions within a Region will be managed by the Logistics Chiefs within each Division or Region. Once resources arrive they will be tracked by the respective Resource Unit within the Planning Section. In the event the Resource Unit has not been activated, resource tracking would become the responsibility of the Plans Section Chief or the Incident Commander.</p>			



Emergency Preparedness

- Storm Outage Prediction Project (SOPP)
- 10 Day Weather Forecast
- Severe Weather Notifications
- Storm briefings
- Drill scenario preparation
- Historical analysis





Adverse Weather at PG&E

- PG&E is exposed to risk during adverse weather
 - Power Outages / Customer Satisfaction / Performance Metrics
 - Risk of safety incidents
 - Financial risk (cost of restoration can be significant, cost of over preparing can also be significant)
 - Liability risk increases
- What are the main adverse weather factors at PG&E?
 - wind, rain, snow, lightning, heat
 - (Each has its own characteristics/impacts)
- What is the seasonal climatology of adverse weather risk?
Where?
 - Winter storm activity in the Santa Cruz mountains versus wildland fire risk in the Chico Area

USO Storm Outage Prediction Project (SOPP)




DSO SOPP Timeline

1995: the big year,
developed basic qualitative
forecast

1995 – 2008: forecasts of
adverse weather were based
on Area specific criteria

January 4, 2008: ...the big one
2600 outages
Jan 5 headline:

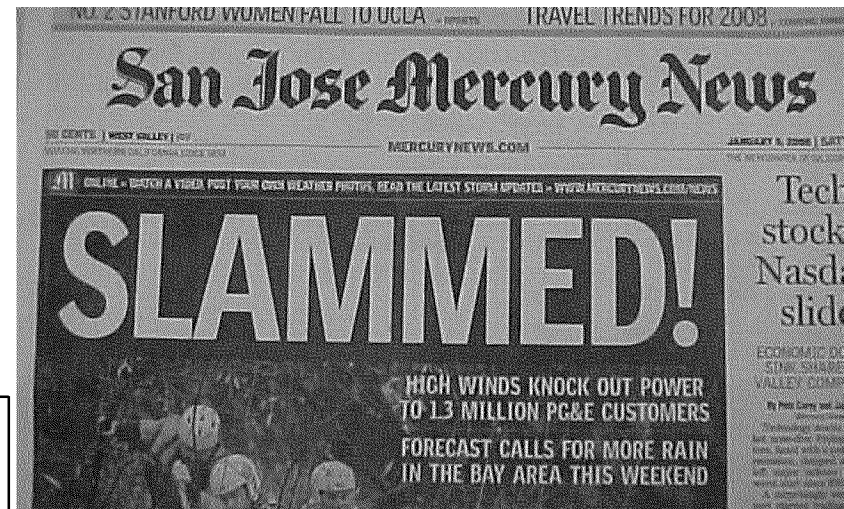

1995

2000

2008

February 2009: First SOPP forecast issued (based on Areas, no troublemen #'s included)

SOPP Model Output Beta Test 2

Outage Forecast for =>	Device Level Outages								
	Sunday 1/17/2010			Monday 1/18/2010			Tuesday 1/19/2010		
Outages by Division	SO	Tm	Cr	SO	Tm	Cr	SO	Tm	Cr
Area 1 Peninsula	<=5	N	N	24	10	5	16	7	3
San Fran	<=2	N	N	8	3	3	5	2	2
Area 2 Diablo	<=5	N	N	18	7	7	8	4	4
East Bay	<=3	N	N	10	4	4	9	4	3
Mission	<=3	N	N	10	4	4	7	3	3
Area 3 Cent. Coast	<=11	N	N	48	14	14	23	7	7
DeAnza	<=5	N	N	16	7	7	9	4	4
San Jose	<=6	N	N	10	7	7	8	4	4
Area 4 Fresno	<=9	N	N	20	5	5	13	4	3
Kern	<=5	N	N	18	5	5	8	2	2
Los Padres	<=6	N	N	34	10	9	11	4	3
Area 5 Stockton	<=7	N	N	40	10	10	17	5	4
Yosemite	<=8	N	N	38	10	7	13	4	3
Area 6 N. Valley	<=9	N	N	42	12	9	22	7	5
Sac	<=6	N	N	30	8	9	18	5	6
Sierra	<=11	N	N	40	10	10	24	6	6
Area 7 Humboldt	18	5	6	35	10	11	42	12	13
Sonoma	8	3	3	22	7	7	32	9	10
North Bay	8	3	3	24	7	8	31	9	11

Notes: SO = Sustained Outages, Tm = Troublemens, Cr = Crews, N = Normal

WindSOPP Model Outage Timing, by

Timing by Division	Sunday 1/17/2010	Monday 1/18/2010	Tuesday 1/19/2010
Area 1 Peninsula	10:00	10:00	04:00
San Fran	10:00	10:00	04:00
Area 2 Diablo	10:00	10:00	04:00
East Bay	10:00	10:00	04:00
Mission	19:00	19:00	04:00
Area 3 Cent. Coast	10:00	10:00	07:00
DeAnza	10:00	10:00	04:00
San Jose	10:00	10:00	04:00
Area 4 Fresno	10:00	10:00	07:00
Kern	10:00	10:00	07:00
Los Padres	10:00	10:00	07:00
Area 5 Stockton	12:00	12:00	07:00
Yosemite	12:00	12:00	07:00
Area 6 N. Valley	12:00	12:00	04:00
Sac	12:00	12:00	04:00
Sierra	12:00	12:00	04:00
Area 7 Humboldt	20:00	12:00	04:00
Sonoma	22:00	12:00	04:00
North Bay	22:00	12:00	04:00

Notes: Timing indicates time of strongest winds for any division with grey skies or

Storm Date: Sun Feb 22, 2009
Based on 22 PST Wed Feb 18 Weather Model Runs

Outage Range	24 Hour Outage* Forecast for Sunday, Feb 22, 2009	Timing of Strongest Winds	Crew Xfmr	Crew Device	Total Crew outages	Crew Outage Ratio (per 24 Hrs)	Crews (avg)	Crews (Hi)
Area 6	50 100	Sun 10 am to 4 pm	17	49	66	3	22	29
Area 1	25 50	Sun 12 pm to 4 pm	8	24	33	4.5	7	10
Area 2	25 50	Sun 12 pm to 4 pm	8	24	33	4.5	7	10
Area 5	0 25	na	3	8	11	3	4	7
Area 3	25 50	Sun 12 pm to 4 pm	8	24	33	4	8	11
Area 4	0 25	na	3	8	11	3	4	7
All	175 400						74	103

* Device level and above outages
Preliminary indications are that 65% of device outages require crews
Not for public distribution

Monday 1/18/2010
First big forecast - MLK Storm

2008 - 2009: Initial SOPP feasibility Study

June 2009: HotSOPP created

Fall 2009: WindSOPP created


2008 2009 2010



DSO SOPP Model

Distribution System Operations - Storm Outage Prediction Project - Model

Developed to predict sustained outage counts, customer outage counts, timing of outages, and resource requirements necessary for restoration in order to better prepare for and mitigate total risk from storms

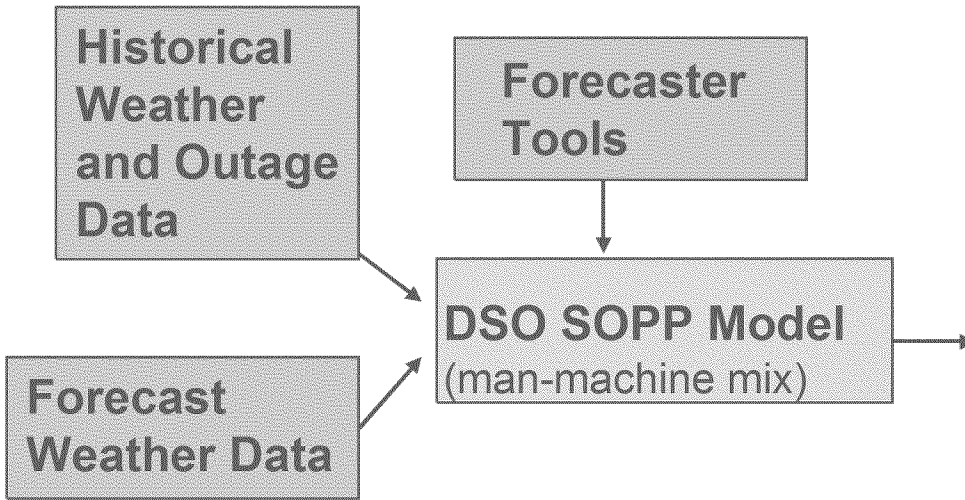

DSO SOPP Model Forecast

Issued: Thursday, January 12, 2012 15:39

Transformer Level Outages and Above

Cat	Staffing	Qualitative Weather
Cat 1	Normal	Adverse weather unlikely
Cat 2	Normal, but have a plan	Adverse weather possible
Cat 3	Staffing & Timing as Directed	Adverse weather likely
Cat 4	Staff to Model, Timing as Directed	Extreme weather possible
Cat 5	Staff to Model, Timing as Directed	Extreme weather likely

Outages by Division	Thursday 1/12/2012				Friday 1/13/2012				Saturday 1/14/2012				Sunday 1/15/2012			
	SO	CESO	TM	CR	SO	CESO	TM	CR	SO	CESO	TM	CR	SO	CESO	TM	CR
Northern Humboldt	7	800	6	5	19	2800	11	10	3	300	3	2	3	300	3	2
Region Sonoma	7	1300	5	4	24	4600	11	10	4	600	3	2	4	600	3	2
N. Valley	16	3100	11	10	26	5000	15	13	5	500	4	3	5	500	4	3
Sac	15	3200	7	6	23	4900	7	6	2	200	2	1	2	200	2	1
Sierra	18	4000	9	8	36	8100	14	12	5	600	3	2	5	600	3	2
Bay North Bay	6	1100	5	4	33	9700	13	10	2	400	2	1	2	400	2	1
Area San Fran	4	2500	3	2	11	6900	5	4	1	600	2	1	1	600	2	1
Region East Bay	4	2300	3	2	6	3400	4	3	1	600	2	1	1	600	2	1
Diablo	6	2100	4	3	7	2500	4	3	2	600	2	1	2	600	2	1
Central Peninsula	8	4100	5	4	8	4100	5	4	3	800	3	2	2	600	2	1
Coast Mission	7	2100	4	3	6	1800	4	3	2	700	2	1	2	700	2	1
Region DeAnza	3	700	3	2	9	2400	6	5	2	500	2	1	2	500	2	1
San Jose	4	1200	3	2	10	3600	6	5	2	600	2	1	2	600	2	1
Cent. Coast	8	1400	6	5	40	10600	16	14	4	700	3	2	4	700	3	2
Los Padres	8	1600	5	4	34	6600	12	9	3	500	3	2	3	500	3	2
Central Stockton	9	2400	5	4	34	9200	9	8	3	500	2	1	3	500	2	1
Valley Yosemite	10	1700	5	4	30	5000	8	7	4	400	3	2	4	400	3	2
Region Fresno	12	2200	7	6	39	7300	12	9	6	800	4	3	6	800	4	3
Kern	9	1800	5	4	24	4900	6	5	3	400	2	1	3	400	2	1
PG&E TOTAL	161	39600	101	82	419	103600	168	140	57	10300	49	30	56	10100	48	29

PG&E Internal Use Only

ATS - Meteorology Services

Notes: SO = Sustained Outages, CESO = Customers Experiencing Sustained Outages, TM = Troublemens, CR = Crew



DSO SOPP Model Sample Forecast

SO = Number of Sustained Outages (transformer level and above) forecast for the day

CESO = Number of Customers Experiencing Sustained Outages forecast for the day

Tm = Number of Troublemens needed to respond to outages *

Cr = Number of Crews needed to repair outages *

DSO SOPP Model Forecast

Issued: Thursday, January 12, 2012 15:39

Transformer Level Outages and Above

Cat	Staffing	Qualitative Weather
Cat 1	Normal	Adverse weather unlikely
Cat 2	Normal, but have a plan	Adverse weather possible
Cat 3	Staffing & Timing as Directed	Adverse weather likely
Cat 4	Staff to Model, Timing as Directed	Extreme weather possible
Cat 5	Staff to Model, Timing as Directed	Extreme weather likely

		Thursday 1/12/2012				Friday 1/13/2012				Saturday 1/14/2012				Sunday 1/15/2012			
Outages by Division		SO	CESO	TM	CR	SO	CESO	TM	CR	SO	CESO	TM	CR	SO	CESO	TM	CR
Northern Humboldt Region	Sonoma	7	800	6	5	9	2800	11	10	3	300	3	2	3	300	3	2
	N. Valley	16	3100	11	10	26	5000	15	13	5	500	4	3	5	500	4	3
	Sac	15	3200	7	6	23	4900	7	6	2	200	2	1	2	200	2	1
	Sierra	18	4000	9	8	36	8100	14	12	5	600	3	2	5	600	3	2
Bay Area Region	North Bay	6	1100	5	4	33	9700	13	10	2	400	2	1	2	400	2	1
	San Fran	4	2500	3	2	11	6900	5	4	1	600	2	1	1	600	2	1
	East Bay	4	2300	3	2	6	3400	4	3	1	600	2	1	1	600	2	1
	Diablo	6	2100	4	3	7	2500	4	3	2	600	2	1	2	600	2	1
Central Coast Region	Peninsula	8	4100	5	4	8	4100	5	4	3	800	3	2	2	600	2	1
	Mission	7	2100	4	3	6	1800	4	3	2	700	2	1	2	700	2	1
	DeAnza	3	700	3	2	9	2400	6	5	2	500	2	1	2	500	2	1
	San Jose	4	1200	3	2	10	3600	6	5	2	600	2	1	2	600	2	1
	Cent. Coast	8	1400	6	5	40	10600	16	14	4	700	3	2	4	700	3	2
Central Valley Region	Stockton	9	2400	5	4	34	9200	9	8	3	500	2	1	3	500	2	1
	Yosemite	10	1700	5	4	30	5000	8	7	4	400	3	2	4	400	3	2
	Fresno	12	2200	7	6	39	7300	12	9	6	800	4	3	6	800	4	3
	Kern	9	1800	5	4	24	4900	6	5	3	400	2	1	3	400	2	1
PG&E TOTAL		161	39600	101	82	419	103600	165	140	57	10300	49	30	56	10100	48	29

Forecast is color coded based on Category level

*** Note:**

Resource numbers are based on forecasted SO and how many crews/troublemen are needed to repair outages:

- within 12 hours for Cat 3 or lower outage conditions
- within 24 hours for Cat 4 or greater outage conditions

PG&E Internal Use Only

ATS - Meteorology Services

Notes: SO = Sustained Outages, CESO = Customers Experiencing Sustained Outages, TM = Troublemens, CR = Crews



DSO SOPP Model Sample Forecast

Timing indicates forecasted timing of most intense outage producing weather (rain, wind, snow, etc) for any division at Cat 2 or above

Colors correspond to the Category forecast

DSO SOPP Model Forecast Timing, by Division

	Thursday 1/12/2012	Friday 1/13/2012	Saturday 1/14/2012	Sunday 1/15/2012
Timing by Division	Timing	Timing	Timing	Timing
Northern Humboldt Region		0:00 - 6:00		
Sonoma	14:00 - 24:00	0:00 - 6:00		
N. Valley	14:00 - 24:00	0:00 - 6:00		
Sac	14:00 - 24:00	0:00 - 6:00		
Sierra	14:00 - 24:00	0:00 - 6:00		
Bay Area Region		0:00 - 8:00		
North Bay		0:00 - 8:00		
San Fran	16:00 - 24:00	0:00 - 8:00		
East Bay		0:00 - 8:00		
Diablo	16:00 - 24:00	0:00 - 8:00		
Central Coast Region	16:00 - 24:00	0:00 - 8:00		
Peninsula	16:00 - 24:00	0:00 - 8:00		
Mission	16:00 - 24:00	0:00 - 8:00		
DeAnza		0:00 - 8:00		
San Jose		0:00 - 8:00		
Cent. Coast		0:00 - 10:00		
Los Padres	20:00 - 24:00	0:00 - 10:00		
Central Valley Region	20:00 - 24:00	0:00 - 12:00		
Stockton	20:00 - 24:00	0:00 - 12:00		
Yosemite	20:00 - 24:00	0:00 - 12:00		
Fresno	20:00 - 24:00	0:00 - 12:00		
Kern	20:00 - 24:00	0:00 - 12:00		

PG&E Internal Use Only

ATS - Meteorology Services

Note: Timing reflects the most intense period of outage producing weather for any division at Cat 2 or above



DSO SOPP Model Sample Forecast

DSO SOPP Dissemination

- The DSO SOPP forecast is delivered each morning via email
- >3500 recipients
- Also posted to the PG&E intranet
- If adverse weather is imminent, afternoon and evening forecasts are produced

Distribution System Operations Weather Forecast: Friday March 30 – Sunday April 8...

File Message Developer McAfee E-mail Scan

Ignore X Junk - Delete Reply Reply Forward Forward All Respond Quick Steps Move Move Mark Unread Categorize Follow Up Tags Editing Zoom

From: [Redacted] Sent: Fri 3/30/2012 07:36

Subject: Distribution System Operations Weather Forecast: Friday March 30 – Sunday April 8, 2012

Message [DSOSOPP_BB_Image_2012-03-30-0723.png (92 KB)]

Distribution System Operations Weather Forecast: Friday March 30 – Sunday April 8, 2012

Forecast Discussion:

Showers continue today in Northern Region with dry conditions expected south of a Santa Rosa to Reno line. Showers will taper off this afternoon before the next storm approaches.

Very early tomorrow a developing Pacific storm will begin to impact Humboldt Division with increasing south winds and rain. This storm system will then sweep across the Service Area bringing heavy rain, gusty west to northwest winds in the Northern Region. Snow levels will start out at 4000' south by Saturday evening. Little snow expected north of the Sierra Nevada line. Following the storm system, snow levels will drop to 3000' north and are not expected at this time.

Snk northwest winds will develop behind the storm system on Sunday with the possibility of reaching outage producing thresholds.

Lingering snow showers in the Sierra Nevada are expected Sunday morning with dry conditions returning to all divisions Sunday afternoon through Tuesday morning. A weak system will move through on Tuesday or Wednesday next week with a chance of light showers continuing through the week and possible dry conditions returning next weekend.

DSO SOPP Model Forecast

Issued: Friday, March 30, 2012 07:23

Transformer Level Outages and Above

Cat	Staffing	Qualitative Weather
Cat 1	Normal	Adverse weather unlikely
Cat 2	Normal, but have a plan	Adverse weather possible
Cat 3	Staffing & Timing as Directed	Adverse weather likely
Cat 4	Staff to Model, Timing as Directed	Extreme weather possible
Cat 5	Staff to Model, Timing as Directed	Extreme weather likely

Outages by Division	Friday 3/30/2012				Saturday 3/31/2012				Sunday 4/1/2012				Monday 4/2/2012			
	SO	CESO	TM	CR	SO	CESO	TM	CR	SO	CESO	TM	CR	SO	CESO	TM	CR
Northern Humboldt Region	6	700	5	4	6	340	10	10	5	600	4	3	4	500	4	3
Sonoma	4	600	3	2	5	250	10	10	5	800	5	4	4	600	3	2
N. Valley	5	500	5	4	21	4000	15	15	5	500	4	3	6	500	3	4
Sac	4	400	3	2	2	1700	5	4	3	300	2	1	4	400	3	2
Sierra	7	800	4	3	23	3400	11	11	5	600	3	2	5	700	4	3
Bay Area	4	800	3	2	10	2500	7	6	5	1000	4	3	3	600	3	2
San Fran Region	1	600	2	1	3	1700	3	2	3	600	2	1	1	600	2	1
East Bay	1	600	2	1	6	3400	4	3	3	1700	3	2	1	600	2	1
Diablo	7	900	2	1	3	2800	6	4	3	300	2	1	3	500	2	1
Central Peninsula	2	800	2	1	3	4600	6	5	3	900	3	2	2	600	2	1
Coast	2	700	2	1	5	1500	3	2	2	700	2	1	2	700	2	1
Hudson	2	500	2	1	11	2800	4	3	3	700	3	2	2	600	2	1
Del Norte	2	600	2	1	7	2500	4	3	3	300	3	2	2	600	2	1
San Jose	6	1000	5	4	11	2900	8	7	7	1200	5	4	6	1000	5	4
Cent. Coast	4	600	3	2	4	800	4	3	3	600	4	3	4	600	3	2
Los Padres	4	600	3	2	4	800	4	3	3	600	4	3	4	600	3	2
Central Stockton	5	800	3	2	10	2700	5	4	6	1000	4	3	5	800	3	2
Valley	5	700	3	2	3	1500	5	4	6	900	4	3	6	700	3	2
Yosemite	5	700	3	2	3	1500	5	4	6	900	4	3	6	700	3	2

DSO SOPP Model Performance

- The DSO SOPP Model helps PG&E more efficiently prepare for adverse weather ...but only if outage forecasts are accurate
- How has the model performed in recent events?





DSO SOPP Model Performance

3/30/2012 forecast for 3/31/2012

1400 Update: Distribution System Operations Weather Forecast: Friday March 30 – Sunday April 8, 2012

1400 Update Highlights:

- **No significant changes to forecast**
- **A vigorous frontal system will sweep across the northern half of the Service Area Saturday morning bringing rain and south winds 30 to 40 mph, with higher gusts likely over elevated terrain**
- **Winds will shift to westerly and remain gusty throughout the day Saturday**
- **Main impacts still appear to be focused on Northern Region, with less certain impacts for areas south of a Bay Area to Tahoe line**
- **Snow levels will be initially high then lower to 3000 north and 4000 feet south by Saturday afternoon, however little snow accumulation is expected at the lower elevations and low snow outage conditions are not anticipated**
- **Chance of thunderstorms Saturday, most likely during the afternoon in Northern Region**
- **Breezy northwest winds 25 to 35 mph are possible Sunday along the coast, through the Bay Area, and down the San Joaquin Valley**
- **Fair weather with lighter winds expected Monday**

*ATS – Meteorology
Services*



DSO SOPP Model Performance

3/30/2012 forecast for 3/31/2012

DSO SOPP Model Forecast

Issued: Friday, March 30, 2012 13:52

Transformer Level Outages and Above

Cat	Staffing	Qualitative Weather
Cat 1	Normal	Adverse weather unlikely
Cat 2	Normal, but have a plan	Adverse weather possible
Cat 3	Staffing & Timing as Directed	Adverse weather likely
Cat 4	Staff to Model, Timing as Directed	Extreme weather possible
Cat 5	Staff to Model, Timing as Directed	Extreme weather likely

Outages by Division	Friday 3/30/2012				Saturday 3/31/2012				Sunday 4/1/2012				Monday 4/2/2012			
	SO	CESO	TM	CR	SO	CESO	TM	CR	SO	CESO	TM	CR	SO	CESO	TM	CR
Northern Humboldt Region	4	500	4	3	37	5500	15	12	5	600	4	3	4	500	4	3
Sonoma	4	600	3	2	16	3100	10	9	6	900	5	4	4	600	3	2
N. Valley	6	500	5	4	21	4000	15	13	5	500	4	3	6	500	5	4
Sac	4	400	3	2	8	1700	5	4	3	300	2	1	4	400	3	2
Sierra	7	800	4	3	23	5200	13	11	5	600	3	2	6	700	4	3
Bay North Bay Area	4	800	3	2	11	3200	8	7	5	1000	4	3	3	600	3	2
San Fran	1	600	2	1	3	1700	3	2	1	600	2	1	1	600	2	1
Region East Bay	1	600	2	1	6	3400	4	3	3	1700	3	2	1	600	2	1
Diablo	3	900	2	1	8	2800	5	4	3	900	2	1	3	900	2	1
Central Peninsula	2	600	2	1	9	4600	6	5	3	800	3	2	2	600	2	1
Coast Mission	2	700	2	1	5	1500	3	2	2	700	2	1	2	700	2	1
Region DeAnza	2	500	2	1	11	2900	7	6	3	700	3	2	2	500	2	1
San Jose	2	600	2	1	7	2500	4	3	3	900	2	1	2	600	2	1
Cent. Coast	6	1000	5	4	11	2900	8	7	7	1200	5	4	6	1000	5	4
Los Padres	4	600	3	2	5	800	4	3	5	800	4	3	4	600	3	2
Central Stockton	5	800	3	2	10	2700	5	4	6	1000	4	3	5	800	3	2
Valley Yosemite	6	700	3	2	9	1500	5	4	8	900	4	3	6	700	3	2
Region Fresno	8	1100	5	4	9	1200	5	4	10	1300	6	5	8	1100	5	4
Kern	3	400	2	1	3	400	2	1	4	600	3	2	3	400	2	1
PG&E TOTAL	74	12700	57	38	212	51600	127	104	87	16000	65	46	72	12400	57	38

PG&E Internal Use Only

ATS - Meteorology Services

Notes: SO = Sustained Outages, CESO = Customers Experiencing Sustained Outages, TM = Troublemakers, CR = Crews

Elevated Outage activity was forecast to begin Saturday morning in the north and spread south during the day

Most Intense Timing, by Division

	Saturday 3/31/2012 Timing	Sunday 4/1/2012 Timing	Monday 4/2/2012 Timing
Region DeAnza	04:00 - 16:00		
San Jose	06:00 - 20:00		
Cent. Coast	08:00 - 16:00		
Los Padres	08:00 - 16:00		
Central Stockton	08:00 - 20:00		
Valley Yosemite	08:00 - 20:00		
Region Fresno	08:00 - 20:00		
Kern	08:00 - 20:00		
Region DeAnza	08:00 - 20:00		
San Jose	08:00 - 20:00		
Cent. Coast	10:00 - 24:00		
Los Padres	10:00 - 24:00		
Central Stockton	12:00 - 18:00		
Valley Yosemite	14:00 - 24:00		
Region Fresno			
Kern			

PG&E Internal Use Only



ATS - Meteorology Services

Note: Timing reflects the most intense period of outage producing weather for any division at Cat 2 or above

DSO SOPP Forecast Issue d: Fri - 03/30/2012 13:52

Valid: Sat - 03/31/2012

Observed Sustained Outages (SOs) on 3.31.2012

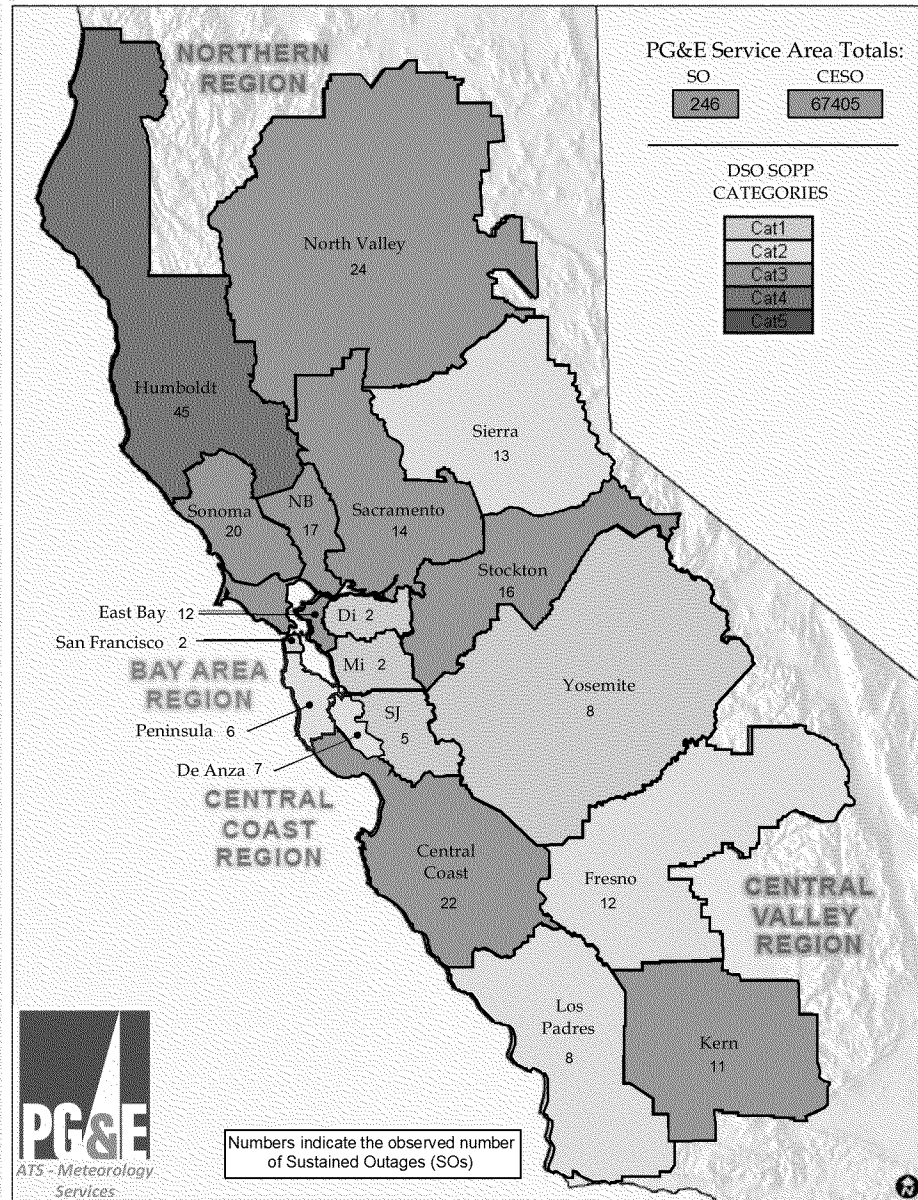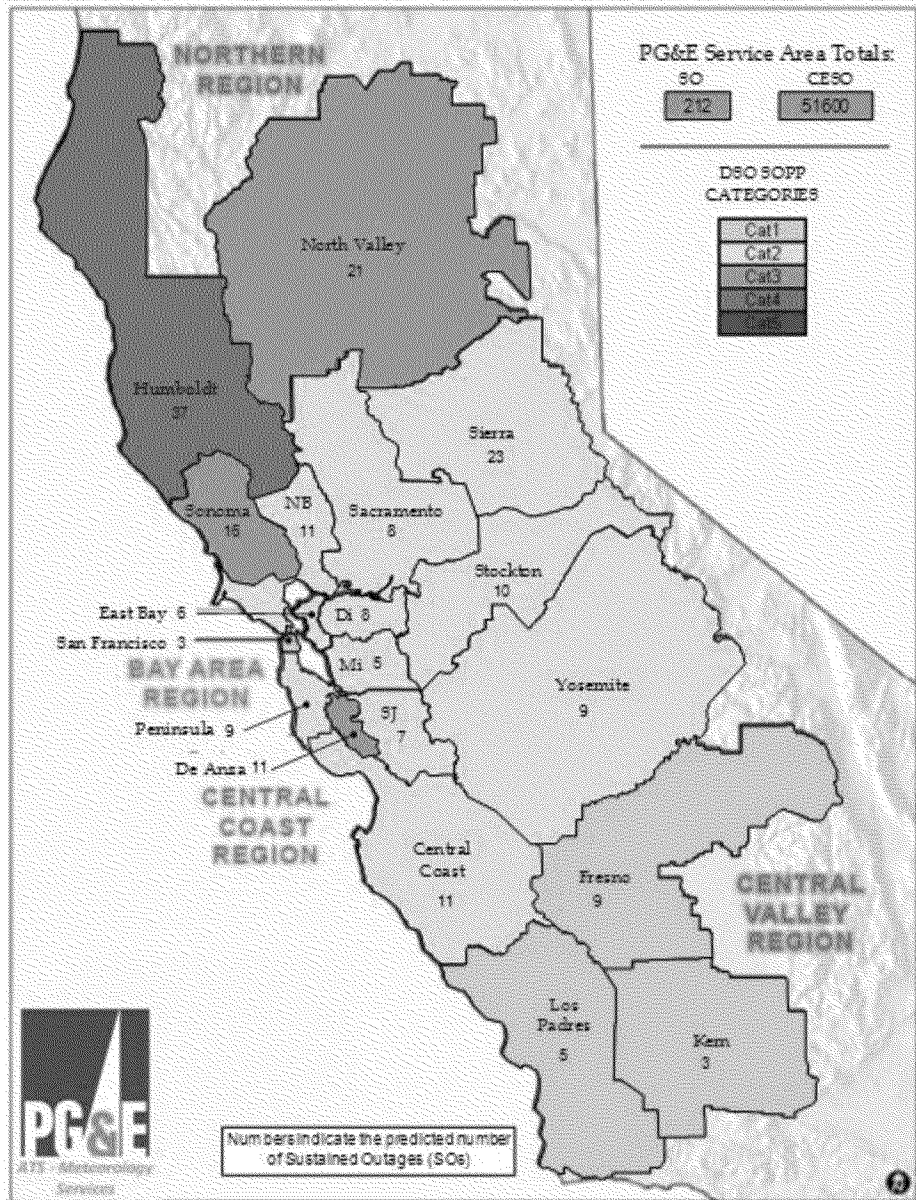

Actual Outages Observed from 03/26/2012 - 04/01/2012

ATS - Meteorology Services	Mon - 3/26/12		Tue - 3/27/12		Wed - 3/28/12		Thu - 3/29/12		Fri - 3/30/12		Sat - 3/31/12		Sun - 4/1/12		
	SO	CESO	SO	CESO	SO	CESO	SO	CESO	SO	CESO	SO	CESO	SO	CESO	
Humboldt	9	2042	37	4049	9	72	8	675	6	89	45	5333	10	176	Humboldt
Sonoma	2	16	18	632	6	134	1	1	7	301	20	4686	5	985	Sonoma
North Valley	6	643	5	319	18	1354	1	61	4	2068	24	4452	3	157	North Valley
Sacramento	8	314	7	591	17	717	2	225	8	1800	14	2049	6	65	Sacramento
Sierra	2	59	3	1234	7	205	3	216	3	39	13	2736	5	251	Sierra
North Bay	2	159	18	1628	2	186	1	149	1	1	17	8719	3	211	North Bay
San Francisco	1	7	3	450	0	0	0	0	1	50	2	1280	1	44	San Francisco
East Bay	2	92	2	613	2	87	0	0	2	2553	12	7053	4	255	East Bay
Diablo	1	8	5	2898	4	376	3	725	2	219	2	1782	1	18	Diablo
Peninsula	5	804	5	337	3	17	7	3227	1	4598	6	1814	3	62	Peninsula
Mission	1	2769	5	757	3	79	0	0	4	282	2	4451	1	10	Mission
DeAnza	3	38	5	491	5	1856	1	145	1	8	7	1694	2	2428	DeAnza
San Jose	1	6	3	3690	2	667	5	167	2	19	5	4304	3	57	San Jose
Central Coast	3	95	6	165	9	217	8	5312	2	51	22	10725	3	912	Central Coast
Los Padres	3	219	5	29	4	262	4	50	3	13	8	1107	8	218	Los Padres
Stockton	6	255	4	247	4	658	4	483	5	276	16	3859	2	143	Stockton
Yosemite	6	136	4	99	9	119	8	660	5	9	8	442	11	2556	Yosemite
Fresno	6	274	5	69	5	207	9	93	3	23	12	526	8	4463	Fresno
Kern	7	15	7	19	1	1	4	4	2	2	11	385	7	4682	Kern
TOTAL	74	7951	147	18317	110	7214	69	12193	62	12401	246	67397	86	17693	TOTAL

DSO SOPP FORECAST


(Forecast numbers extracted from the previous day's forecast)

ATS - Meteorology Services	Mon - 3/26/12		Tue - 3/27/12		Wed - 3/28/12		Thu - 3/29/12		Fri - 3/30/12		Sat - 3/31/12		Sun - 4/1/12		
	SO	CESO	SO	CESO	SO	CESO	SO	CESO	SO	CESO	SO	CESO	SO	CESO	
Humboldt	10	1500	23	3400	7	800	8	1200	12	1800	37	5500	4	500	Humboldt
Sonoma	4	600	15	2900	5	800	4	600	4	600	16	3100	5	800	Sonoma
N. Valley	6	500	15	2900	7	600	6	500	6	500	21	4000	5	500	N. Valley
Sac	4	400	8	1700	5	500	4	400	4	400	8	1700	3	300	Sac
Sierra	6	700	15	3400	8	1000	6	700	7	800	23	5200	5	600	Sierra
North Bay	4	800	11	3200	4	800	4	800	4	800	11	3200	3	600	North Bay
San Fran	1	600	2	1100	1	600	1	600	1	600	3	1700	1	600	San Fran
East Bay	1	600	5	2800	2	1100	1	600	1	600	6	3400	1	600	East Bay
Diablo	3	900	8	2800	3	900	3	900	3	900	8	2800	3	900	Diablo
Peninsula	2	600	6	3100	3	800	2	600	2	600	9	4600	3	800	Peninsula
Mission	2	700	3	1100	3	1100	2	700	2	700	5	1500	2	700	Mission
DeAnza	2	500	3	700	3	700	2	500	2	500	11	2900	3	700	DeAnza
San Jose	2	600	4	1200	3	900	2	600	2	600	7	2500	3	900	San Jose
Cent. Coast	5	900	8	1400	8	1400	6	1000	6	1000	11	2900	6	1000	Cent. Coast
Los Padres	4	600	4	600	4	600	4	600	4	600	5	800	5	800	Los Padres
Stockton	5	800	5	800	5	800	5	800	5	800	10	2700	6	1000	Stockton
Yosemite	6	700	6	700	6	700	6	700	6	700	9	1500	8	900	Yosemite
Fresno	8	1100	8	1100	8	1100	8	1100	8	1100	9	1200	10	1300	Fresno
Kern	3	400	3	400	3	400	3	400	3	400	3	400	4	600	Kern
TOTAL	78	13500	152	35300	88	15600	77	13300	82	14000	212	51600	80	14100	TOTAL



DSO SOPP Model Error History

- New categories were defined in Fall 2011, adjusted January 2012
- Increased sensitivity in DSO SOPP Model to smaller storms
- Drop in the relative error in recent months

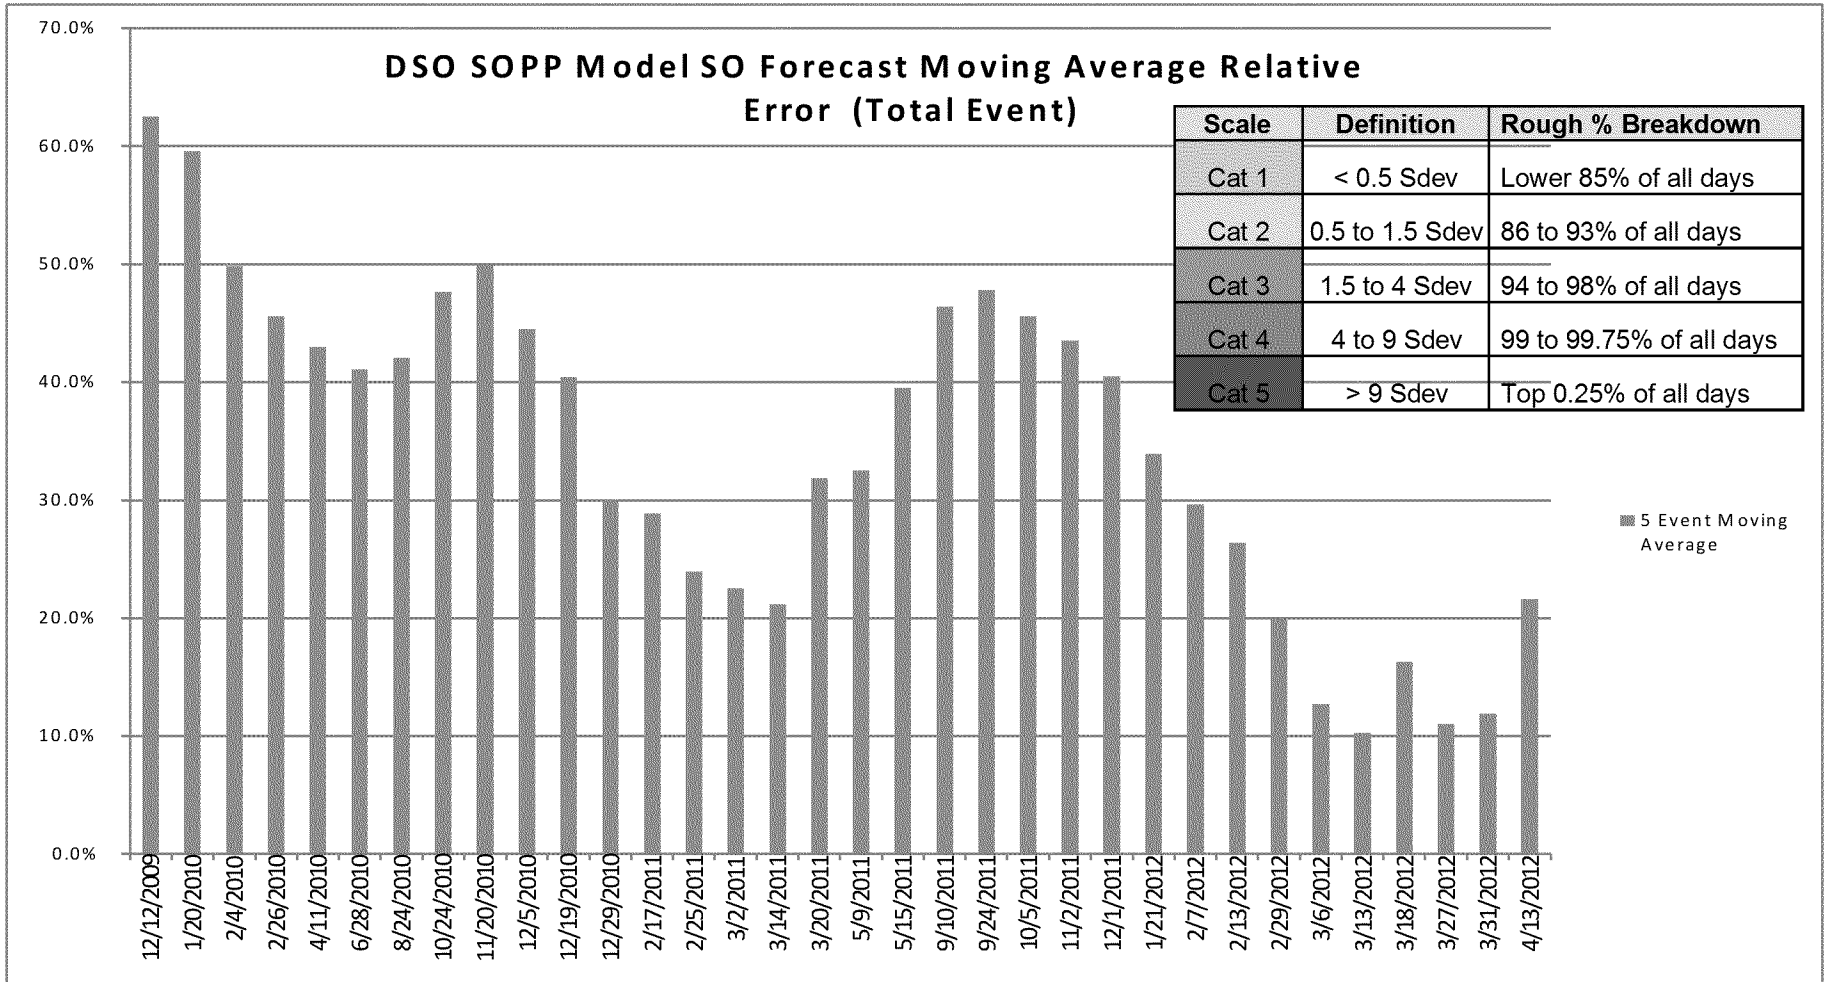



DSO SOPP Intangibles

The indirect and less quantifiable benefits besides more efficient restoration

The SOPP methodology, databases, and expertise has enabled:

- Better situational awareness prior to and during weather events – meteorologist takes on valuable role in the Plans Section in the Technical Specialist role
- Vastly improved understanding of weather risk to the system
- What is really causing outages and where
- Better understanding of cost drivers for different kinds of storms
- New understanding of the relationships between weather (trends) and reliability (trends) scores (much more than just the obvious fact that weather negatively impacts reliability)

Pre-Event





Pre-Event Checklist

Based on supporting execution of the Electric Operations Emergency Operations Plan

- **96 hour-** is to be used when the SOPP model is forecasting escalated outage levels in approximately 96 hours out. The overall objective is to begin raising awareness with the Emergency Management Organization (EMO) and to begin the necessary planning activities.
- **48-72 hour-** Similar to the 96+ hours checklist, this checklist begins the transition from initial planning activities to tactical readiness. The objective of this checklist is to begin finalizing key strategies, messages, and readiness.
- **24 hour-** This checklist is generally focused on tactical readiness. The objective of this checklist is to validate that the line item approvals are still appropriate based on the latest SOPP output. It is also set up to begin tactical activities such as messaging, where possible.



Pre Staging Resources

Pre staging is done based on SOPP model outputs

- Field resource movements across the service territory
- Standby awaiting outage activity

Resources are staggered based on response role

- Troublemens and Operators on shift with additional resources reporting just prior to peak weather activity
- 911 Standby resources
- Crew and estimating resources staggered to capture efficiency

Contractor resources included in pre-staging based on forecasted weather impact



Resource Staffing Plan

- Command and General Staff positions filled at all emergency room levels
- Staffing plans are updated weekly and used to populate the Incident Action Plan
- Incident Management Teams utilized to support headquarters with large outage volume
- Field Resources staffed to SOPP model outputs

Oncall Schedule for 09/21/2012 - 09/27/2012

EMO Northern Region						
REC	Humboldt	North Valley	Sacramento	Sierra	Sonoma	Incident Management
Incident Command Anthony Aker 530-328-9186 Tom Elder 530-410-5056	Incident Command Cynthia King-Palix 707-498-4171 Richard Tomble 707-799-3981	Incident Command Dan Hangan 530-698-4735 Brook Boyce 530-736-5647	Incident Command Eric Rubio 530-696-3304 Trevor Henneman 209-479-4176	Incident Command Marty Sunde 707-915-9244 Eric Marlock 415-517-4541	Incident Command Allen Thorburn 707-322-8080 Ron Richardson 415-342-9160	
Customer Strategy Dale Schmidt 530-608-6119 Kris Heinrich 916-956-3476	Customer Strategy Robert Chern 707-498-1887 Neil Manoff 707-498-4920	Customer Strategy Denise Lee 530-432-2020 Deann Maranghi 530-701-2062	Customer Strategy Derek Bond 530-610-9156 Keith Smith 916-295-2985	Customer Strategy Dale Bond 530-610-9156 Karin Smith 916-295-2985	Customer Strategy	
P&I Erik Shaw 530-626-7087 Brian Sweeney 916-605-6247	P&I Celine Holsten 707-637-8888 David Wyle 707-606-4559	P&I Loreta Weber 530-520-2176 Brian Agnew 530-410-7065	P&I Denise Abayekona 530-667-1673 Ontario Johnson 916-619-4416	P&I Denise Leggs 916-610-1157	P&I Laura Aker 707-322-8080	
Logistics Joseph Manoff 530-401-0801 Lynn Forette 916-402-6327	Logistics Sharon Meard 707-498-0118	Logistics Liz Bravins 530-410-6472	Logistics Darryl Williams 530-648-1097	Logistics Joseph Abner 530-322-7071 Marty Hepper 530-226-4002	Logistics Denise Meard 707-322-8080	

Pre-Planning Available Resources

Reported time

	Repair Crews (T-200 & T-300)											
	Thurs			Fri			Sat			Sun		
	Crews on shift	Pre-arranged or held over	212 Call-out	Crews on shift	Pre-arranged or held over	212 Call-out	Crews on shift	Pre-arranged or held over	212 Call-out	Crews on shift	Pre-arranged or held over	212 Call-out
Northern (NF)	3	0	15	3	0	5	0	0	5	0	0	5
Humboldt	0	0	12	0	0	5	0	0	5	0	0	5
Sonoma	3	0	3	3	0	0	0	0	0	0	0	0
North Valley												
Sacramento												
Sierra												
Bay Area (BA)	22	4	11	22	4	12	3	5	9	2	4	9
North Bay	10	4	4	10	4	4	1	1	1	0	0	1
San Francisco	7	0	2	7	0	2	0	0	2	0	0	1
East Bay	3	0	1	3	0	1	0	0	1	0	0	1
Diablo	2	4	4	2	4	5	2	4	5	2	4	4
Central Coast (CC)	22	4	8	19	5	11	1	4	10	1	2	10
Peninsula												
Mission												
De Anza	3/3man	1/4man late	3/3man	3/3man	1/3man late	3/3man	1	1	3/3man	1	1	3/3man
San Jose	3	0	6	3	0	6	0	1	5	0	0	5
Central Coast												
Los Padres	14	4	2	11	4	2	0	2	2	0	1	2
Central Valles (CV)	24	11	20	23	18	18	5	16	15	0	14	17
Stockton	11	4	10	4	4	5	2	3	5	0	3	5
Yosemite	0	3	5	0	4	5	0	3	5	0	3	5
Fresno	13	6	6	12	8	8	2	6	6	0	6	8
Kern	2	5	2	2	6	1	2	4	4	0	3	4
Total	71	19	54	67	27	46	9	25	39	3	20	41

During Event





Overall Strategy

Make Safe: Field personnel act to address hazardous conditions to ensure public and employee safety.

Assess: Field personnel assess the outage location to:

- identify the outage cause
- determine the necessary (material, equipment, personnel)
- estimate the time necessary to make repairs.

Communicate: Field personnel and system operators work together to provide customers and public agencies with information: such as the cause of an outage and estimated time of restoration.

Restore: After making the condition safe, assessing the situation and beginning the communication process, field personnel and system operators work together to restore service



Prioritization Guidelines

Electric System

- Control area interconnections
- Generation
- Transmission
- Substation
- Distribution
- Customer level

Special Considerations

- Essential and Critical Customers (e. g., life support, hospitals, water, sewage, schools)
- Make Safe and Wire Down Situations
- Extended Duration Outages

Close coordination is required with local and state governments



Tactics Call

Audience: Emergency Management Organization

EOC Command and General Staff, Region Directors, Division Superintendents and their respective command and general staff support

Objective: Organization leaders to set preliminary expectations for emergency centers, Incident Action Plan forms, and pre-staging requirements

Facilitated by the Planning Section Chief

Agenda:

- Safety -- Key Safety Topics and Safety Incident Report Out (Safety Officer)
- Weather -- (Meteorology)
- Operations Update
- Restoration Update
- Resourcing Plan
- Closing Comments

Resource and ETOR Strategy

SOPP model

DSO SOPP Model Forecast

Issued: Thursday, January 12, 2012 16:39


Transformer Level Outages and Above

Cat	Staffing				Qualitative Weather			
	SO	CEO	TM	CR	SO	CEO	TM	CR
Cat 1	Normal				Normal			Adverse weather unlikely
Cat 2	Normal, but have a plan				Normal			Adverse weather possible
Cat 3	Starting & Timing as Directed				Starting & Timing as Directed			Adverse weather likely
Cat 4	Staff to Model, Timing as Directed				Staff to Model, Timing as Directed			Extreme weather possible
Cat 5	Staff to Model, Timing as Directed				Staff to Model, Timing as Directed			Extreme weather likely

Outages by Division	Thursday 1/12/2012				Friday 1/13/2012				Saturday 1/14/2012				Sunday 1/15/2012			
	SO	CEO	TM	CR	SO	CEO	TM	CR	SO	CEO	TM	CR	SO	CEO	TM	CR
Northern Humboldt Region	7	800	0	3	19	2600	11	10	3	300	3	2	3	300	3	2
Region Sonoma N. Valley	7	1300	2	4	24	4600	11	16	4	500	3	2	4	600	3	2
Sac	16	3100	11	10	26	5000	15	13	5	500	4	3	5	500	4	3
Sierra	18	3200	9	8	23	4600	7	8	2	200	2	1	2	200	2	1
Bay North Bay Area	8	4000	6	6	36	8100	14	12	5	600	3	2	5	600	3	2
San Fran	8	1100	5	4	53	10000	10	10	2	400	2	1	2	400	2	1
East Bay	4	2500	2	2	11	6000	5	4	1	600	2	1	1	600	2	1
Diablo	4	2300	3	2	6	3400	4	3	1	600	2	1	1	600	2	1
Central Peninsula	0	2100	4	3	7	2500	4	3	2	600	2	1	2	600	2	1
Coast Mission	8	4100	5	4	8	4100	6	4	3	600	3	2	2	600	2	1
DeAnza	7	2100	4	3	6	1800	4	3	2	700	2	1	2	700	2	1
San Jose	3	700	3	2	8	2400	6	5	2	500	2	1	2	500	2	1
Cent. Coast	4	1200	3	2	10	3000	6	5	2	600	3	1	2	600	2	1
Los Padres	3	1400	6	5	40	10600	10	14	4	700	3	2	4	700	3	2
Stockton	8	1600	6	4	34	3800	12	8	3	500	3	2	3	500	3	2
Yosemite	5	2400	5	4	34	3900	9	8	3	500	2	1	3	500	2	1
Fresno	10	1200	5	4	30	3000	8	7	4	400	3	2	4	400	3	2
Kern	3	1800	5	4	24	4800	6	5	3	400	2	1	3	400	2	1
PG&E TOTAL	101	38600	101	82	419	103600	168	140	57	10300	49	33	50	10100	48	29


Notes: SO = Sustained Outages, CEO = Customers Experiencing Sustained Outages, TM = Troublen, CR = Cr

Restoration Work Plan

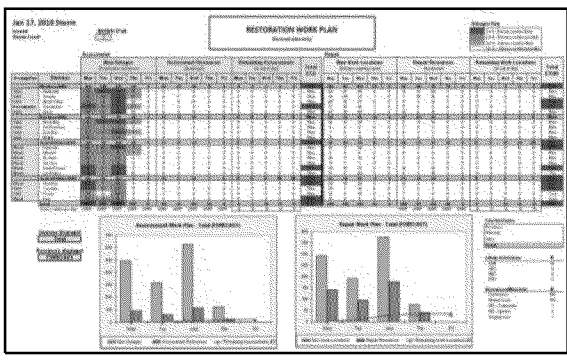


- Improving our ability to estimate infrastructure damage will:
 - improve our ability to provide timely and accurate outage information
 - expedite the outage restoration effort

Resource Transfer Strategy

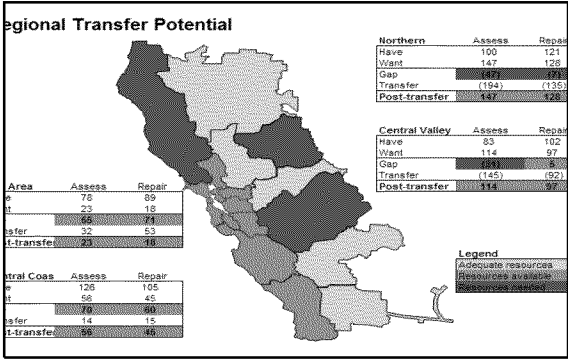


Scenario Analysis

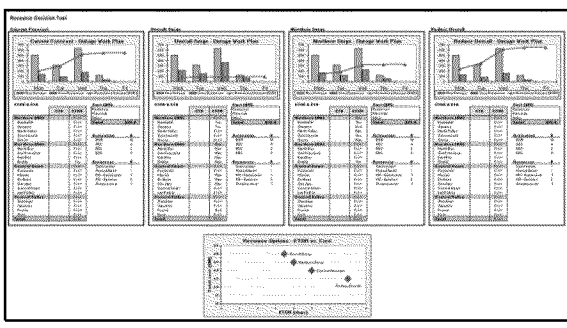

Resource and ETOR Strategy

Restoration Work Plan

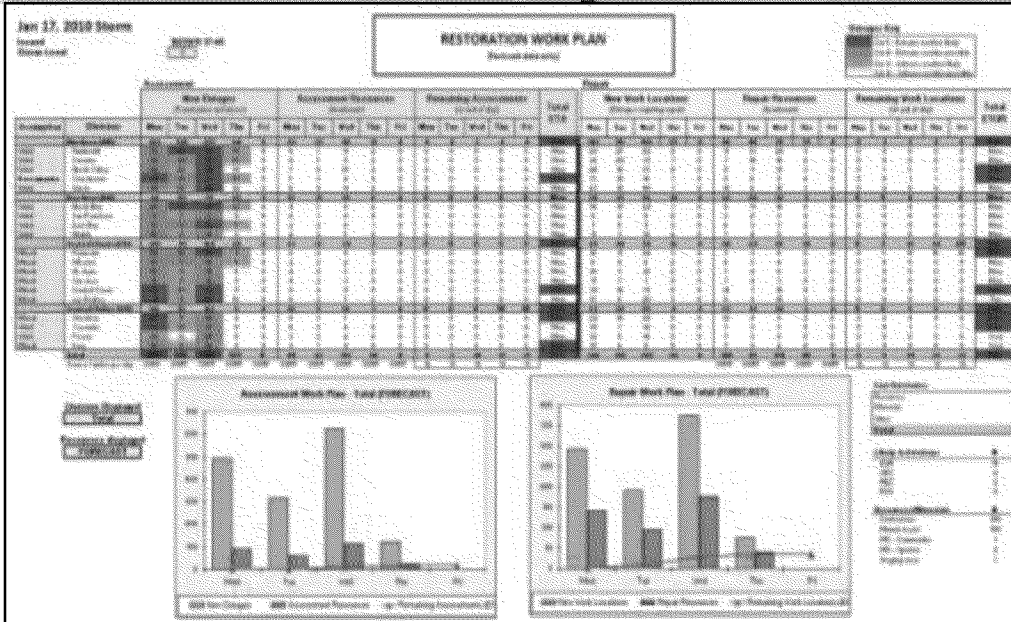

Inputs

- Weather
- Outage forecasts and real time outages
- Available resources
- Assessment and Restoration Rates

Outputs

- Assessment Times
- Restoration Times
- Event ETOR

Resource and Estimated Time of Restoration (ETOR) Strategy

Resource Transfer Strategy



Scenario Analysis

Scenario Analysis

- Allows us to determine resource movement strategy to meet operational objectives

Resource Transfer Strategy

- Takes input from scenario analysis and visually represents resource picture
- Identifies gaps in staffing levels.

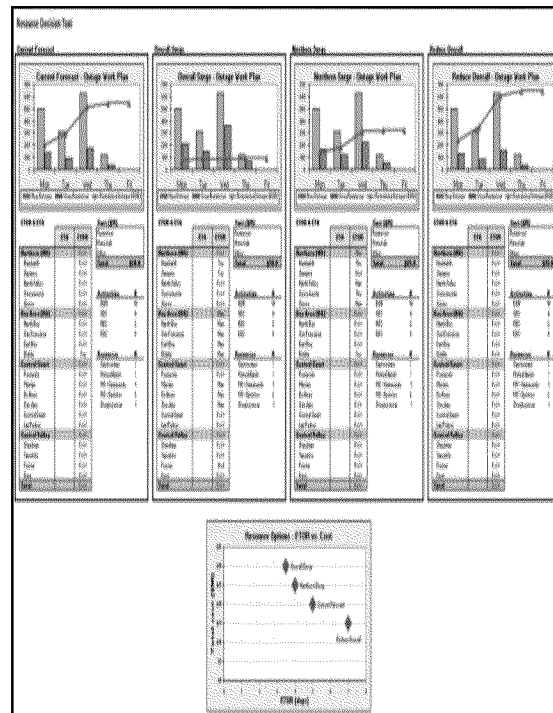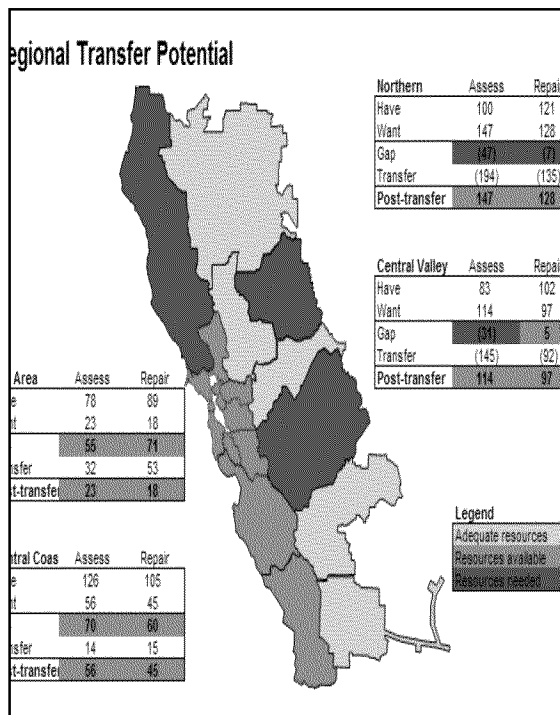



Mutual Aid

Triggers for Mutual Assistance

Prior to and continuously through out an event, the EOC Director shall begin the process of evaluating and documenting the need for mutual assistance. The EOC Director will recommend the need for mutual assistance to the SVP of EDO when existing resources are determined to be inadequate. Conditions triggering this determination include, but are not limited to:

- All PG&E resources have or will be committed.
- Service restoration cannot be completed within 48 hours.
- It is the opinion of the EOC Director that additional resources will significantly reduce the time needed to complete restoration.
- Mobilization and travel time of Mutual Assistance Crews.

Mutual Aid requests are prioritized to the closest available utilities



Smart Meter

Restoration Validation

- Restoration Validation enables users to ping the SmartMeters of Single Customer outages to determine if power has been restored

Manual Scoping

- Operators have the ability to ping meters to determine if additional customers are also out.


Probable Inferred Location

- Identification of potential nested outages using the analysis of customer calls and the AMI (Advanced Metering Infrastructure) outage alarms

Outage Communication Map

Other Outreach Tactics:

- Door to Door
- Town Hall Meetings
- Extended Outage Outbound Calls
- Government and State Interactions
- Social Media
 - Twitter
 - Facebook
 - Currents

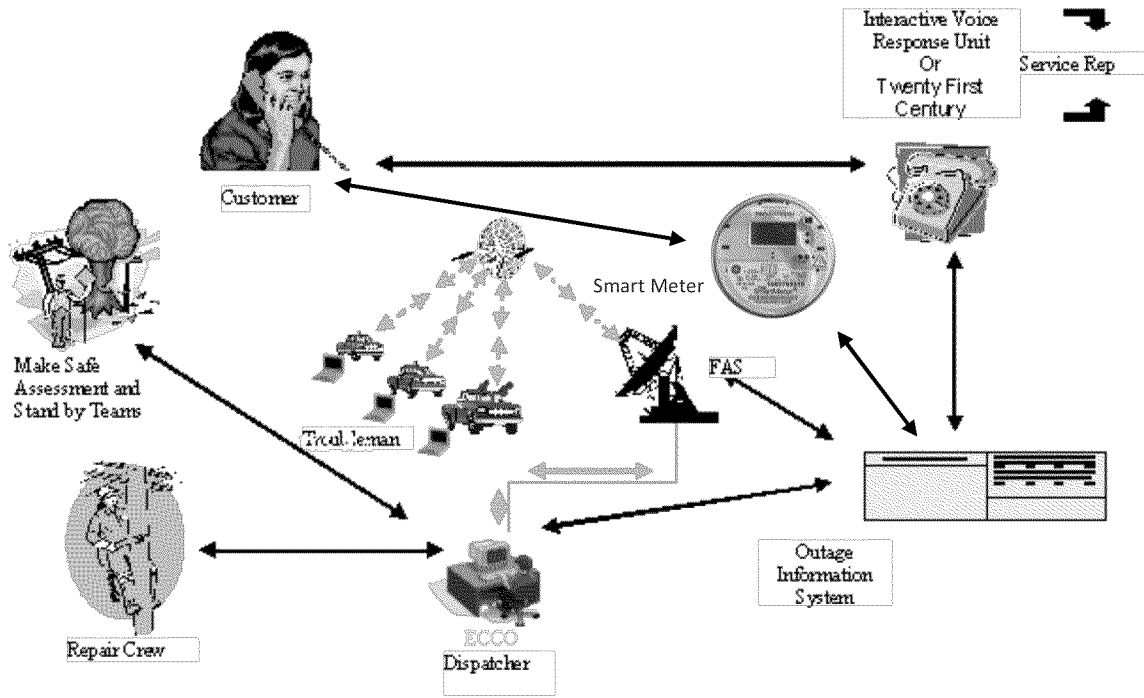


911 Standby Process




911 Emergency Response



- High profile events
- Coordination and prompt response supports public safety
- Public agencies can then respond to other public safety concerns

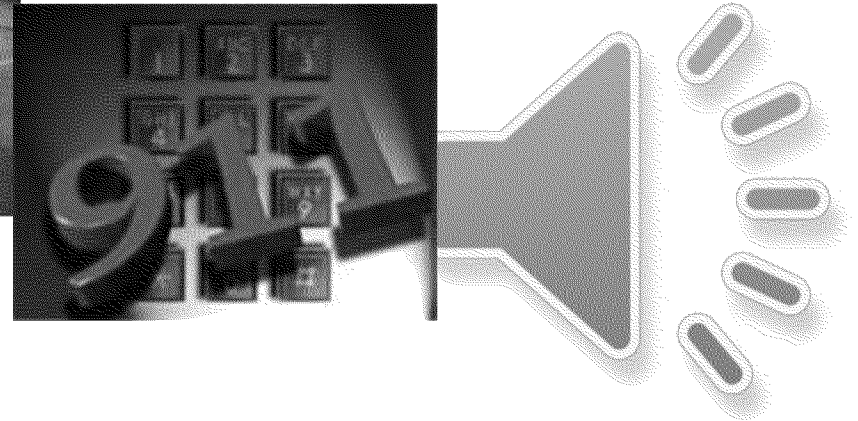


Improving Performance

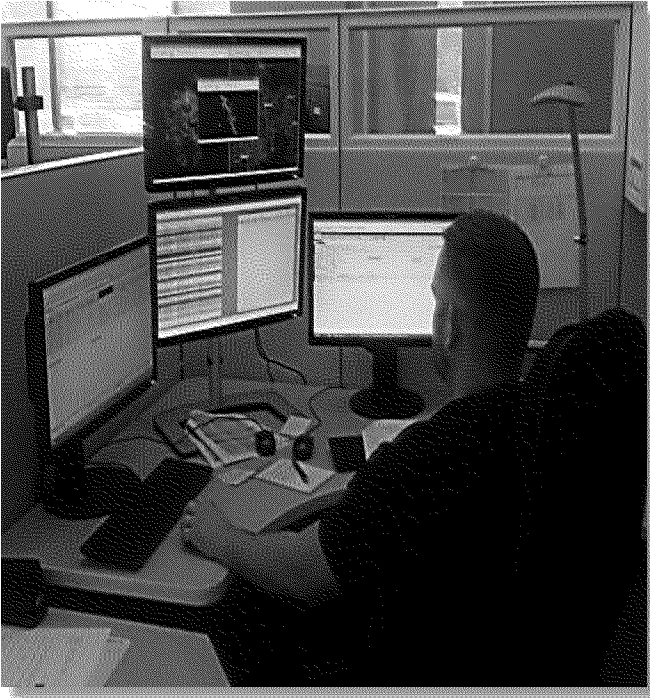

- Organizational focus has driven improved performance
- Daily metric on Daily Reliability Scorecard
- Weekly reviews on daily status calls and with local teams


Process Capability

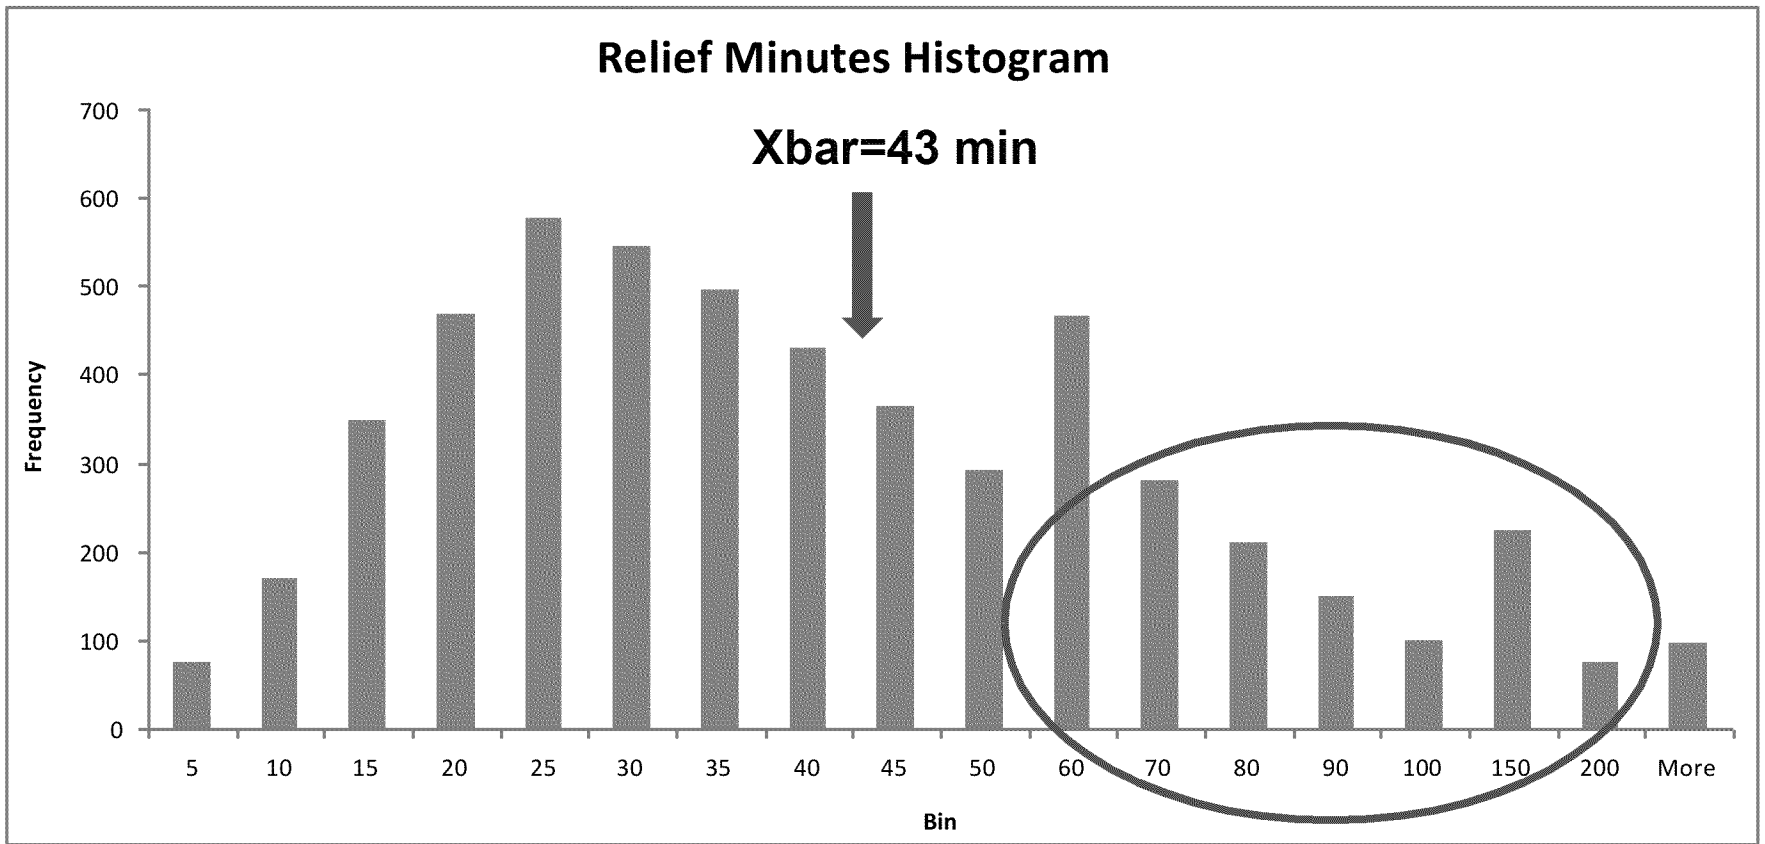

2012 end of year performance 84.09%

Improving Response Performance During Storm Events


Resource Deployment

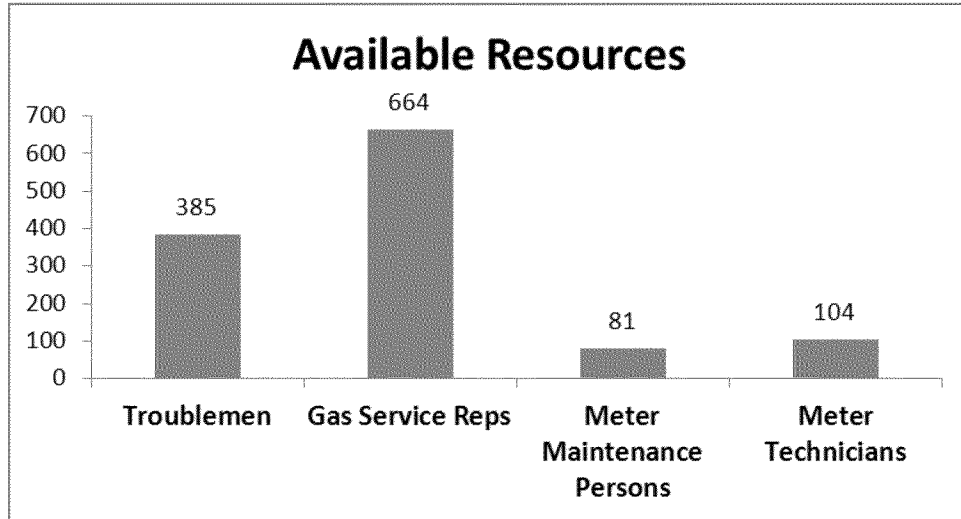

- SOPP Forecast represents expected number of calls for each division
- Use of non-traditional resources (e.g., meter techs, GSRs) is critical during significant events\

Storm Response Performance within 1 hour

2011 **40%** 2012 **80%**

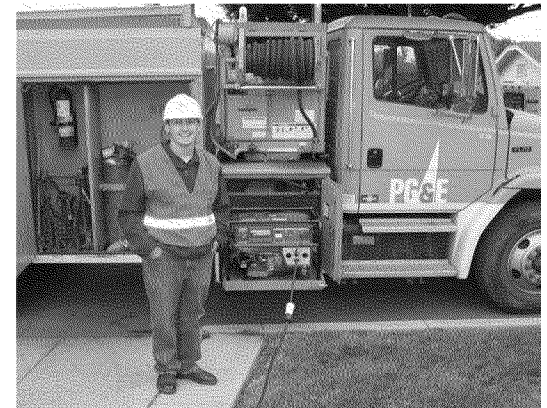

Public Agencies As Partners



- Training
- Pre-event Process Coordination
- Joint Exercises
- Joint Stakeholder 911 Committee
- Participation in PG&E exercises

Joint Response Plans and Exercises

PG&E has dedicated Public Safety Personnel to support training and exercise development

- Development of joint response plans based on identification of joint risk
- Utilization of Unified Command
- Joint exercise of developed response plans





Adoption of Public Sector Best Practices

- **ICS and NIMS**
 - Command and General Staff ICS 100-400
 - Utilization of a written Incident Action Plan (IAP) including prioritization of goals and establishment of objectives
- **Homeland Security Exercise and Evaluation Program (HSEEP)**
 - All Emergency Preparedness personnel HSEEP certified
 - Application of the building block approach for training and exercises
 - Utilization of capabilities to drive development of exercise scenarios, supporting documents (Sit Mans, Ex Plans), and Exercise Evaluation Guides
- **Formalized corrective action and improvement program**

Fire Prevention Plan





Fire Prevention Plan

- Pre-planning Activities
 - Public Outreach
 - Fire and Weather Intelligence
- Threat Mitigation
 - Vegetation Management
 - Patrols and Inspections
 - Operational Precautions during high risk periods
- Proactive Responses to Fire Incidents
 - Fire suppression support
 - Pole treatment and ground cover mastication
- Post Incident Recovery
 - Thorough event critiques
 - Joint agency debrief sessions
- An addendum which identifies the specific CPUC requirements for Santa Barbara County with which PG&E should comply.

Fire Weather Forecasts

- Daily fire weather forecasts (8 AM DSO call)
- Weekly fire weather summary forecast
- Alert organization of current and future fire weather conditions, and provide awareness of critical fire weather conditions
- Spot forecasts for active wildfires which threaten PG&E assets



Weekly Fire Weather Forecast 8/10/2012 – 8/17/2012

A strong ridge of high pressure is extending westward from the four corner regions over the Service Area and will dominate weather conditions through the weekend into early next week. Very hot temperatures are forecast across the interior valleys today and through the weekend with the warmest locations likely to exceed 105 degrees. During the afternoon hours today and through the weekend, relative humidities will drop to critical single digit values across the north creating conditions conducive for fire ignitions, extreme fire behavior and growth. Winds are expected to be light to moderate during this time frame with maximum gusts near 25 mph.



Distribution Maintenance

- Performed additional annual enhanced patrols
 - Focus on facilities that can be a source of ignition and are near flammable vegetation- Completed by March 31st
- Maintenance identified by enhanced patrols rated as high priority and must be replaced or repaired by 7/31
- Performed overhead infrared inspections on all overhead line segments in the Urban Wildfire Areas by 6/30
- Vegetation contractor clears all Local Responsibility Area (LRA) locations in the Urban Wildfire (UWF) that have non-exempt equipment
- Proactive on non-exempt equipment in UWF area begins in 2012



Routine T&D Vegetation Management Program Scope

Annual ground inspection of every mile (100%) of overhead line. Address through trim or removal, any tree that will encroach within minimum clearance distances and any hazard tree to maintain regulatory compliance.

- 113,000 miles of distribution line
- 19,500 miles of transmission line
- 70,000 square mile service territory
- Prune or remove ~2,000,000 trees annually

5M trees in inventory with potential to “grow into” powerline

50M trees with potential to “fall into” powerline

Maintain fire breaks on 120,000 subject poles/towers


Maintain transmission right of way

625 contract tree crews and 350 utility arborists/foresters

Fire Season Preparedness

- Reinforced S-1464, Fire Danger Precautions in Hazardous Fire Areas with organization
 - Prohibits or limits certain maintenance activities (i. e., blasting, welding, open burning) in “very high” or “extreme” areas
 - Limits electric operations circuit testing
- Daily tailboard of fire weather forecast and fire index

Control Centers	Divisions	Regions	Fire Areas	Contact																																						
Fire Adjective Index																																										
Fire Adjective Index for Friday, June 15, 2012 Updated by LMG8 on 6/15/12 @ 0007																																										
<ul style="list-style-type: none"> System-wide Fire Index by Region Area Map (PDF) GIS Map of Fire Indexes and Active Fires GIS Map of Fire Indexes, Active Fires, and Lightning GIS Map Gallery Old Fire Link 		<ul style="list-style-type: none"> Service Area Temperature Forecasts NWS California Fire Weather Risk PG&E Meteorology Services City/County Lookout Tables (Excel spreadsheet) 																																								
Very High Fire Index Areas (Cities and Counties) <table border="1"> <thead> <tr> <th>CITY/COUNTY</th> <th>CITIES IN THIS FIRE AREA</th> </tr> </thead> <tbody> <tr><td>430 MADERA</td><td>Daulton, Indian Springs, Katoctles, Knowles Junction, Raymond</td></tr> <tr><td>430 MARIPOSA</td><td>Ben Hur, Granite Springs, Hayward, Hermitos, Indian Gulch</td></tr> <tr><td>430 MERCED</td><td>Le Grand, Merced Falls, Planada, Snelling</td></tr> <tr><td>430 TUOLUMNE</td><td>Blanchard</td></tr> <tr><td>437 MONTEREY</td><td>Panorama</td></tr> <tr><td>438 KERN</td><td>Unknown</td></tr> <tr><td>438 SAN LUIS OBISPO</td><td>Unknown</td></tr> <tr><td>439 SAN MATEO</td><td>La Honda, Redwood Terrace</td></tr> <tr><td>520 SANTA CLARA</td><td>Aldercroft Heights, Chemeleta Park, Holy City, Redwood Estates, Sireadal</td></tr> <tr><td>420 SANTA CRUZ</td><td>(Big Basin Post Office), Ben Lomond, Boreas Dook, Boulder Creek, Bracches, Broadvale, Felton, Forest Springs, Glen Arbor, Glenwood, Johnston Corner, Laurel, Lompoc, Mission Springs, Olympia, Redwood Grove, Riverside Grove, San Lorenzo Park, Woodward, Zayante</td></tr> <tr><td>430 MONTEREY</td><td>Valleton</td></tr> <tr><td>430 SAN LUIS OBISPO</td><td>Shandon, Whitley Gardens, Wilson Corner, California Valley, La Panza, Martinez Place, Simmer</td></tr> </tbody> </table>		CITY/COUNTY	CITIES IN THIS FIRE AREA	430 MADERA	Daulton, Indian Springs, Katoctles, Knowles Junction, Raymond	430 MARIPOSA	Ben Hur, Granite Springs, Hayward, Hermitos, Indian Gulch	430 MERCED	Le Grand, Merced Falls, Planada, Snelling	430 TUOLUMNE	Blanchard	437 MONTEREY	Panorama	438 KERN	Unknown	438 SAN LUIS OBISPO	Unknown	439 SAN MATEO	La Honda, Redwood Terrace	520 SANTA CLARA	Aldercroft Heights, Chemeleta Park, Holy City, Redwood Estates, Sireadal	420 SANTA CRUZ	(Big Basin Post Office), Ben Lomond, Boreas Dook, Boulder Creek, Bracches, Broadvale, Felton, Forest Springs, Glen Arbor, Glenwood, Johnston Corner, Laurel, Lompoc, Mission Springs, Olympia, Redwood Grove, Riverside Grove, San Lorenzo Park, Woodward, Zayante	430 MONTEREY	Valleton	430 SAN LUIS OBISPO	Shandon, Whitley Gardens, Wilson Corner, California Valley, La Panza, Martinez Place, Simmer	Extreme Fire Index Areas (Cities and Counties) <table border="1"> <tbody> <tr><td>245 COLUSA</td><td>Stonyford</td></tr> <tr><td>245 GLENN</td><td>Chrome, Elk Creek, Newville</td></tr> <tr><td>245 SHASTA</td><td>Beegum, Ohio</td></tr> <tr><td>245 TEHAMA</td><td>Cold Fork, Lowrey, Parkersburg, Red Bank, Rosewood</td></tr> <tr><td>245 ALAMEDA</td><td>Livermore, Treveno, Umar</td></tr> <tr><td>245 CONTRA COSTA</td><td>Alamo, Alamo Oaks, Clayton, Concord, Cowell, Danville, Diablo, Four Corners, Mur, Pacheco, Tassajara</td></tr> </tbody> </table>			245 COLUSA	Stonyford	245 GLENN	Chrome, Elk Creek, Newville	245 SHASTA	Beegum, Ohio	245 TEHAMA	Cold Fork, Lowrey, Parkersburg, Red Bank, Rosewood	245 ALAMEDA	Livermore, Treveno, Umar	245 CONTRA COSTA	Alamo, Alamo Oaks, Clayton, Concord, Cowell, Danville, Diablo, Four Corners, Mur, Pacheco, Tassajara
CITY/COUNTY	CITIES IN THIS FIRE AREA																																									
430 MADERA	Daulton, Indian Springs, Katoctles, Knowles Junction, Raymond																																									
430 MARIPOSA	Ben Hur, Granite Springs, Hayward, Hermitos, Indian Gulch																																									
430 MERCED	Le Grand, Merced Falls, Planada, Snelling																																									
430 TUOLUMNE	Blanchard																																									
437 MONTEREY	Panorama																																									
438 KERN	Unknown																																									
438 SAN LUIS OBISPO	Unknown																																									
439 SAN MATEO	La Honda, Redwood Terrace																																									
520 SANTA CLARA	Aldercroft Heights, Chemeleta Park, Holy City, Redwood Estates, Sireadal																																									
420 SANTA CRUZ	(Big Basin Post Office), Ben Lomond, Boreas Dook, Boulder Creek, Bracches, Broadvale, Felton, Forest Springs, Glen Arbor, Glenwood, Johnston Corner, Laurel, Lompoc, Mission Springs, Olympia, Redwood Grove, Riverside Grove, San Lorenzo Park, Woodward, Zayante																																									
430 MONTEREY	Valleton																																									
430 SAN LUIS OBISPO	Shandon, Whitley Gardens, Wilson Corner, California Valley, La Panza, Martinez Place, Simmer																																									
245 COLUSA	Stonyford																																									
245 GLENN	Chrome, Elk Creek, Newville																																									
245 SHASTA	Beegum, Ohio																																									
245 TEHAMA	Cold Fork, Lowrey, Parkersburg, Red Bank, Rosewood																																									
245 ALAMEDA	Livermore, Treveno, Umar																																									
245 CONTRA COSTA	Alamo, Alamo Oaks, Clayton, Concord, Cowell, Danville, Diablo, Four Corners, Mur, Pacheco, Tassajara																																									
Very High and Extreme Fire Danger hours: 09:00 AM to two hours after sunset (local time)																																										

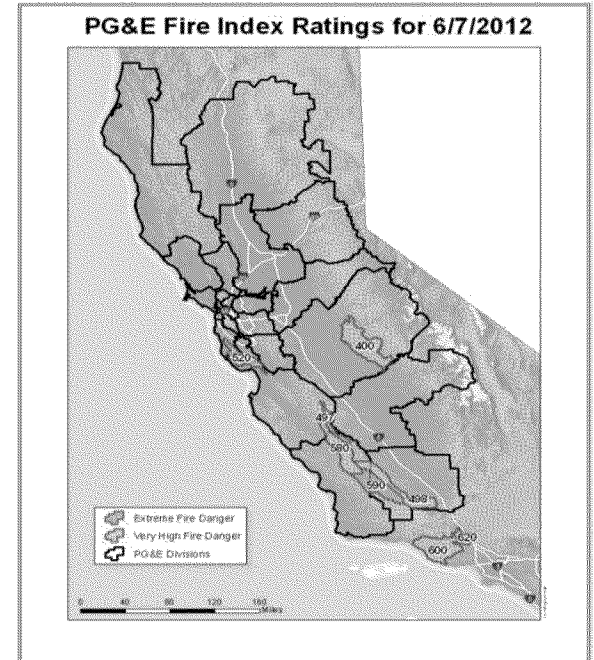


- Conducting spring table top exercises for gas and electric
 - ICS response structures and scenarios
 - Table top Exercises focused on ICS coordination, heat events and wildland fire response



Wildland Fire Lessons Learned

- PG&E's proactive initial response support has been invaluable in supporting responder and public safety and effective response strategy
- PG&E presence at the ICP has provided enhanced information and intelligence to the Command Team and other Cooperating Agencies and supports the execution of the incident objectives
- GIS maps and MCV support has been identified by responders as proof of PG&E's commitment to public safety and community recovery
- PG&E's implementation of ICS has provided a more coordinated response across the enterprise and has resulted in the development of sustainable relationships within PG&E and with the agencies.
- Cell communications not reliable in all areas resulting in the addition of satellite communications to the Sprinter fleet- Sept 2012
- Multiple technology issues including: router and network
- Increase of 2 additional Emergency Communications Trailers (ECT) units Q1 2013

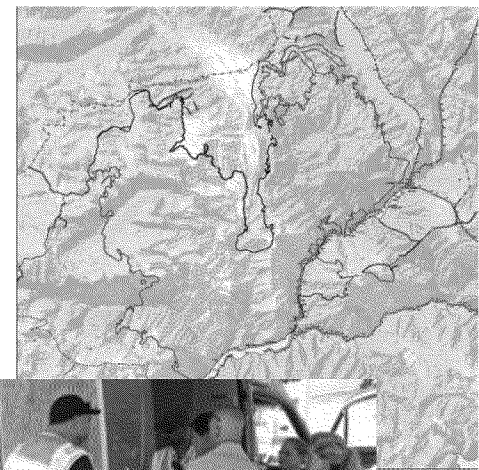

Questions



In Summary

- We want you to be informed on PG&E Capabilities
- We want to strengthen working relationship and partnerships!
- PG&E is here to support you!
- You will be receiving a Survey from PG&E within 10 days – for your Comments and Input



If you have additional questions or comments:

Redacted



Manager, Electric Operations Emergency Preparedness and Public Partnerships

Redacted

