

Redacted

Substation Incident

June 18, 2014





Redacted

Substation





What happened?

Redacted




What happened?

Redacted



What happened?

Damaged transformer

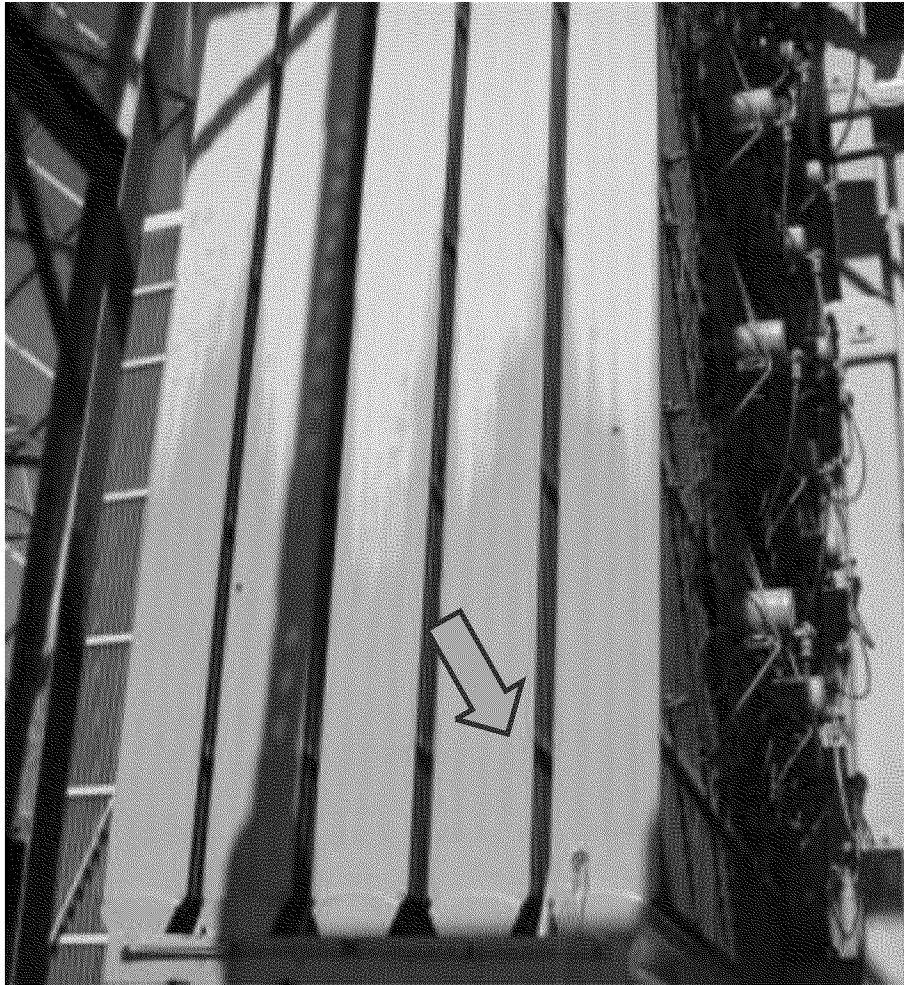

Repaired transformer





How did we immediately respond?

No customers lost service and there were no public or employee safety incidents as a result of this event

Operations:

Immediately activated company emergency response protocols, including establishing an incident command structure at [Redacted] substation

- Transferred customers from [Redacted] to other substations
- Evaluated potential system overloads
- Coordinated with the CAISO to increase local generation and alert customers about Flex Alert issued for local area
- Cancelled scheduled system work
- Worked with agencies to support cleanup efforts

Security:

- Coordinated and shared information with multiple law enforcement agencies
- Immediate on site security presence at multiple facilities
- Law enforcement conducted ground/air patrols of critical substations

Long term response:

- Evaluating and enhancing security at all critical facilities

Thank You

