



**CORROSION CONTROL OF GAS FACILITIES**

**O-16**

**Department:** Gas Distribution and Technical Services      **Section:** Gas Engineering and Planning  
**Approved by:** D. M. Kelly      **Date:** 11-13-00

**Rev. #06:** This document replaces Revision #05. For a description of the changes, see Page 9.

**Purpose and Scope**

This gas standard outlines PG&E's corrosion control program for all gas facilities including PG&E-owned gas gathering lines, gas transmission facilities and gas distribution facilities.

**Acronyms**

- AWG: American wire gauge
- CGT: California Gas Transmission (organization within PG&E)
- CPA: cathodic protection area
- CPUC: California Public Utilities Commission
- DC: direct current
- GSTS: Gas System Technical Support
- HMWPE: high molecular weight polyethylene
- HVAC: high voltage alternating current
- kV: kilovolts
- mA: milliamperes
- MSDS: material safety data sheet
- mV: millivolts
- NACE: National Association of Corrosion Engineers
- OM&C: Operations, Maintenance and Construction
- PCM: pipeline current mapper
- P/S: pipe-to-soil
- VAC: volts alternating current

**References**

**Document**

Glass-Epoxy Retainer Gaskets .....	Gas Standard B-45.1
Cast Iron to Steel Insulated Transition Couplings .....	Gas Standard B-91.4
Machine Application of Polyethylene Systems (3/4" – 48" Pipe) .....	Gas Standard E-24
Field Wrapping with Cold-applied Tape .....	Gas Standard E-25
Meter Valves .....	Gas Standard F-80
Electrolysis Test Station Connection to Main .....	Gas Standard O-10
Wire Splices .....	Gas Standard O-12
Galvanic Anodes: Installation and Purchasing Data .....	Gas Standard O-13.1
Flange Insulation .....	Gas Standard O-22
Leak Survey and Repair of Gas Transmission and Distribution Facilities ...	UO/CGT Standard S0350/S4110
CPA Assessment/Resurvey Procedures .....	UO Standard D-S0467
NACE .....	Standard RPO177

## Corrosion Control of Gas Facilities

---

### General Information

#### 1. Requirements for Protection

Install all new, reconditioned, converted or replaced buried metallic pipeline facilities with an approved coating and cathodically protect the facilities within one year after the installation date. This requirement applies to all gathering lines, transmission lines, distribution mains and services. This requirement also applies to PG&E-owned, buried, metallic gas house lines.

- A. Attachment A describes cathodic-protection guidelines for steel mains and services.
- B. Transmission and gathering line cathodic-protection requirements shall be determined either by testing or by investigating the historical current requirements. Galvanic anodes or rectifier stations shall be installed as required.
- C. Ensure the following coated equipment is cathodically protected: gathering lines, transmission lines, mains, services, PG&E-owned gas house lines, and other buried metallic gas facilities. Bare or poorly coated steel pipe shall not be cathodically protected.

#### 2. Designing and Installing Cathodic Protection Systems (CPAs)

Design CPAs according to the following guidelines.

- A. Use good judgment when engineering CPAs so they are not excessively large or small. Ideally, an area should contain no more than 50,000 square feet of steel pipe. This guideline may not be applicable to some existing systems or to long-line systems.
- B. Design and operate cathodic protection systems to ensure they do not significantly interfere with other underground metallic structures. Select rectifier sites which maintain a minimum distance of separation between the anode bed and any non-PG&E, underground metallic structures such as water lines, underground electric lines with bare neutral wires, metal-sheathed telephone or television cable, metal fence posts, electric ground rods and guy wire anchors and similar facilities. A minimum distance of separation is any distance, verifiable through testing, that does not register interference. Workers must maintain a minimum distance of separation between all anodes and protected gas mains or services to prevent coating damage. Document the results on the "Cathodic Protection Station Report" (Attachment C).
- C. To prevent coating damage, P/S on-potentials shall not exceed negative 1,600 mV on potential when measured with a copper-copper sulfate electrode anywhere on the protected structure. Consider voltage resistance (IR) drop in this measurement. Perform interference response testing or make engineering calculations on rectifier sites that cannot meet the requirements documented in this subheading 2C, as well as in locations where non-PG&E facilities may be affected. Notify non-PG&E facility owners of the new or proposed rectifier sites or of the possibility of increased current outputs. Arrange to conduct testing, if required. Testing should include interrupting the rectifier current and measuring the on and off P/S potentials on nearby non-PG&E facilities. Measure and record hard wire current flows, when necessary. Document the results using the "Interference Test Form" (Attachment E).
- D. For proposed sites, consider establishing temporary drains to measure potential influences and cathodic protection current necessary to protect the area.
- E. Insulating devices may be used in underground vaults. Take care to prevent possible electrical arcing. Use only approved flanges, gaskets and insulating sleeves for insulating purposes (as described in Gas Standard O-22 or Gas Standard B-45.1). Design the facility to prevent accidental contact or shorting across the insulating device (i.e., avoid using foil-backed sound insulation on vault lids; it could fall and contact the insulating device).
- F. It may be necessary to provide galvanic grounding or other protection:
  - (1) on pipelines which closely parallel HVAC electric transmission lines, and
  - (2) on pipelines where the anticipated or measured voltage between the pipeline and ground exceeds 15 VAC open circuit or has a source current capacity of 5 mA. For example, protect pipelines that parallel 230 kV or 500 kV HVAC circuits of appreciable distance (over one mile) and are within 1,000' of a HVAC conductor and any pipeline that parallels a HVAC circuit for any distance when the separation is small.

The need for special precautions is greater when electric loads are higher and when pipelines are well-coated and/or installed in high-resistance soil. These precautions apply to both pipelines under construction and pipelines operated under the conditions described in this section (paragraph 2F). See the NACE Standard RPO177 for additional guidelines or contact the CGT Corrosion Engineering Section.


## Corrosion Control of Gas Facilities

---

- G. Install wire test leads according to Gas Standard O-10 and at the following locations.
- (1) At new installation transmission/distribution pipeline areas.
  - (2) On both sides of buried, insulated fittings (Type D installation).
  - (3) On pipeline at cased crossings (Type B installation).
  - (4) Consider installations on crossings with other metallic pipelines.  
(Additional test leads should also be attached to major non-PG&E pipelines, if the owners will consent.)
  - (5) In enough additional locations to ensure that the pipeline is accessible at least every block on distribution and every 1/2 mile on transmission.
  - (6) Install current span test stations at least every five miles for gathering and transmission lines (Type E installation).
  - (7) One on each side of a rectifier (Type F installation).
  - (8) When installing numerous plastic services on a steel main, test leads are required every 500' unless there is sufficient access to the pipeline at existing test leads or existing steel services.
- H. Where stray currents from non-PG&E protection systems, both cathodic and anodic, are detrimentally affecting the cathodic protection of PG&E gas lines, contact non-PG&E facility owners and take corrective measures to limit or eliminate the stray current condition. Non-PG&E protection systems may include pipelines, transit systems, telluric earth currents, etc.
- I. Clear all CPA contacts before designating the CPA as protected. Before excavation, when practical, confirm the location of underground contacts with current span calculations as well as with a locator (PCM, Tinker or pipe locator). Cathodic protection systems will be considered adequately protected when the lowest P/S on-potential is a minimum of  $-850$  mV with reference to copper-copper sulfate electrode with protective current applied. Other NACE recognized protection criteria may be used when the  $-850$  mV on-potential criteria is not practical. Obtain baseline current profiles with a PCM unless extenuating circumstances (such as the gas main running in the middle of the street) dictate otherwise. Trace the PCM currents to 15 mA and hard-wire currents to 50 mA. It is typical that the PCM transmitter current is set at one-third of the CP current during "baselining."
- J. When trying to account for current on transmission and gathering lines, workers may use a combination of protective current history, current requirements representative of the age and type of coating, P/S potentials, electrical surveys or other methods to account for current when spanning is not practical (i.e., too few spans or services off the pipeline). In areas where there is reasonable evidence that other facilities contact the transmission lines, perform electrical surveys such as close interval P/S potential readings, PCM or tinkering.
- K. The number of final P/S potential readings (P/S profile), approximately one per two blocks, will be considerably greater than the number of locations selected for maintenance readings.
- L. Gathering lines and transmission lines shall use the method described above (paragraph 2K) except when there are no branch services. Final P/S readings should document approximately one P/S potential reading per mile, unless field conditions warrant otherwise.
- M. Meet cathodic protection requirements for buried, metallic, PG&E-owned gas houselines by ensuring that the gas houseline is insulated from the service line (normally at the service riser valve) and is insulated at the original gas meter location or at the first point that the gas houseline comes above ground. Do this by using an insulating union. Apply cathodic protection with at least one 5-pound zinc or at least one 9-pound magnesium anode that is electrically attached to the buried gas houseline. The coating on the gas houseline will be an approved PG&E coating as listed in Gas Standards E-24 and E-25.

## Corrosion Control of Gas Facilities

N. All gas construction jobs installing buried steel, gas-carrying facilities (pipeline, main or service) or tying plastic mains into existing buried steel, gas-carrying pipelines or mains must ensure that the cathodic protection levels of the affected steel facilities are checked before closing out the job. Note the cathodic protection levels on the as-built construction drawing where the P/S measurements were taken. Each applicable construction job drawing must be stamped with the stamp shown in Figure 1 on Page 4. A corrosion mechanic or other qualified\* employee must sign off on the as-built construction drawing before the job is completed. If only full length plastic services are installed, the above requirement does not apply. Report any deficiencies in the cathodic protection levels to the local corrosion supervisor for remedial action. Do not consider a construction job to be complete and ready to be closed out until adequate cathodic protection levels are noted on the installed or affected steel facilities.

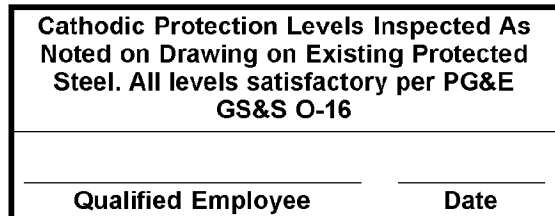

**Figure 1  
Stamp Used on the Construction Job Drawings**

\* A qualified employee is an employee trained to take a P/S cathodic protection measurement.

### 3. Cathodic Protection Maintenance

Maintain cathodic protection systems according to the following procedures.

#### A. Rectified Areas

In rectified areas, workers shall monitor for cathodic protection effectiveness according to the schedule listed in Table 1 on Page 4.

#### B. Transmission, Gathering Lines, and Distribution Mains

The test locations selected for monitoring cathodic protection effectiveness shall be representative of locations where the level of protection is the lowest for that CPA or shall be at locations where the loss of effective cathodic protection in the CPA would be detected.

#### C. Monitoring Schedule

As documented in a state of California Waiver Resolution, PG&E is exempt from the federal CPA Rectifier Inspection Monitoring Schedule as required in 49 CFR 192.465 (b). Reference: CPUC Resolution SU-39, February 23, 1996, Order Authorizing Pacific Gas and Electric Company to Deviate From General Order 112-D, Section 192.465 (b), to Exempt the Company From the Requirement of Bi-Monthly Rectifier Inspection. (A copy of this waiver is located in the *Gas Distribution Maintenance Manual*, Section II, Part O). The approved monitoring schedule is shown in Table 1 on Page 4.

**Table 1 Schedule of Monitoring Intervals <sup>1</sup>**

	P/S Monitoring	Rectifier Monitoring
UO, CGT <sup>2</sup>	Bi-monthly <sup>3</sup>	Annually <sup>4</sup>
CGT	Annually <sup>4</sup>	Bi-monthly <sup>3</sup>

<sup>1</sup> Record P/S measurements on a PG&E "Cathodic Protection Maintenance Report," Attachment D.

<sup>2</sup> CGT intervals are the same as UO when maintained by UO.

<sup>3</sup> "Bi-monthly" means six times each calendar year with intervals not to exceed 2-1/2 months.

<sup>4</sup> "Annually" means once each calendar year with intervals not to exceed 15 months.

In some distribution rectified CPAs, yearly, routine, P/S on-potential monitoring points can be established in addition to required bi-monthly monitoring points. These yearly locations do not have an "anniversary month" but may be read at any time during the calendar year. Each rectified distribution CPA must have at least one bi-monthly, routine, P/S on-potential monitoring point.

## Corrosion Control of Gas Facilities

---

### D. Rectifier Monitoring

Rectifiers shall be monitored to ensure that they are functioning correctly. Include the voltage and amperage measurements when taking rectifier readings. Record the results on the PG&E "Cathodic Protection Maintenance Report," Attachment D.

### E. Rectifier Adjustment

If the rectifier output (amperage) needs to be increased to achieve effective levels of cathodic protection, an interference test is required to ensure interference is not occurring on non-PG&E structures. Record the results on Attachment E, "Interference Test Form." A previous interference test within 10% of the new current setting is sufficient to meet this requirement. Clear all contacts before raising the rectifier output settings. In addition, document the reason the rectifier output setting had to be adjusted on the back of the "Cathodic Protection Maintenance Report," Attachment D. Acceptable reasons for adjusting the rectifier outputs include:

- (1) tying another CPA into the area.
- (2) disconnecting another rectifier in the CPA.
- (3) adding more steel piping to the CPA.
- (4) adjusting for summer dryout conditions.
- (5) deterioration of pipe coating.

### F. Remote Monitoring

Cathodic protection rectifier locations, or P/S locations, can be monitored remotely to meet PG&E requirements. The cathodic protection remote monitoring system will take a minimum of one daily reading.

### G. CPA Restoration

- (1) Schedule CPAs for restoration when the areas show P/S on-potentials to be below adequate levels of protection. Check rectifier readings before restoring a CPA. Restore areas within 30 calendar days from the date they are found to be inadequate, as defined by the current version of 49 CFR 192, Subpart I (barring acceptable extenuating circumstances). Document the reason(s) for any delays in the restoration work. Once restored, an area shall have approximately the same P/S on-potentials and rectifier output as existed before the level dropped, unless re-evaluation of the system indicates that different values are more appropriate.
- (2) Extenuating circumstances may cause a CPA's restoration to go beyond the 30 calendar day timeframe. Examples of acceptable extenuating circumstances may include worker safety, public safety, population density, environmental concerns, climatic conditions, material availability, government permitting processes, land acquisition requirements and workloads. PG&E personnel shall determine if CPA restoration work is being delayed by an acceptable extenuating circumstance.
- (3) If the CPA restoration work is (or is expected to be) delayed, develop an action plan for addressing the CPA restoration work within 30 days from the date the CPA is found below adequate levels of protection, as defined by the current 49 CFR 192, Subpart I. The action plan shall list and document the extenuating circumstance(s), the cause of the CPA problem (to the extent the cause is known), the desired solution(s), the actions needed to implement the solution, the estimated time to take those actions, and the personnel who will perform those actions. The action plan shall be updated every 30 days, or as established by the action plan, until the CPA restoration work is completed and the CPA shows adequate levels of protection. Updates to the action plan shall document the work that has been completed to date and the work that needs to be completed to achieve adequate protection. (Reference: WIN. DOT - DOT RSPA Interpretation Letter #16 for 49 CFR 192.465 – May 19, 1989.)
- (4) Attachment B is a sample "CPA Follow-up Action Plan." If using this action plan, file it with the respective CPA P/S maintenance worksheet. Document routine circumstances using the back of the "Cathodic Protection Maintenance Report," Attachment D.
- (5) The area headquarter OM&C or California CGT Pipeline Department must provide a monthly status report regarding CPA maintenance to the Engineering and Planning Department or the asset owner.

## Corrosion Control of Gas Facilities

---

H. Monitor facilities protected with galvanic anodes by using P/S on-potentials as follows.

- (1) Monitor isolated main pipe segments that are over 100' long at least once each calendar year, but with intervals not exceeding 15 months. Monitoring includes plastic systems using locating wire to distribute protection to multiple service risers, steel pipes, steel valves, etc. Consider monitoring these sections more frequently, as conditions justify.
- (2) Monitor individual isolated services of any length; fittings; individually buried, metallic, PG&E-owned gas houselines; and isolated main segments less than 100' long at least once each ten years. Monitor at least 10% of all such facilities each year. Each successive year, monitor a different selection of at least 10% of the facilities.
- (3) Evaluate (using leak detection surveys) the galvanic anode protection installed at leak repairs as well as short (less than 100'), non-insulated sections of pipe at three-year intervals.

I. Monitor the cathodic protection on bare transmission line either by performing an electrical survey every three years or by performing an annual flamepack ionization leak survey.

J. Review the gas distribution CPAs using the "CPA Assessment Worksheet" at intervals not to exceed five years, using UO Standard D-S0467. This standard is located in the *Gas Distribution Maintenance Manual*, Section II, Part O, and on the Intranet at [http://www/techlib/manuals/uo\\_standards/all\\_uo\\_standards.asp](http://www/techlib/manuals/uo_standards/all_uo_standards.asp).

K. Review transmission line CPAs according to methods, schedules and priorities developed by the CGT Pipeline Re-evaluation Program. The operating headquarters should use UO Standard D-S0467, located in the *Gas Distribution Maintenance Manual*, Section II, Part O, and on the Intranet at [http://www/techlib/manuals/uo\\_standards/all\\_uo\\_standards.asp](http://www/techlib/manuals/uo_standards/all_uo_standards.asp), except when other methods are developed and recommended by the CGT corrosion engineer. CGT will normally use electrical surveys to reevaluate pipelines, but may also use Gas Distribution's method if the CGT corrosion engineer determines it to be appropriate.

#### 4. Voltage (IR) Drop Considerations

Always consider the IR drop in the measurement circuit when interpreting the results of P/S on-potential measurements. Elements of the measuring circuit that may cause IR drop include the volt meter, reference cell placement, reference cell contact resistance, test leads and pipe and soil resistance.

A. Volt Meters: Take all P/S on-potential measurements with an approved electronic volt meter, having an input impedance equal to or greater than 10 megohms.

B. Reference Cell Placement: Since it is not always expedient to excavate for the sole purpose of taking P/S on-potential measurements, place the reference cell as close as possible over the pipe. At risers, place the reference cell approximately 6" to 12" from the riser and over the service.

C. Reference Cell Contact Resistance: Moisten the ground to minimize reference cell contact resistance. Where sufficient moisture does not exist, add water to the P/S on-potential measurement location.

D. Test Leads: Since only approved volt meters are used for making P/S on-potential measurements, IR drop in the test leads is insignificant.

E. CP Current Flow: Current flow on a pipeline from cathodic protection can cause an IR drop in the pipe and in the soil. When conducting close-interval surveys, refer the data to the corrosion specialist and/or corrosion engineer to determine if and how the IR drop in the pipe should be considered.

F. Soil: Evaluate the IR drop in the soil using the following considerations.

- (1) The 850 mV criterion for cathodic protection was developed with an allowance of at least 50 mV for IR drop and other measurement errors.
- (2) Evaluate IR drop considerations by reviewing the historical performance of the cathodic protection system and determining whether or not there is physical evidence of corrosion.
- (3) The IR drop from a galvanic anode system is usually insignificant due to the small amount of current flow. Therefore, soil IR drop is considered insignificant if the reference cell is placed over the pipe and away from the galvanic anode.

## Corrosion Control of Gas Facilities

---

### 5. Inspection and Leak Repair

Inspect a pipeline for evidence of external corrosion and take remedial action, as appropriate, any time it is exposed.

- A. Make a written report of each inspection as outlined in UO/CGT Standard D-S0350/S4110. Use Form 62-4060, "Leak Survey, Repair, Inspection and Gas Quarterly Incident Report," for all distribution and transmission pipeline facilities and services. Do not mark "Corrosion" unless it is observed. If in doubt, contact the local headquarters OM&C corrosion group.
- B. Repair, replace or recoat corrosion damaged pipe according to the applicable gas standards.
- C. When external corrosion leaks are repaired on steel pipe that is not cathodically protected, regardless of whether the pipe is wrapped or bare, install at least one 9-pound magnesium or one 5-pound zinc anode (preferred) without the shunt and without the valve frame and cover according to the instructions found in Gas Standard O-13.1. Do not install anodes at leak repairs in cathodically protected areas unless they are part of a cathodic protection improvement plan. However, investigate continuing corrosion leakage in protected areas and take corrective measures.
- D. Where an external corrosion leak occurs on a buried gas steel transmission line, a corrosion mechanic must take a P/S on-potential measurement at the leak repair site. If it is safe and practical, immediately take the P/S on-potential reading at the corroded site as the pipe is exposed. If low levels of protection are identified as a possible cause for the leak, take remedial measures.
- E. Where an external corrosion leak occurs on a buried gas steel distribution facility, take a P/S on-potential measurement at the leak site at the time of the repair. If low levels of protection are identified as a possible cause for the leak, take remedial measures.

### 6. Internal Corrosion

- A. Perform internal corrosion tests where evidence of internal pipeline corrosion is noted and has been verified, or where pipeline liquids are present. Record all information on Form 75-95.
- B. When found, sample and analyze pipeline liquids according to guidelines in the *Corrosion Manual*. If the sample is determined to be corrosive, initiate an internal corrosion control program. If evidence of internal corrosion is found, regardless of the pipeline liquid sample analysis results, initiate an internal corrosion control program.
- C. The effectiveness of the internal corrosion control program is usually monitored with electrical resistance probes or coupons and data recorded on "Probe Data Sheets" or "Coupon Data Sheets." Also, inhibitor concentrations may be measured by properly sampling liquid and analyzing it at designated liquid collection points. Each pipeline section may have its own internal corrosion control program depending on the operation and environment of that section of the system. Consult the *Internal Corrosion Mitigation Plan* for the specific pipeline sections and for details regarding the internal corrosion control program.
- D. It is recommended to take all electrical resistance probe readings and to log them in at monthly intervals not to exceed a period of 90 days for the life of the system or until the probe is retired from service.
- E. Whenever steel pipe is removed from a pipeline, inspect it for evidence of internal corrosion. Record this inspection as outlined in UO/CGT Standard D-S0350/S4110 using Form 62-4060, "Leak Survey, Repair, Inspection and Gas Quarterly Incident Report."
- F. It is required to frequently and regularly drain drip tubes and bottom tap drains on pipelines to decrease the amount of stagnating liquids and, therefore, the potential for severe internal corrosion. Log the volume of liquids removed and the frequency of their removal. If liquid is discovered in a pipeline, it is recommended that the pipeline be drained monthly. Also, samples of the liquid must be taken and analyzed and the results logged. Repair a damaged or malfunctioning drip tube or drain within one year.
- G. It is strongly recommended to swiftly retire idle pipelines that could potentially be wet. This action significantly reduces the risk of internal corrosion and, therefore, the need to eventually treat these idle pipelines with other methods (i.e., installing probes and inhibitor injection sites).
- H. All pipelines installed in potentially internally wet areas of operation should follow the piggable pipeline design standard.
- I. Evaluate well sites upstream of PG&E-owned lines that are in potentially internally wet areas of operation (i.e., downstream of a wet well but upstream of dehydration facilities) as described in the *Corrosion Manual*. Log the result of these evaluations.

## Corrosion Control of Gas Facilities

---

J. Locate all inhibitor-injection sites on a map. Include information on the type of chemical found, the volume of the chemical tank and county where the site is located. Send the information to the operating headquarter's environmental coordinator in GSTS. Update these maps as necessary. They are used to track and determine county permitting and spill plan requirements. Log all information regarding the type of inhibitor and the delivery rates. If possible, set the delivery rates off of the total flow to ensure that chemicals are not delivered to the pipeline when the gas flow is zero. Ensure that all inhibitor injection sites have a MSDS displayed and a placard indicating whether the inhibitor is flammable since it is considered to be a hazardous material.

### 7. Electrical Device Checks

Electrically check each reverse current switch, diode or interference bond whose failure jeopardizes structure protection for proper performance six times per calendar year at intervals not exceeding 2-1/2 months.

### 8. Records

A. Maintain records to show the location details of all protected structures. Ensure the records contain sufficient test data to demonstrate the adequacy of installed corrosion control measures. Maintain a file folder containing location maps illustrating the protected piping system for each cathodic protection system. The file folder should also contain information on the number, kind and location of rectifiers and anodes; a complete history of monitoring information; current span/PCM data; bond data; pipe square footage; final P/S on-potentials; final current (PCM/hardware) spans; gas facility maps; and any other pertinent information. Maintain these records for the life of the facility.

B. Use an approved computer software database management system to maintain part or all of the records and information required in paragraph 8A.

### 9. Atmospheric Corrosion Control

#### A. General

This section outlines requirements for lessening the damage caused by corrosive environments to aboveground PG&E gas facilities in compliance with current CPUC General Order 112 and 49 CFR 192.

(1) Coat all new pipe installed aboveground with a PG&E-approved product (Section E, "Coating and Wrapping," in *Gas Standards and Specifications*).

(2) Operating organizations are responsible for designating areas subject to atmospheric corrosion. Use Electric Engineering Standard Drawing 032911 which defines atmospheric corrosion areas. Maps of the atmospheric corrosion areas shall be prepared and maintained by the operating organizations. Areas affected by atmospheric corrosion monitoring are made up of all the areas bordering the ocean, including North Coast, North Bay, San Francisco, Peninsula, Central Coast and Los Padres divisions.

#### B. Monitoring

(1) In atmospheric corrosion areas, inspect all aboveground gas facilities at intervals not greater than three years.

(2) During inspection, analyze all piping or metersets with active corrosion to determine whether the damaged facility may be repaired by removing the corrosion and recoating it, or whether it must be replaced.

#### C. Maintenance

Complete all repairs or replacements according to the appropriate gas standards and specifications.

#### D. Coatings

Galvanized piping does not require coating. Take care to limit the number of scratches on galvanized pipe.

#### E. Records

Each operating organization shall maintain a file that includes the following information.

(1) A map of the atmospheric corrosion area(s).

(2) Documentation from each survey indicating the following information: dates the surveys were taken, physical locations of the pipe requiring remedial attention, the type of action required and dates of remedial actions taken.



## Corrosion Control of Gas Facilities

---

### Revision Notes

Revision 06 has the following changes.

1. Added the term “converted pipelines” in “General Information,” Item 1, “Requirements for Protection” on Page 2.
2. Eliminated from Item 2G(6) on Page 3 the requirement for the current span test stations on the distribution main.
3. Clarified the current profiling in Item 2I on Page 3.
4. Added the requirement regarding checking for the proper electrical performance of all electrical elements whose failure would jeopardize structure protection (see Item 7 on Page 8).
5. Eliminated the requirement to calculate the CP current. Substituted measurement of steel main in CPA. Attachment F modified accordingly.
6. Modified and expanded Attachments A, C, D and E.
7. Added NACE standard reference to “References” section.
8. This document is part of Change 48.

## Corrosion Control of Gas Facilities

### Attachment A

#### Cathodic Protection Guidelines for Installing New, Replaced or Transferred Steel Mains and Steel or Plastic Services

Proposed New or Replaced Gas Facility  Existing Main Piping System	Mains	Services			
	Steel Main	Direct Burial Plastic Service (See Note 5) or Plastic Service Insert (See Note 6) with Noncorrodible Riser	Plastic Service Insert with Noncorrodible Riser where Plastic Service Locating Wire Cannot Be Inserted Through Service Case Pipe	Plastic Service Insert Through Existing Steel Riser (See Note 7)	New or Transferred Steel Services or Steel Risers
<b>Cathodically Protected Steel Main or Plastic Main with a Locating Wire that is Part of a Cathodic Protection System</b>	<ol style="list-style-type: none"> <li>1. Tie new steel main into existing steel main.</li> <li>2. Bond existing plastic main locating wire to installed steel main, if doing so does not cross CPA boundaries.</li> <li>3. Ensure adequate P/S readings on installation.</li> <li>4. Contact a corrosion mechanic to ensure proper cathodic protection requirements are met.</li> </ol>	<ol style="list-style-type: none"> <li>1. Bond installed plastic service wire to existing steel main or existing plastic main locating wire.</li> <li>2. Insulate plastic service locating wire from the riser by wrapping it around the service riser.</li> <li>3. Insulate at the riser valve.</li> <li>4. Insulate plastic service locating wire from the inserted steel casings.</li> </ol>	<ol style="list-style-type: none"> <li>1. Insulate plastic service locating wire from existing steel main or existing plastic main locating wire.</li> <li>2. If plastic service locating wire is needed (see Note 7), bond plastic service locating wire to the inserted steel casing and wrap it around the tee.</li> <li>3. Bond another plastic service locating wire to the plastic service case pipe at the riser-end of the service case pipe and insulate the plastic service locating wire from the riser by wrapping it around the service riser.</li> <li>4. Insulate at the riser valve.</li> </ol>	<ol style="list-style-type: none"> <li>1. Insulate plastic service locating wire from existing steel main or plastic main locating wire.</li> <li>2. If the plastic service locating wire is needed (see Note 7), bond the plastic service locating wire to the inserted steel casing and wrap it around the tee.</li> <li>3. Insulate at the riser valve.</li> </ol>	<ol style="list-style-type: none"> <li>1. Tie steel service at the steel main.</li> <li>2. Bond steel service to the plastic main wire.</li> <li>3. Insulate at the riser.</li> </ol>
<b>Wrapped, Unprotected Steel Main</b>	<p><b>100' or less Replacement Repair, or Relocation</b></p> <ol style="list-style-type: none"> <li>1. Tie new steel main to existing steel main.</li> <li>2. Install at least one 17-pound magnesium or one 15-pound zinc anode on each end of the new pipe.</li> <li>3. Monitor in accordance with applicable leak survey requirements.</li> </ol> <p><b>Over 100' and All Main Extensions</b></p> <ol style="list-style-type: none"> <li>1. Insulate at each end of main-to-main connections.</li> <li>2. Install the appropriate number of galvanic anodes.</li> <li>3. Monitor P/S annually.</li> <li>4. Ensure P/S readings are adequate.</li> </ol>	<ol style="list-style-type: none"> <li>1. Bond installed plastic service wire to existing steel main.</li> <li>2. Insulate plastic service locating wire from the riser by wrapping it around the service riser.</li> <li>3. Insulate at the riser valve.</li> <li>4. Insulate plastic service locating wire from inserted steel casings.</li> </ol>	<ol style="list-style-type: none"> <li>1. Insulate plastic service locating wire from existing steel main.</li> <li>2. If plastic service locating wire is needed (see Note 7), bond the plastic service locating wire to inserted steel casing and wrap around tee.</li> <li>3. Bond another plastic service locating wire to the plastic service case pipe at the riser end of the service case pipe and insulate the plastic service locating wire from the riser by wrapping it around the service riser.</li> <li>4. Insulate at the riser valve.</li> </ol>	<ol style="list-style-type: none"> <li>1. Insulate plastic service locating wire from existing steel main.</li> <li>2. If the plastic service locating wire is needed (see Note 7), bond the plastic service locating wire to the inserted steel casing and wrap it around the tee.</li> <li>3. Insulate at the riser valve.</li> </ol>	<p><b>Any length:</b></p> <ol style="list-style-type: none"> <li>1. Tie to existing steel main.</li> <li>2. Use an insulated valve stop riser (Gas Standard F-80).</li> <li>3. Install at least one 9-pound magnesium or one 5-pound zinc anode on the service pipe.</li> <li>4. Monitor in accordance with applicable leak survey requirements.</li> </ol>

## Corrosion Control of Gas Facilities

*Attachment A, continued***Cathodic Protection Guidelines for Installing New, Replaced or Transferred Steel Mains and Steel or Plastic Services**

Proposed New or Replaced Gas Facility  Existing Main Piping System	Mains	Services			
	Steel Main	Direct Burial Plastic Service (See Note 5) or Plastic Service Insert (See Note 6) with Noncorrodible Riser	Plastic Service Insert with Noncorrodible Riser where Plastic Service Locating Wire Cannot Be Inserted Through Service Case Pipe	Plastic Service Insert Through Existing Steel Riser (See Note 7)	New or Transferred Steel Services or Steel Risers
<b>Unwrapped, Unprotected Steel Main</b>	<p><b>10' or less Replacement Repair, or Relocation</b></p> <ol style="list-style-type: none"> <li>1. Tie new main to existing main.</li> <li>2. Install at least one 9-pound magnesium or one 5-pound zinc anode.</li> <li>3. Monitor in accordance with applicable leak survey requirements.</li> </ol> <p><b>Over 10' and all main extensions</b></p> <ol style="list-style-type: none"> <li>1. Insulate at each end of main-to-main connections.</li> <li>2. Install the appropriate number of galvanic anodes.</li> <li>3. Ensure P/S readings are adequate.</li> <li>4. Monitor P/S yearly on 10% of those pipe sections which are 100' long or less. Monitor annually if pipe length is over 100'.</li> </ol>	<ol style="list-style-type: none"> <li>1. Bond installed plastic service wire to existing steel main.</li> <li>2. Insulate plastic service locating wire from the riser by wrapping it around the service riser.</li> <li>3. Insulate at the riser valve.</li> <li>4. Insulate plastic service locating wire from the inserted steel casings.</li> </ol>	<ol style="list-style-type: none"> <li>1. Insulate plastic service locating wire from existing steel main.</li> <li>2. If plastic service locating wire is needed (see Note 7), bond the plastic service locating wire to the inserted steel casing and wrap it around the tee.</li> <li>3. Bond another plastic service locating wire to the plastic service case pipe at the riser end of the service case pipe and insulate the plastic service locating wire from the riser by wrapping it around the service riser.</li> <li>4. Insulate at the riser valve.</li> </ol>	<ol style="list-style-type: none"> <li>1. Insulate plastic service locating wire from existing steel main.</li> <li>2. If the plastic service locating wire is needed (see Note 7), bond the plastic service locating wire to the inserted steel casing and wrap it around the tee.</li> <li>3. Insulate at the riser valve.</li> </ol>	<p><b>Any length</b></p> <ol style="list-style-type: none"> <li>1. Insulate steel service at both the main and the riser.</li> <li>2. Install at least one 9-pound magnesium or one 5-pound zinc anode on the service pipe.</li> <li>3. Ensure P/S readings are adequate.</li> <li>4. Monitor P/S yearly on 10% of these installations.</li> </ol>
<b>Cast Iron Main</b>	<p><b>Any length</b></p> <ol style="list-style-type: none"> <li>1. Insulate cast iron-to-steel transition with an approved insulating coupling (per Gas Standard B-91.4).</li> <li>2. Install the appropriate number of galvanic anodes.</li> <li>3. Ensure there are adequate P/S readings on the installation.</li> <li>4. Monitor P/S yearly on 10% of those pipe sections which are 100' long or less. Monitor annually if pipe length is over 100'.</li> </ol>	<ol style="list-style-type: none"> <li>1. Insulate installed plastic service wire from existing cast iron main by wrapping around tee.</li> <li>2. Insulate plastic service locating wire from the riser by wrapping it around the service riser.</li> <li>3. Insulate at riser valve.</li> <li>4. Insulate plastic service locating wire from inserted steel casings.</li> </ol>	<ol style="list-style-type: none"> <li>1. Insulate plastic service locating wire from existing cast iron main.</li> <li>2. If plastic service locating wire is needed (see Note 7), bond plastic service locating wire to inserted steel casing and wrap around tee.</li> <li>3. Bond another plastic service locating wire to the plastic service case pipe at the riser end of the service case pipe and insulate plastic service locating wire from the riser by wrapping it around the service riser.</li> <li>4. Insulate at riser valve.</li> </ol>	<ol style="list-style-type: none"> <li>1. Insulate plastic service locating wire from existing cast iron main.</li> <li>2. If plastic service locating wire is needed (see Note 7), bond plastic service locating wire to inserted steel casing and wrap around tee.</li> <li>3. Insulate at riser valve.</li> </ol>	<p><b>Any length</b></p> <ol style="list-style-type: none"> <li>1. Install malleable iron saddle, Universal 90. Install a small section of plastic pipe to isolate the service from the cast iron main.</li> <li>2. Wrap the saddle and tee according to Section E of the <i>Gas Standards and Specifications</i>.</li> <li>3. Install at least one 9-pound magnesium or one 5-pound zinc anode on the service pipe.</li> <li>4. Ensure P/S readings are adequate.</li> <li>5. Monitor P/S yearly on 10% of these installations.</li> </ol>

Corrosion Control of Gas Facilities

Attachment A, continued

Cathodic Protection Guidelines for Installing New, Replaced or Transferred Steel Mains and Steel or Plastic Services

Proposed New or Replaced Gas Facility  Existing Main Piping System	Mains	Services			
	Steel Main	Direct Burial Plastic Service (See Note 5) or Plastic Service Insert (See Note 6) with Noncorrodible Riser	Plastic Service Insert with Noncorrodible Riser where Plastic Service Locating Wire Cannot Be Inserted Through Service Case Pipe	Plastic Service Insert Through Existing Steel Riser (See Note 7)	New or Transferred Steel Services or Steel Risers
Plastic Main (Insert or Direct Buried) with Locating Wire that is Not Part of a Cathodic Protection System	<ol style="list-style-type: none"> <li>1. Insulate at each end of main-to-main connection.</li> <li>2. Do not bond existing plastic main locating wire to steel main.</li> <li>3. Install the appropriate number of galvanic anodes.</li> <li>4. Ensure P/S readings are adequate.</li> <li>5. Monitor P/S yearly on 10% of those pipe sections which are 100' long or less. Monitor annually if pipe length is over 100'.</li> </ol>	<ol style="list-style-type: none"> <li>1. Insulate installed plastic service wire from existing plastic main by wrapping it around the tee.</li> <li>2. Insulate plastic service locating wire from the riser by wrapping it around the service riser.</li> <li>3. Insulate at the riser valve.</li> <li>4. Insulate plastic service locating wire from inserted steel casings.</li> </ol>	<ol style="list-style-type: none"> <li>1. Insulate plastic service locating wire from existing plastic main locating wire.</li> <li>2. If plastic service locating wire is needed (see Note 7), bond the plastic service locating wire to the inserted steel casing and wrap it around the tee.</li> <li>3. Bond another plastic service locating wire to the plastic service case pipe at the riser end of the service case pipe and insulate the plastic service locating wire from the riser by wrapping it around the service riser.</li> <li>4. Insulate at the riser valve.</li> </ol>	<ol style="list-style-type: none"> <li>1. Insulate plastic service locating wire from existing cast iron main.</li> <li>2. If plastic service locating wire is needed (see Note 7), bond the plastic service locating wire to the inserted steel casing and wrap it around the tee.</li> <li>3. Insulate at riser valve.</li> </ol>	<p><b>Any length</b></p> <ol style="list-style-type: none"> <li>1. Insulate steel service at both the main and the riser.</li> <li>2. Install at least one 9-pound magnesium or one 5-pound zinc anode on the service pipe.</li> <li>3. Ensure P/S readings are adequate.</li> <li>4. Monitor P/S yearly on 10% of these installations.</li> </ol>

Notes:

1. For new mains or services, or when reconstructing plastic services by insertion, use AWG No.14 copper HMWPE wire (Code 294378). Use AWG No.10 copper HMWPE wire (Code 294414) for mains.
2. Use compression fittings and wrap them with Tac-Tape (Code 507036). Then wrap splices with electrical tape. Soldered splices may be used instead of compression fittings (refer to Gas Standard O-12).
3. Thermite weld all wire connections to steel pipe. Strap locating wire to the service line with electrical tape or Tie-Locks (Code 399093) to ensure close proximity. Tapes other than electrical tape are not permitted for strapping unless they are approved by the corrosion supervisor.
4. Ensure that anodes are a minimum of 12" from other underground metallic facilities.
5. Strap a locating wire to the service riser above ground, but below an insulated service valve. Use Tie-Locks (Code 399093). Do not bond the wire to the riser.
6. Do not bond plastic service locating wire to existing service case pipe or to a new, noncorrodible, prefabricated riser. If plastic service locating wire can be inserted successfully, strap it to the service riser above ground, but below an insulated service valve. Use Tie-Locks (Code 399093).
7. Do not bond plastic service locating wire to steel main or plastic main locating wire. For distances less than 3' from the metallic service case pipe to the main, a plastic service locating wire is not required. For longer distances, bond a plastic service locating wire to a metallic service case pipe, but never to steel main or the plastic main locating wire.
8. Driveable anodes can be thermite welded or clamped.

**Corrosion Control of Gas Facilities**

**Attachment B**

**CPA FOLLOW-UP ACTION PLAN**

CPA # \_\_\_\_\_ CPA Description \_\_\_\_\_

Corrosion Mechanic \_\_\_\_\_ Location \_\_\_\_\_ Date \_\_\_\_\_ Page # \_\_\_\_\_

OBJECTIVE: This follow-up action plan facilitates completing actions needed to restore a CPA to adequate levels of cathodic protection and to meet the requirements for documenting extenuating circumstances as required in Gas Standard O-16, Section 3, Paragraph A.

Date CPA Was Found Below Adequate Levels of Cathodic Protection: \_\_\_\_\_

Date of Action Plan: \_\_\_\_\_

Date Next Action Plan Update Needed: \_\_\_\_\_ Date CPA Restored: \_\_\_\_\_

Cause of CPA Problem: \_\_\_\_\_

Desired Solution: \_\_\_\_\_

Description of Extenuating Circumstances: \_\_\_\_\_

	Recommended Action / Work Completed	Assigned Person	Estimated Completion Date	Actual Completion Date
1				
2				
3				
4				
5				
6				
7				
8				
9				
10				
11				

Reviewed by \_\_\_\_\_ / \_\_\_\_\_ Date \_\_\_\_\_

Corrosion Control of Gas Facilities



Attachment C

Gas Distribution and Technical Services  
Rev. 11/00

CATHODIC PROTECTION STATION REPORT

- Transmission
- Distribution
- Both

PG&E NO.	CP. SYSTEM NO.	DIVISION	OP. HEADQUARTERS
----------	----------------	----------	------------------

**RECTIFIER**

LOCATION		CITY	
MANUFACTURER	TYPE	MODEL	SERIAL NO.
PRIMARY RATING <span style="float: right;">VOLTS</span>		ACTUAL PRIMARY VOLTAGE <span style="float: right;">VOLTS</span>	
SECONDARY RATING <span style="float: left;">AMPS</span>	INITIAL SETTING <span style="float: right;">VOLTS</span>	DATE PLACED IN OPERATION	

**ANODE**

NUMBER	WEIGHT AND/OR SIZE
TYPE	BACKFILL USED

**SOIL RESISTIVITY**

PIN SPACING - Feet	Ohms	MULTIPLIER	Ohm-Cm
2.5	_____	500	_____
5.0	_____	1,000	_____
7.5	_____	1,500	_____
10.1	_____	2,000	_____
15.0	_____	3,000	_____

SHOW LOCATION OF RECTIFIER AND ANODE(S) AND PERTINENT DIMENSIONS

WALL MAP \_\_\_\_\_ PLAT \_\_\_\_\_ BLOCK \_\_\_\_\_

PREPARED BY \_\_\_\_\_ DATE \_\_\_\_\_ CALIFORNIA GRID COORDINATE NUMBER \_\_\_\_\_



## Corrosion Control of Gas Facilities

---

### Attachment C, continued

#### “Cathodic Protection Station Report” Instructions

##### RECORD

- PG&E No.: Record the rectifier’s PG&E identification number, if any.
- CP System No.: Record the cathodic protection system number for the rectifier.
- Division/Operating Headquarters: Record the name of the division and operating headquarters where the rectifier is located.
- Transmission/Distribution/Both: Check the appropriate box for the type of gas facility that the rectifier is protecting.

##### RECTIFIER

- Location: Provide details of the rectifier’s location.
- City: Record the name of the city.
- Manufacturer/Type/Model/Serial No.: Complete the rectifier manufacturer’s information.
- Primary Rating: Record the unit’s input voltage rating per manufacturer’s specifications.
- Actual Primary Voltage: Complete the unit’s input actual primary voltage rating as measured in the field.
- Secondary Rating: Record the unit’s maximum secondary amperage and voltage ratings per the manufacturer.
- Initial Setting: Record the rectifier’s initial setting (amperage and voltage).
- Date Placed in Operation: Record the month, day and year when the rectifier was placed in operation.
- Number, Weight and/or Size: Record the number, weight (or size) in pounds, type (material) and backfill used.

##### SOIL RESISTIVITY

- Soil Resistivity: Record soil resistivity readings based on ohm readings and pin spacing.
- Location Sketch: Include a detailed sketch of the location of the rectifier and the anodes. Ensure the sketch is precise enough to enable a person to locate those structures in the field.

##### RECTIFIER SERVICE HISTORY

- Date, By, Manhr: Record the date, person and time (in hours) used for the maintenance.
- Inspect: Verify that all actions specified in Note 1 were taken.
- Locks Lubed: Verify that this action was taken.
- Rectifier Cleaned: Verify that this action was taken.
- Repairs Required: Specify any needed repairs.
- Action Taken: Record any corrective actions taken.
- Repaired By/Date: Record the initials of the person performing the repair and the date of the repair.
- Reviewed By/Date: Supervisor’s initials and the date of review.





## CATHODIC PROTECTION MAINTENANCE REPORT

### A. RECORD INFORMATION

PG&E NO.	CITY	CP SYSTEM NO.	FM#
AREA	DIVISION	DISTRICT	YEAR

### B. PIPE-TO-SOIL POTENTIAL MEASUREMENTS (MILLIVOLTS)

TEST LOCATION	FREQ.																	REMARKS	
1.																			
2.																			
3.																			
4.																			
5.																			
6.																			
7.																			
8.																			
DATA RECORDED BY																			
DATE (MONTH/DAY)																			

### C. GALVANIC ANODE/RECTIFIER MEASUREMENTS

GALVANIC ANODE LOCATION OR RECTIFIER LOCATION																			REMARKS	
	(VOLTS/AMPS)      Indicate which unit was used – <input type="checkbox"/> amperes or <input type="checkbox"/> milliamperes																			
1.																				
2.																				
3.																				
4.																				
5.																				
DATA RECORDED BY																				
DATE (MONTH/DAY)																				
REVIEWED BY																				
DATE (MONTH/DAY)																				

Corrosion Control of Gas Facilities

O: Corrosion Control



## Corrosion Control of Gas Facilities

**Attachment D, continued**

Gas Distribution and Technical Services  
Rev. 11/00

**“Cathodic Protection Maintenance Report” Instructions****A. RECORD INFORMATION**

- PG&E No.: Record PG&E's identification number for cathodic protection area.
- City: Record the city where the cathodic protection area is located.
- CP System No.: Record the cathodic protection system number.
- FM#: Record the facility maintenance system or work management system number for the cathodic protection area.
- Area: Record the neighborhood or area description of the cathodic protection area.
- Division: Record the division or operating headquarters.
- District: Record the local district office.
- Year: Record the year that is being monitored.

**B. PIPE-TO-SOIL POTENTIAL MEASUREMENTS**

- Test Location: Record the exact address or location of the P/S monitoring point.
- Freq.: Record the planned monitoring frequency of the test location.  
Record “Y” for yearly or “B” for bi-monthly. If left blank, it is assumed to be a bi-monthly test location.
- Measurement: Record the exact P/S reading in millivolts for the date and test location.
- Data Recorded by: Record the initials of the person taking the P/S reading.
- Date (Month/Day): Record the exact month and day that a P/S reading was taken at the test location.

**C. GALVANIC ANODE/RECTIFIER MEASUREMENTS**

- Galvanic Anode Location or Rectifier No. and Location: Record the location of the galvanic anode or the rectifier number and location.
- Voltage/Amperage: Record two measurements at each location: the voltage in volts and the amperage in either milliamperes or amperes.
- Remarks: Record any remarks for the test location.
- Data Recorded by: Record the initials of the person taking the volt/ampere readings.
- Date (Month/Day): Record the exact month and day that the volt/ampere readings were taken at the test location.
- Reviewed by: Record the initials of the person reviewing the maintenance sheet for completeness and accuracy (optional).
- Date (Month/Day): Record the exact month and day that the maintenance sheet was reviewed, if reviewed.



**Attachment D, continued**

Gas Distribution and Technical Services  
Rev. 11/00

**D. LOG OF CATHODIC PROTECTION MAINTENANCE WORK**

- CP System No.: Record the cathodic protection system number.
- Date/Initials: Record the date that work was performed and the initials of the person performing it.
- Work Description: Describe the exact work task completed on the date (e.g., Checked with engineering, who submitted a permit to the city on 09/09/99, expect to receive by 10/01/99).

Corrosion Control of Gas Facilities

<b>Attachment E</b> Gas Distribution and Technical Services Rev. 11/00				
<b>INTERFERENCE TEST FORM</b>				
PG&E NO.	CP SYSTEM NO.	DIVISION	OPERATING HQ	CITY
<b>RECTIFIER</b>				
LOCATION				
DC RATING		DC SETTING		
Amperes	Volts	Amperes	Volts	
<b>SOIL RESISTIVITY</b>				
AVERAGE SOIL RESISTIVITY FOR SHALLOW WELL ANODES _____ Ohm/Cm				
TOTAL SOIL RESISTIVITY FOR DEEP WELL ANODES _____ Ohms				
<b>PIPE-TO-SOIL POTENTIAL</b>				
PROTECTED STRUCTURE	ON		OFF	
NON-PG&E STRUCTURE	ON		OFF	
NON-PG&E STRUCTURE	ON		OFF	
NON-PG&E STRUCTURE OWNER			TELEPHONE	
<b>DRAWING</b>				
CORRECTIVE ACTION TAKEN:				
DATE:			PREPARED BY:	



**Attachment E, continued**

Gas Distribution and Technical Services  
Rev. 11/00

**“Interference Test Form” Instructions**

**RECORD**

PG&E Number: Record the rectifier’s PG&E identification number.

CP System Number: Record the cathodic protection system number for the area.

Division/Operating Headquarters/City: Record those elements for the tested rectifier.

**RECTIFIER**

Location: Record the exact location of the rectifier.

DC Rating: Record the manufacturer’s rating for the rectifier (amperes and volts).

DC Setting: Record the DC settings at the time of the interference test.

**SOIL RESISTIVITY**

Average Soil Resistivity for Shallow  
Well Anodes/Total Soil Resistivity for

Deep Well Anodes: Record soil resistivity for the shallow or deep well anodes as applicable to the test.

**PIPE-TO-SOIL POTENTIALS**

Pipe-to-Soil Potentials on Protected  
and Non-PG&E Structure:

After setting up an interrupter, record “ON” and “OFF” P/S potentials on the protected facility (e.g., PG&E Gas Main) and any non-PG&E structures that could be affected by the rectifier.

Non-PG&E Structure Owner and  
Telephone:

Record the name of the owner of non-PG&E structure and a local telephone number.

Drawing:

Include a drawing of the rectifier, anode bed and the location of any non-PG&E structure.

Corrective Action Taken:

Record the corrective action taken, if any, needed to mitigate any interference situations.

Date/Prepared by:

Record the date and the name of the person who conducted the interference test.

Corrosion Control of Gas Facilities



**Attachment F**

Gas Distribution and Technical Services  
Rev. 11/00

**CPA STEEL MAIN FOOTAGE WORKSHEET**

CPA \_\_\_\_\_

**IMPORTANT: Fill Out the Following Table in Pencil.**

Wall Map	Plat Sheet	Steel Main Footage	Date	Wall Map	Plat Sheet	Steel Main Footage	Date
Total Footage				Total Footage			

Total Steel Main Footage \_\_\_\_\_ Date \_\_\_\_\_ by \_\_\_\_\_

Updated Steel Main Footage \_\_\_\_\_ Date \_\_\_\_\_ by \_\_\_\_\_

Updated Steel Main Footage \_\_\_\_\_ Date \_\_\_\_\_ by \_\_\_\_\_

Updated Steel Main Footage \_\_\_\_\_ Date \_\_\_\_\_ by \_\_\_\_\_



**Attachment F, continued**

Gas Distribution and Technical Services  
Rev. 11/00

**“CPA Steel Main Footage Worksheet” Instructions**

This worksheet is used to help calculate the total steel main footage in the CPA.

**Note: Fill out the form in pencil. This will allow future revisions to be made directly on this sheet, without creating a new form.**

CPA: Record the cathodic protection system number for the area.

Wall Map: Record the wall map number.

Plat Sheet: Record the plat sheet number for all plat sheets in CPA.

Steel Main Footage: Record all steel main footage on this plat sheet, protected by this CPA.

Total Footage: The footage column grand total.

Total Steel Main Footage: Total steel main protected in this CPA.

Updated Steel Main Footage: Spaces are provided for future footage updates. These footages will be recalculated when the system is resurveyed.