

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
1000 Oaks District


		1998				Corrective Action			
		Level 4		Level 5					
Distribution Equipment	Scheduled	Completed	Balance Remaining	% (1)	Scheduled (2)	Completed	Balance Remaining	% (1)	
Transformers									
Overhead	0	4	0	0.0%	0	36	0	0.0%	
Underground	4	11	0	0.0%	0	0	0	0.0%	
Pad Mounted	10	17	0	0.0%	0	0	0	0.0%	
Sub-Total	14	32	0	0.0%	0	36	0	0.0%	
Switching/Protective Devices									
Overhead	1	4	0	0.0%	0	4	0	0.0%	
Underground	11	15	0	0.0%	0	2	0	0.0%	
Pad Mounted	1	3	0	0.0%	0	0	0	0.0%	
Sub-Total	13	22	0	0.0%	0	6	0	0.0%	
Regulators									
Overhead	0	0	0	0.0%	0	0	0	0.0%	
Underground	0	0	0	0.0%	0	0	0	0.0%	
Pad Mounted	0	0	0	0.0%	0	0	0	0.0%	
Sub-Total	0	0	0	0.0%	0	0	0	0.0%	
Capacitors									
Overhead	0	14	0	0.0%	0	3	0	0.0%	
Underground	0	0	0	0.0%	0	0	0	0.0%	
Pad Mounted	0	1	0	0.0%	0	0	0	0.0%	
Sub-Total	0	15	0	0.0%	0	3	0	0.0%	
Conductors, Cables									
Overhead (Conductor Miles)	0	0	0	0.0%	0	0	0	0.0%	
Street Lights									
	0	0	0	0.0%	0	0	0	0.0%	
Wood Poles									
	182	108	74	40.7%	0	25	0	0.0%	
Total	209	177	74	35.4%	0	70	0	0.0%	
(1) Percentage of remaining Corrective Actions (2) Pad mounted transformer quantity is different than 1997 GO 165 Report due to a calculation error in last year's report.									

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
1000 Oaks District

		1998			Corrective Action		
		Summary (2)			Explanation For Balance (> 0)		
Distribution Equipment	Scheduled (3)	Completed	Balance Remaining	% (1)		Recovery Date	
Transformers							
Overhead	0	40	0	0.0%			
Underground	4	11	0	0.0%			
Pad Mounted	10	17	0	0.0%			
Sub-Total	14	68	0	0.0%			
Switching/Protective Devices							
Overhead	1	8	0	0.0%			
Underground	11	17	0	0.0%			
Pad Mounted	1	3	0	0.0%			
Sub-Total	13	28	0	0.0%			
Regulators							
Overhead	0	0	0	0.0%			
Underground	0	0	0	0.0%			
Pad Mounted	0	0	0	0.0%			
Sub-Total	0	0	0	0.0%			
Capacitors							
Overhead	0	17	0	0.0%			
Underground	0	0	0	0.0%			
Pad Mounted	0	1	0	0.0%			
Sub-Total	0	18	0	0.0%			
Conductors, Cables							
Overhead (Conductor Miles)	0	0	0	0.0%			
Street Lights							
	0	0	0	0.0%			
Wood Poles							
	182	133	74	40.7%	Additional repairs/replacements were performed in other districts.	31-Dec-99	
Total	209	247	74	35.4%			
(1) Percentage of remaining Corrective Actions (2) Summary = Condition level 4 + Condition Level 5 from Page 6. (3) Pad mounted transformer quantity is different than 1997 GO 165 Report due to a calculation error in last year's report.							

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
1000 Oaks District

Distribution Equipment	1999						Corrective Actions		
	Detail/Intru '98 Balance Remaining	1999 Planned		Detail/ Intrusive	Total Planned	'98 Balance Remaining	1999		Total Planned
		Patrol (1)	Intrusive				Planned (2)	Planned	
Transformers									
Overhead	0	9,113	0	9,113	0	2	2	2	
Underground	0	6,239	1,995	8,234	0	1	1	1	
Pad Mounted	0	4,604	901	5,505	0	4	4	4	
Sub-Total	0	19,956	2,896	22,852	0	7	7	7	
Switching/Protective Devices									
Overhead	0	147	0	147	0	1	1	1	
Underground	0	2,074	682	2,756	0	11	11	11	
Pad Mounted	0	296	49	345	0	4	4	4	
Sub-Total	0	2,517	731	3,248	0	16	16	16	
Regulators									
Overhead	0	6	0	6	0	0	0	0	
Underground	0	0	0	0	0	0	0	0	
Pad Mounted	0	0	0	0	0	0	0	0	
Sub-Total	0	6	0	6	0	0	0	0	
Capacitors									
Overhead	0	257	0	257	0	14	14	14	
Underground	0	17	0	17	0	0	0	0	
Pad Mounted	0	57	1	58	0	0	0	0	
Sub-Total	0	331	1	332	0	14	14	14	
Conductors, Cables Overhead (Conductor Miles)	0	4,246	0	4,246	0	0	0	0	
Street Lights									
	N/A	25,077	N/A	25,077	0	0	0	0	
Wood Poles									
	0	48,677	0	48,677	74	31	105	105	
Total	0	100,810	3,628	104,438	74	68	142	142	
(1) District is required to patrol 100% of its circuits in 1999. 100% of street lights are planned to be patrolled in 1999. (2) Corrective actions planned to be completed in 1999 based on items found through previous inspections.									

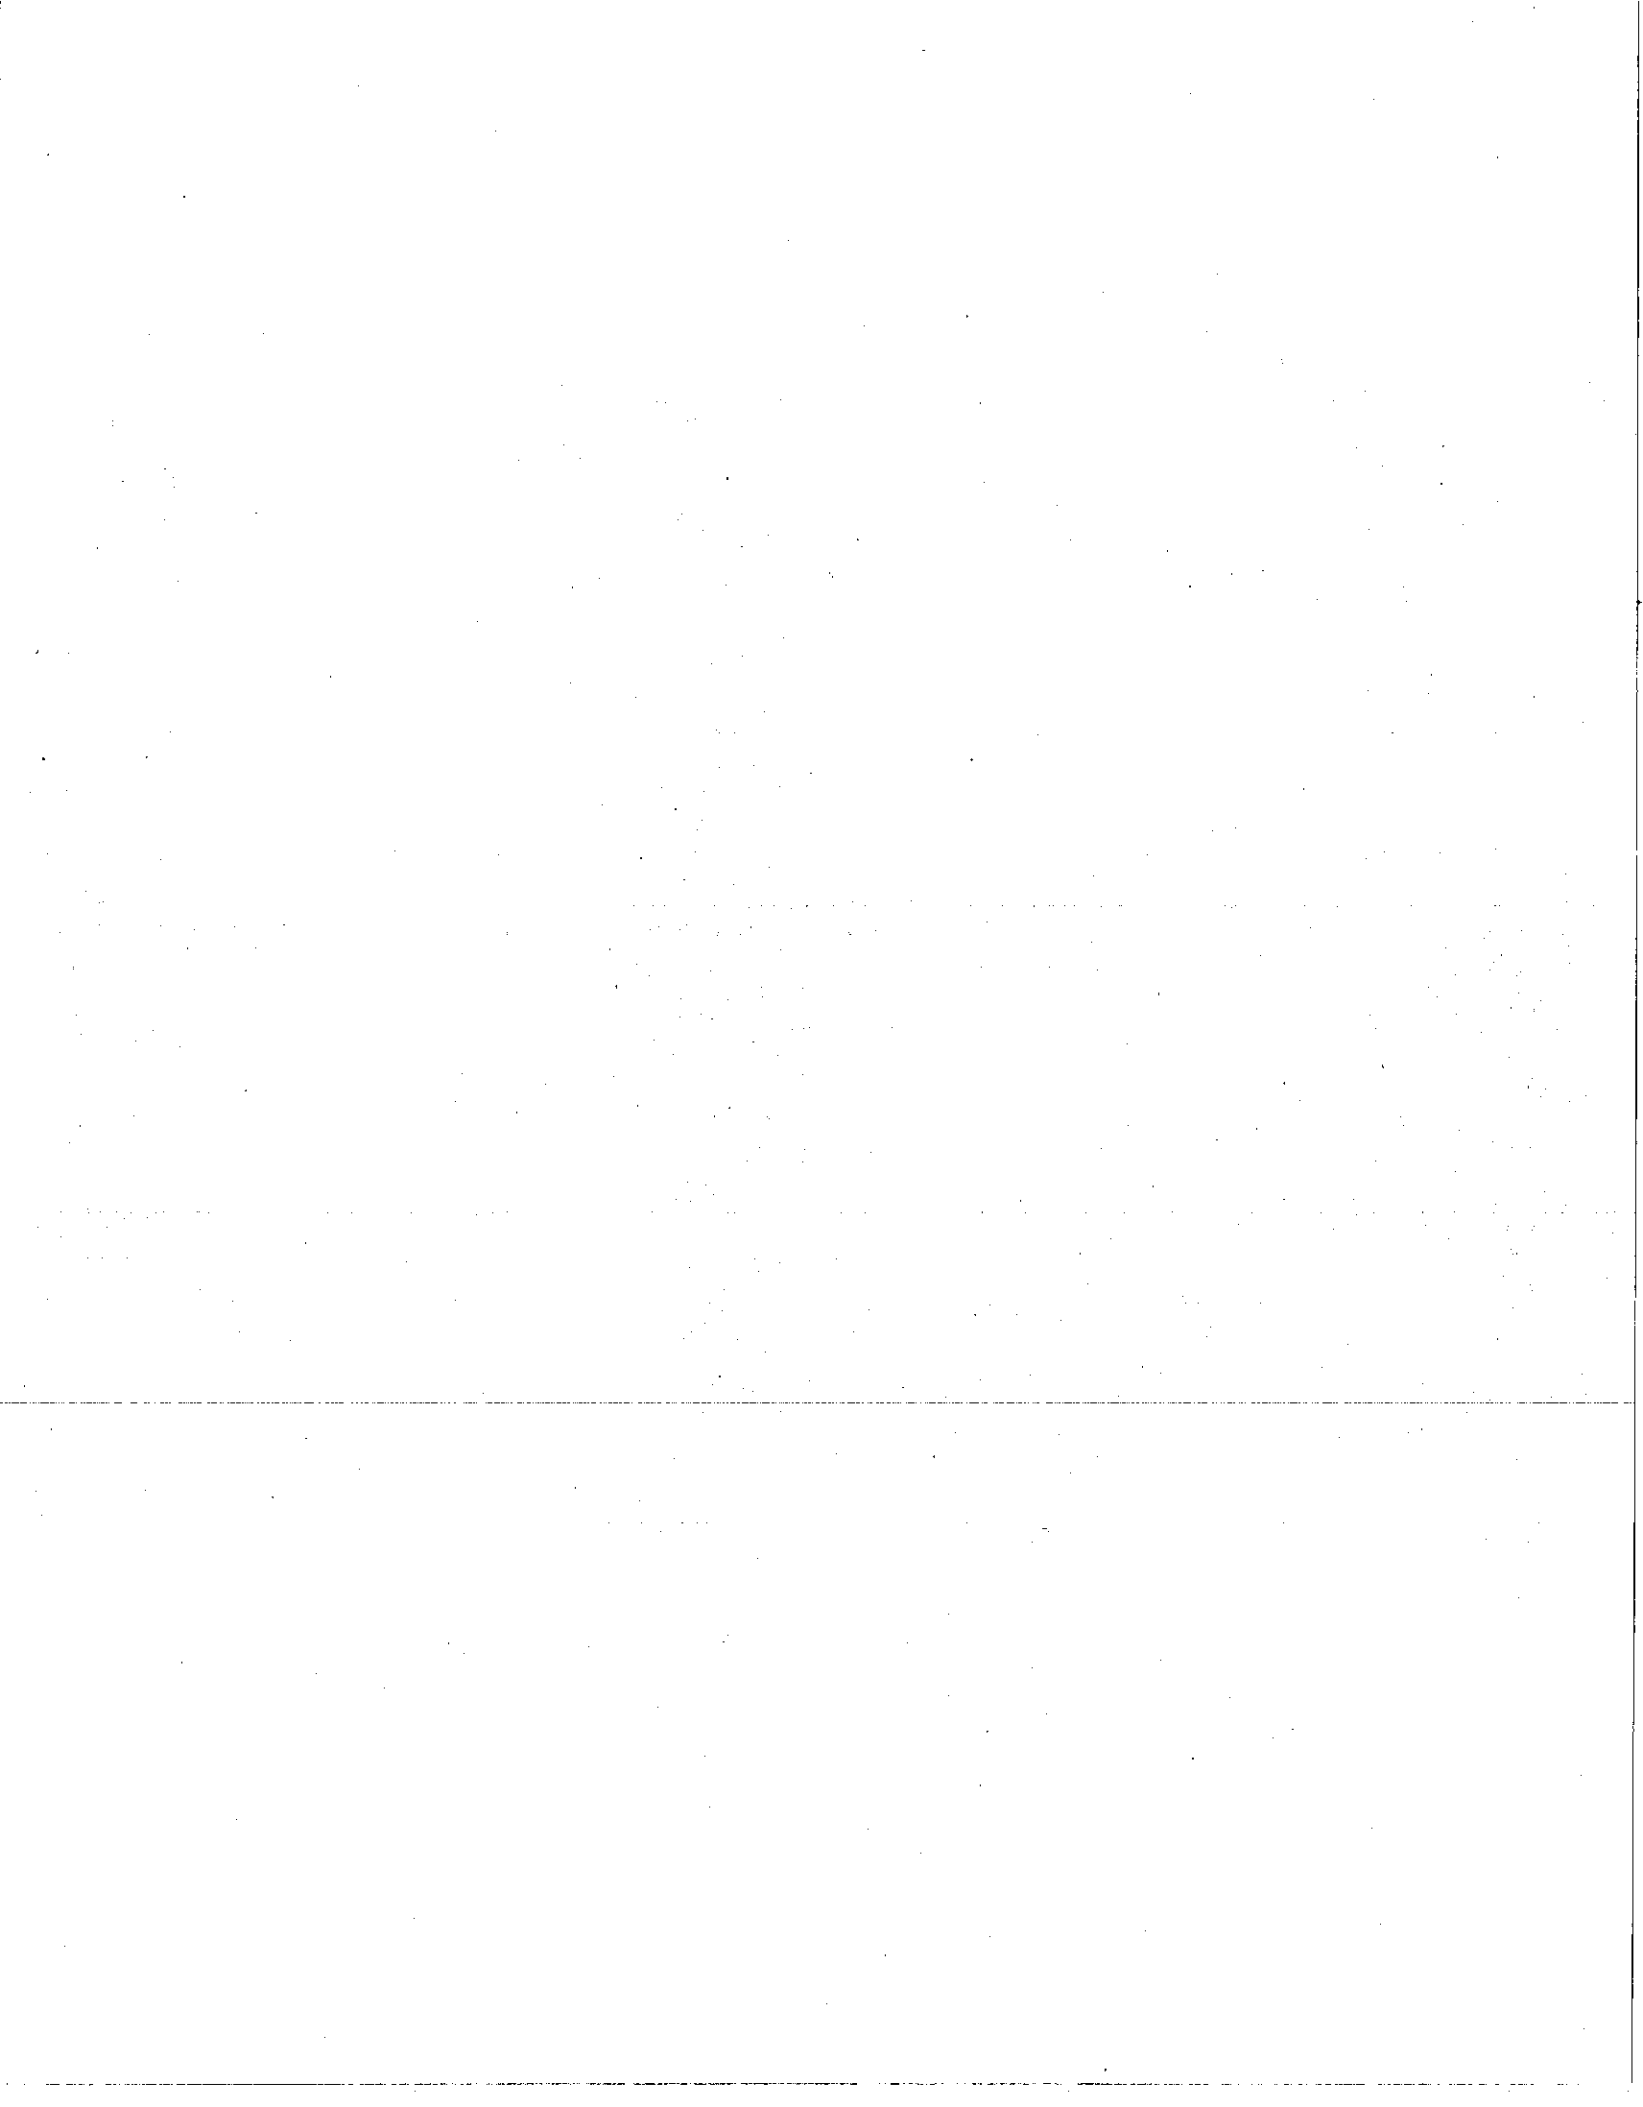

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Antelope Valley District

Distribution Equipment	Inspection Cycles										Circuits				
	(Maximum Intervals in Years)										Total Inventory	Total Circuits	Required	Patrolled (1)	%
	Patrol		Detailed		Intrusive										
	Urban	Rural	Urban	Rural	Urban	Rural	Urban	Rural							
Transformers															
Overhead	1	2	5	5	--	--	--	--	13,954						
Underground	1	2	3	3	--	--	--	--	3,691						
Pad Mounted	1	2	5	5	--	--	--	--	4,086						
Sub-Total									21,731						
Switching/Protective Devices															
Overhead	1	2	5	5	--	--	--	--	427						
Underground	1	2	3	3	--	--	--	--	971						
Pad Mounted	1	2	5	5	--	--	--	--	278						
Sub-Total									1,676						
Regulators															
Overhead	1	2	5	5	--	--	--	--	0						
Underground	1	2	3	3	--	--	--	--	0						
Pad Mounted	1	2	5	5	--	--	--	--	0						
Sub-Total									0						
Capacitors															
Overhead	1	2	5	5	--	--	--	--	367						
Underground	1	2	3	3	--	--	--	--	0						
Pad Mounted	1	2	5	5	--	--	--	--	22						
Sub-Total									389						
Conductors, Cables															
Overhead (Conductor Miles)	1	2	5	5	--	--	--	--	7,213						
Street Lights															
Overhead	1	2	--	--	--	--	--	--	30,912						
Wood Poles															
Overhead	1	2	--	--	20	20	--	--	77,467						
Total									139,398	63	83	83	83	100%	

(1) For 1998, SCE patrolled circuits to conduct simple visual inspections of distribution facilities. Underground structures and equipment are not opened on Circuit Patrol Inspections.

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Antelope Valley District

		1998		Inspections		Patrol		Explanation For Balance (> 0)		Recovery Date
Distribution Equipment		Planned (1)	Complete (2)	Balance Remaining						
Transformers										
Overhead		13,954	13,954	0						
Underground		3,691	3,691	0						
Pad Mounted		4,086	4,086	0						
	Sub-Total	21,731	21,731	0						
Switching/Protective Devices										
Overhead		427	427	0						
Underground		971	971	0						
Pad Mounted		278	278	0						
	Sub-Total	1,676	1,676	0						
Regulators										
Overhead		0	0	0						
Underground		0	0	0						
Pad Mounted		0	0	0						
	Sub-Total	0	0	0						
Capacitors										
Overhead		367	367	0						
Underground		0	0	0						
Pad Mounted		22	22	0						
	Sub-Total	389	389	0						
Conductors, Cables										
Overhead (Conductor Miles)		7,213	7,213	0						
Street Lights										
		30,912	30,912	0						
Wood Poles										
		77,467	77,467	0						
	Total	139,388	139,388	0						
<p>(1) Planned Patrol Inspections are based on Required Circuit Patrols (excl Streetlights). Planned amounts are different from 1997 GO 165 Report due to changes in the inventory and the quantity of required circuit patrols.</p> <p>(2) Completed Patrol Inspections are based on the percentage of total patrolled circuits (excl Streetlights).</p>										

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Antelope Valley District

		1998			Inspections		Detail/Intrusive			
		Planned	Complete	Balance Remaining	Explanation For Balance (> 0)				Recovery Date	
Distribution Equipment										
Transformers										
	Overhead	0	0	0						
	Underground	864	943	0						
	Pad Mounted	555	670	0						
	Sub-Total/	1,419	1,613	0						
Switching/Protective Devices										
	Overhead	0	0	0						
	Underground	282	282	0						
	Pad Mounted	95	140	0						
	Sub-Total/	377	422	0						
Regulators										
	Overhead	0	0	0						
	Underground	0	0	0						
	Pad Mounted	0	0	0						
	Sub-Total/	0	0	0						
Capacitors										
	Overhead	0	0	0						
	Underground	0	0	0						
	Pad Mounted	2	3	0						
	Sub-Total/	2	3	0						
Conductors, Cables										
	Overhead (Conductor Miles)	0	0	0						
Street Lights										
		N/A	N/A	N/A						
Wood Poles										
		0	149	0						
	Total	1,798	2,187	0						

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Antelope Valley District

		1998		
		Inspections (1)(2)		
		Summary		
Distribution Equipment	Planned	Complete	Balance Remaining	
Transformers				
Overhead	13,954	13,954	0	
Underground	4,555	4,634	0	
Pad Mounted	4,641	4,756	0	
Sub-Total	23,150	23,344	0	
Switching/Protective Devices				
Overhead	427	427	0	
Underground	1,253	1,253	0	
Pad Mounted	373	418	0	
Sub-Total	2,053	2,098	0	
Regulators				
Overhead	0	0	0	
Underground	0	0	0	
Pad Mounted	0	0	0	
Sub-Total	0	0	0	
Capacitors				
Overhead	367	367	0	
Underground	0	0	0	
Pad Mounted	24	25	0	
Sub-Total	391	392	0	
Conductors, Cables				
Overhead (Conductor Miles)	7,213	7,213	0	
Street Lights				
	30,912	30,912	0	
Wood Poles				
	77,467	77,616	0	
Total	141,186	141,575	0	
(1) Total inspections may exceed total inventory of an asset as equipment may be inspected twice in a year.				
(2) Includes Patrols + Details/Intrusives.				

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Antelope Valley District

		1998						
		Condition Rating						
Distribution Equipment	Level 1, 2, 3 Total	% (1)	Level 4 Total	% (1)	Level 5 Total	% (1)	Summary(2)	
							Total	% (1)
Transformers								
Overhead	13,864	99.5%	3	0.0%	67	0.5%	13,954	100.0%
Underground	4,624	99.8%	4	0.1%	6	0.1%	4,634	100.0%
Pad Mounted	4,743	99.7%	8	0.2%	5	0.1%	4,756	100.0%
Sub-Total	23,231	99.6%	15	0.1%	78	0.3%	23,344	100.0%
Switching/Protective Devices								
Overhead	418	97.9%	1	0.2%	8	1.9%	427	100.0%
Underground	1,249	99.7%	1	0.1%	3	0.2%	1,253	100.0%
Pad Mounted	417	99.8%	1	0.2%	0	0.0%	418	100.0%
Sub-Total	2,084	99.3%	3	0.1%	11	0.5%	2,098	100.0%
Regulators								
Overhead	0	0.0%	0	0.0%	0	0.0%	0	0.0%
Underground	0	0.0%	0	0.0%	0	0.0%	0	0.0%
Pad Mounted	0	0.0%	0	0.0%	0	0.0%	0	0.0%
Sub-Total	0	0.0%	0	0.0%	0	0.0%	0	0.0%
Capacitors								
Overhead	349	95.1%	14	3.8%	4	1.1%	367	100.0%
Underground	0	0.0%	0	0.0%	0	0.0%	0	0.0%
Pad Mounted	25	100.0%	0	0.0%	0	0.0%	25	100.0%
Sub-Total	374	95.4%	14	3.6%	4	1.0%	392	100.0%
Conductors, Cables								
Overhead (Conductor Miles)	7,213	100.0%	0	0.0%	0	0.0%	7,213	100.0%
Street Lights								
	30,912	100.0%	0	0.0%	0	0.0%	30,912	100.0%
Wood Poles								
	77,588	100.0%	16	0.0%	12	0.0%	77,616	100.0%
Total	141,422	99.9%	48	0.0%	105	0.1%	141,575	100.0%
		(1) Percentage of Total Completed Inspections						
		(2) Total condition rating exceeds total inventory as it includes patrol and detailed/intrusive inspections.						

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Antelope Valley District


		1998		Corrective Action				
Distribution Equipment	Scheduled	Level 4			Level 5			
		Completed	Balance		Completed	Balance		
			Remaining	% (1)		Remaining	% (1)	
Transformers								
Overhead	3	4	0	0.0%	0	67	0	0.0%
Underground	15	17	0	0.0%	0	6	0	0.0%
Pad Mounted	6	7	0	0.0%	0	5	0	0.0%
Sub-Total	24	28	0	0.0%	0	78	0	0.0%
Switching/Protective Devices								
Overhead	1	7	0	0.0%	0	8	0	0.0%
Underground	0	1	0	0.0%	0	3	0	0.0%
Pad Mounted	0	1	0	0.0%	0	0	0	0.0%
Sub-Total	1	9	0	0.0%	0	11	0	0.0%
Regulators								
Overhead	0	0	0	0.0%	0	0	0	0.0%
Underground	0	0	0	0.0%	0	0	0	0.0%
Pad Mounted	0	0	0	0.0%	0	0	0	0.0%
Sub-Total	0	0	0	0.0%	0	0	0	0.0%
Capacitors								
Overhead	0	25	0	0.0%	0	4	0	0.0%
Underground	0	0	0	0.0%	0	0	0	0.0%
Pad Mounted	0	0	0	0.0%	0	0	0	0.0%
Sub-Total	0	25	0	0.0%	0	4	0	0.0%
Conductors, Cables								
Overhead (Conductor Miles)	0	0	0	0.0%	0	0	0	0.0%
Street Lights								
	0	0	0	0.0%	0	0	0	0.0%
Wood Poles								
	0	294	0	0.0%	0	3	0	0.0%
Total	25	356	0	0.0%	0	96	0	0.0%
(1) Percentage of remaining Corrective Actions								

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Antelope Valley District

1998							Corrective Action	Recovery Date
Summary (2)							Explanation For Balance (> 0)	
Distribution Equipment	Scheduled	Completed	Balance Remaining	% (1)				
Transformers								
Overhead	3	71	0	0.0%				
Underground	15	23	0	0.0%				
Pad Mounted	6	12	0	0.0%				
Sub-Total	24	106	0	0.0%				
Switching/Protective Devices								
Overhead	1	15	0	0.0%				
Underground	0	4	0	0.0%				
Pad Mounted	0	1	0	0.0%				
Sub-Total	1	20	0	0.0%				
Regulators								
Overhead	0	0	0	0.0%				
Underground	0	0	0	0.0%				
Pad Mounted	0	0	0	0.0%				
Sub-Total	0	0	0	0.0%				
Capacitors								
Overhead	0	29	0	0.0%				
Underground	0	0	0	0.0%				
Pad Mounted	0	0	0	0.0%				
Sub-Total	0	29	0	0.0%				
Conductors, Cables								
Overhead (Conductor Miles)	0	0	0	0.0%				
Street Lights								
	0	0	0	0.0%				
Wood Poles								
	0	297	0	0.0%				
Total	25	452	0	0.0%				
(1) Percentage of remaining Corrective Actions								
(2) Summary = Condition Level 4 + Condition Level 5 from Page 6.								

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Antelope Valley District

	1999				1999		
	Inspections		Corrective Actions				
	Detail/Intru	1999 Planned	Detail/Intrusive	Total Planned	'98 Balance Remaining	1999 Planned (a)	Total Planned
Distribution Equipment	'98 Balance Remaining	Patrol (1)	Intrusive	Planned	Remaining	Planned (a)	Total Planned
Transformers							
Overhead	0	13,954	0	13,954	0	0	0
Underground	0	3,691	1,513	5,204	0	1	1
Pad Mounted	0	4,086	593	4,679	0	7	7
Sub-Total	0	21,731	2,106	23,837	0	8	8
Switching/Protective Devices							
Overhead	0	427	0	427	0	2	2
Underground	0	971	282	1,253	0	0	0
Pad Mounted	0	278	95	373	0	0	0
Sub-Total	0	1,676	377	2,053	0	2	2
Regulators							
Overhead	0	0	0	0	0	0	0
Underground	0	0	0	0	0	0	0
Pad Mounted	0	0	0	0	0	0	0
Sub-Total	0	0	0	0	0	0	0
Capacitors							
Overhead	0	367	0	367	0	0	0
Underground	0	0	0	0	0	0	0
Pad Mounted	0	22	0	22	0	0	0
Sub-Total	0	389	0	389	0	0	0
Conductors, Cables							
Overhead (Conductor Miles)	0	7,213	0	7,213	0	0	0
Street Lights							
	N/A	30,912	N/A	30,912	0	0	0
Wood Poles							
	0	77,467	6,000	83,467	0	39	39
Total	0	139,388	8,483	147,871	0	49	49
(1) District is required to patrol 100% of its circuits in 1999. 100% of street lights are planned to be patrolled in 1999.							
(2) Corrective actions planned to be completed in 1999 based on items found through previous inspections.							

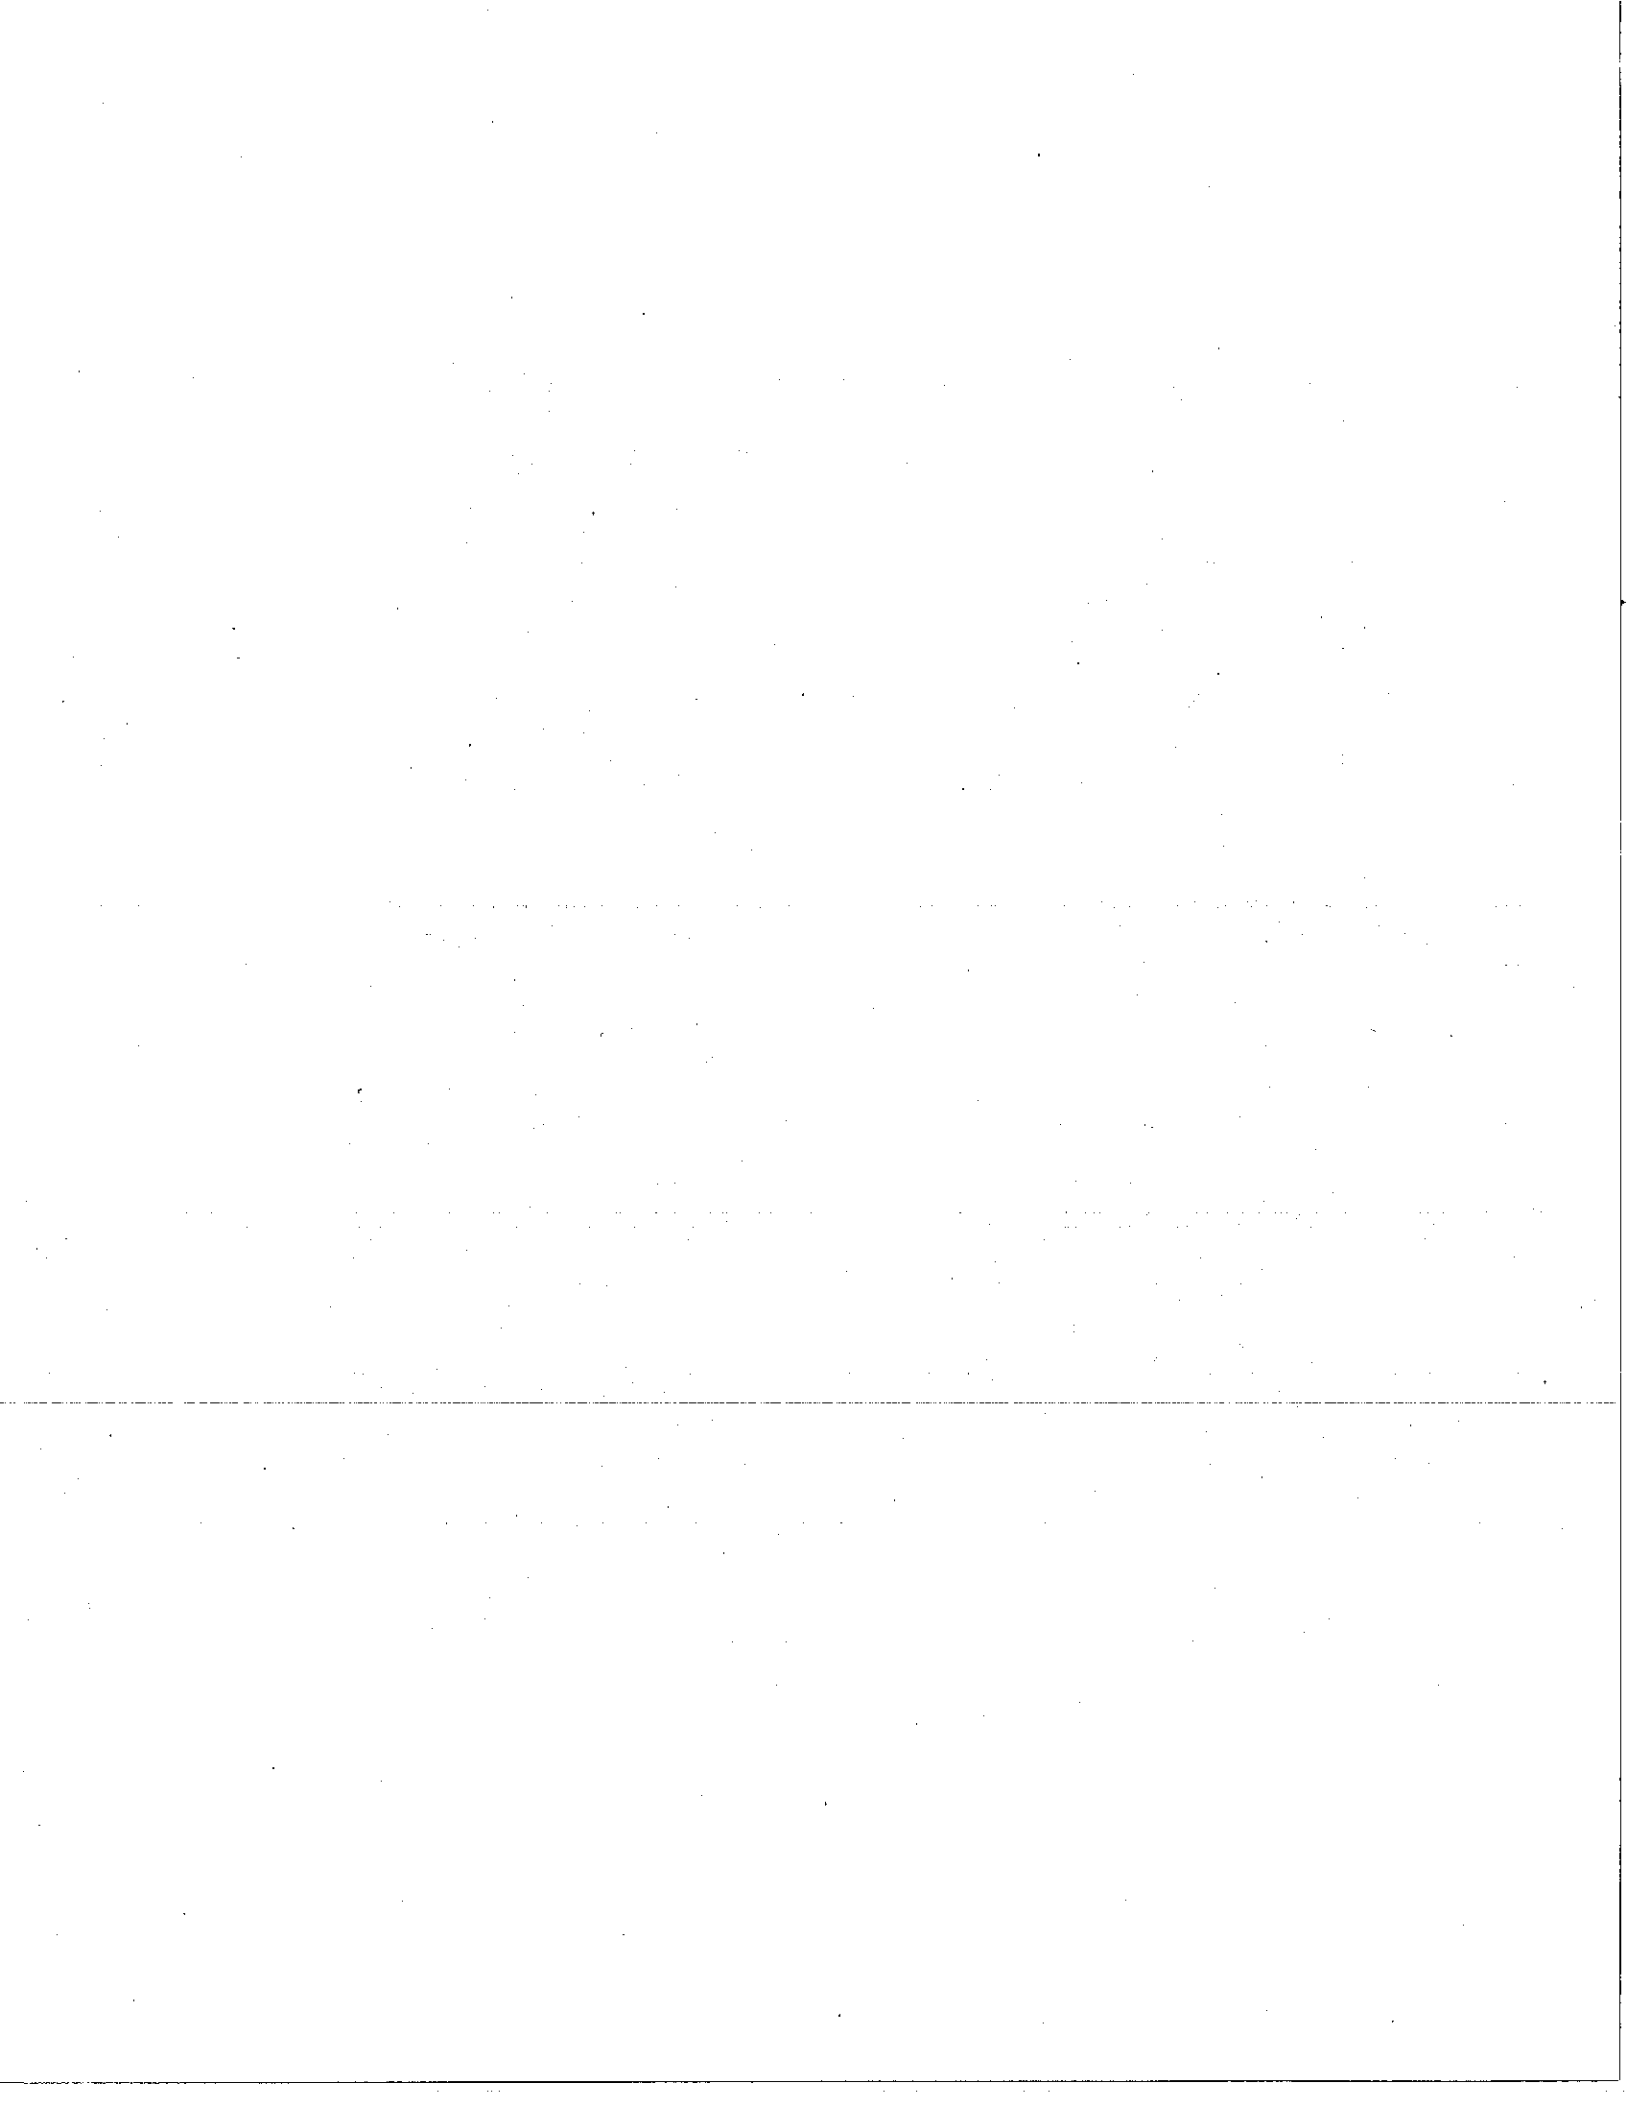

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Ventura District

		Inspection Cycles						1998		Circuits				
		(Maximum Intervals In Years)												
Distribution Equipment	Patrol	Urban		Rural		Urban	Rural	Instructive	Rural	Inventory	Total Circuits	Required	Patrolled (1)	%
		Urban	Rural	Urban	Rural									
Transformers														
Overhead	1	2	5	5	5	--	--	--	--	17,929				
Underground	1	2	3	3	3	--	--	--	--	2,883				
Pad Mounted	1	2	5	5	5	--	--	--	--	4,238				
Sub-Total										25,050				
Switching/Protective Devices														
Overhead	1	2	5	5	5	--	--	--	--	133				
Underground	1	2	3	3	3	--	--	--	--	1,158				
Pad Mounted	1	2	5	5	5	--	--	--	--	146				
Sub-Total										1,437				
Regulators														
Overhead	1	2	5	5	5	--	--	--	--	0				
Underground	1	2	3	3	3	--	--	--	--	0				
Pad Mounted	1	2	5	5	5	--	--	--	--	0				
Sub-Total										0				
Capacitors														
Overhead	1	2	5	5	5	--	--	--	--	264				
Underground	1	2	3	3	3	--	--	--	--	2				
Pad Mounted	1	2	5	5	5	--	--	--	--	43				
Sub-Total										309				
Conductors, Cables														
Overhead (Conductor Miles)	1	2	5	5	5	--	--	--	--	7,039				
Street Lights														
	1	2	--	--	--	--	--	--	--	24,782				
Wood Poles														
	1	2	--	--	--	20	20	20	20	69,746				
Total										128,363	97	97	97	100%
(1) For 1998, SCE patrolled circuits to conduct simple visual inspections of distribution facilities. Underground structures and equipment are not opened on Circuit Patrol Inspections.														

**General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Ventura District**

		1998							
		Inspections							
		Patrol							
Distribution Equipment	Planned (1)	Complete (2)	Balance Remaining	Explanation For Balance (> 0)	Recovery Date				
Transformers									
Overhead	17,929	17,929	0						
Underground	2,883	2,883	0						
Pad Mounted	4,238	4,238	0						
Sub-Total	25,050	25,050	0						
Switching/Protective Devices									
Overhead	133	133	0						
Underground	1,158	1,158	0						
Pad Mounted	146	146	0						
Sub-Total	1,437	1,437	0						
Regulators									
Overhead	0	0	0						
Underground	0	0	0						
Pad Mounted	0	0	0						
Sub-Total	0	0	0						
Capacitors									
Overhead	264	264	0						
Underground	2	2	0						
Pad Mounted	43	43	0						
Sub-Total	309	309	0						
Conductors, Cables									
Overhead (Conductor Miles)	7,039	7,039	0						
Street Lights									
	24,792	24,792	0						
Wood Poles									
	69,746	69,746	0						
Total	128,363	128,363	0						
<p>(1) Planned Patrol Inspections are based on Required Circuit Patrols (excl Streetlights). Planned amounts are different from 1997 GO165 Report due to changes in the inventory and the quantity of required circuit patrols.</p> <p>(2) Completed Patrol Inspections are based on the percentage of total patrolled circuits (excl Streetlights).</p>									

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Ventura District

		1998			Inspections		Detail/Intrusive			
		Planned	Complete	Balance Remaining	Explanation For Balance (> 0)				Recovery Date	
Distribution Equipment										
Transformers										
	Overhead	0	0	0						
	Underground	137	670	0						
	Pad Mounted	393	681	0						
	Sub-Total	530	1,351	0						
Switching/Protective Devices										
	Overhead	0	0	0						
	Underground	381	621	0						
	Pad Mounted	56	97	0						
	Sub-Total	437	718	0						
Regulators										
	Overhead	0	0	0						
	Underground	0	0	0						
	Pad Mounted	0	0	0						
	Sub-Total	0	0	0						
Capacitors										
	Overhead	0	0	0						
	Underground	0	2	0						
	Pad Mounted	6	39	0						
	Sub-Total	6	41	0						
Conductors, Cables										
	Overhead (Conductor Miles)	0	0	0						
Street Lights										
		N/A	N/A	N/A						
Wood Poles										
		3,748	535	3,213						
	Total	4,721	2,645	3,213						
					Inspection quantities moved to Covina (#26) and Huntington Beach (#33) Districts					
					31-Dec-06					

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Ventura District

		1998		
		Inspections (1)(2)		
		Summary		
Distribution Equipment		Planned	Complete	Balance Remaining
Transformers				
Overhead		17,929	17,929	0
Underground		3,020	3,553	0
Pad Mounted		4,631	4,919	0
	Sub-Total	25,580	26,401	0
Switching/Protective Devices				
Overhead		133	133	0
Underground		1,539	1,779	0
Pad Mounted		202	243	0
	Sub-Total	1,874	2,155	0
Regulators				
Overhead		0	0	0
Underground		0	0	0
Pad Mounted		0	0	0
	Sub-Total	0	0	0
Capacitors				
Overhead		264	264	0
Underground		2	4	0
Pad Mounted		49	82	0
	Sub-Total	315	350	0
Conductors, Cables				
Overhead (Conductor Miles)		7,039	7,039	0
Street Lights				
		24,782	24,782	0
Wood Poles				
		73,494	70,281	3,213
	Total	133,084	131,008	3,213
(1) Total inspections may exceed total inventory of an asset as equipment may be inspected twice in a year.				
(2) Includes Patrols + Details/Intrusives.				

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Ventura District

		1998							
		Condition Rating							
Distribution Equipment		Level 1, 2, 3		Level 4		Level 5		Summary (a)	
		Total	% (1)	Total	% (1)	Total	% (1)	Total	% (1)
Transformers									
Overhead		17,828	99.4%	5	0.0%	96	0.5%	17,929	100.0%
Underground		3,550	99.9%	3	0.1%	0	0.0%	3,553	100.0%
Pad Mounted		4,908	99.6%	10	0.2%	1	0.0%	4,919	100.0%
Sub-Total		26,286	99.6%	18	0.1%	97	0.4%	26,401	100.0%
Switching/Protective Devices									
Overhead		126	94.7%	1	0.8%	6	4.5%	133	100.0%
Underground		1,775	99.8%	4	0.2%	0	0.0%	1,779	100.0%
Pad Mounted		241	99.2%	2	0.8%	0	0.0%	243	100.0%
Sub-Total		2,142	99.4%	7	0.3%	6	0.3%	2,155	100.0%
Regulators									
Overhead		0	0.0%	0	0.0%	0	0.0%	0	0.0%
Underground		0	0.0%	0	0.0%	0	0.0%	0	0.0%
Pad Mounted		0	0.0%	0	0.0%	0	0.0%	0	0.0%
Sub-Total		0	0.0%	0	0.0%	0	0.0%	0	0.0%
Capacitors									
Overhead		250	94.7%	8	3.0%	6	2.3%	264	100.0%
Underground		4	100.0%	0	0.0%	0	0.0%	4	100.0%
Pad Mounted		82	100.0%	0	0.0%	0	0.0%	82	100.0%
Sub-Total		336	96.0%	8	2.3%	6	1.7%	350	100.0%
Conductors, Cables									
Overhead (Conductor Miles)		7,039	100.0%	0	0.0%	0	0.0%	7,039	100.0%
Street Lights									
		24,782	100.0%	0	0.0%	0	0.0%	24,782	100.0%
Wood Poles									
		70,199	99.9%	66	0.1%	16	0.0%	70,281	100.0%
Total		130,784	99.8%	99	0.1%	125	0.1%	131,008	100.0%
		(1) Percentage of Total Completed Inspections							
		(2) Total condition rating exceeds total inventory as it includes patrol and detailed/intrusive inspections.							

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Ventura District

		1998				Corrective Action			
		Level 4		Level 5					
Distribution Equipment	Scheduled	Completed	Balance Remaining	% (1)	Scheduled (2)	Completed	Balance Remaining	% (1)	
Transformers									
Overhead	2	4	0	0.0%	0	97	0	0.0%	
Underground	2	3	0	0.0%	0	0	0	0.0%	
Pad Mounted	26	28	0	0.0%	0	2	0	0.0%	
Sub-Total	30	35	0	0.0%	0	99	0	0.0%	
Switching/Protective Devices									
Overhead	5	8	0	0.0%	0	7	0	0.0%	
Underground	3	4	0	0.0%	0	0	0	0.0%	
Pad Mounted	0	0	0	0.0%	0	0	0	0.0%	
Sub-Total	8	12	0	0.0%	0	7	0	0.0%	
Regulators									
Overhead	0	0	0	0.0%	0	0	0	0.0%	
Underground	0	0	0	0.0%	0	0	0	0.0%	
Pad Mounted	0	0	0	0.0%	0	0	0	0.0%	
Sub-Total	0	0	0	0.0%	0	0	0	0.0%	
Capacitors									
Overhead	0	33	0	0.0%	0	6	0	0.0%	
Underground	0	0	0	0.0%	0	0	0	0.0%	
Pad Mounted	0	0	0	0.0%	0	0	0	0.0%	
Sub-Total	0	33	0	0.0%	0	6	0	0.0%	
Conductors, Cables									
Overhead (Conductor Miles)	0	0	0	0.0%	0	0	0	0.0%	
Street Lights									
	0	0	0	0.0%	0	0	0	0.0%	
Wood Poles									
	0	68	0	0.0%	0	52	0	0.0%	
Total	38	148	0	0.0%	0	164	0	0.0%	
				(1) Percentage of remaining Corrective Actions					
				(2) Pad mounted transformer quantity is different than 1997 GO 165 Report due to a calculation error in last year's report.					

**General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Ventura District**

		1998			Corrective Action		Summary	
Distribution Equipment	Scheduled (1)	Completed	Balance Remaining	% (1)	Explanation For Balance (> 0)	Recovery Date		
Transformers								
Overhead	2	101	0	0.0%				
Underground	2	3	0	0.0%				
Pad Mounted	26	30	0	0.0%				
Sub-Total	30	134	0	0.0%				
Switching/Protective Devices								
Overhead	5	15	0	0.0%				
Underground	3	4	0	0.0%				
Pad Mounted	0	0	0	0.0%				
Sub-Total	8	19	0	0.0%				
Regulators								
Overhead	0	0	0	0.0%				
Underground	0	0	0	0.0%				
Pad Mounted	0	0	0	0.0%				
Sub-Total	0	0	0	0.0%				
Capacitors								
Overhead	0	39	0	0.0%				
Underground	0	0	0	0.0%				
Pad Mounted	0	0	0	0.0%				
Sub-Total	0	39	0	0.0%				
Conductors, Cables								
Overhead (Conductor Miles)	0	0	0	0.0%				
Street Lights								
	0	0	0	0.0%				
Wood Poles								
	0	120	0	0.0%				
Total	38	312	0	0.0%				
(1) Percentage of remaining Corrective Actions (2) Summary = Condition Level 4 + Condition Level 5 from Page 6. (3) Pad mounted transformer quantity is different than 1997 GO 165 Report due to a calculation error in last year's report.								

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Ventura District

	1999						
	Inspections			Corrective Actions			
	Detail/Intru '98 Balance Remaining	1999 Planned Patrol (1)	Detail/ Intrusive	Total Planned	'98 Balance Remaining	1999 Planned (2)	Total Planned
Transformers							
Overhead	0	17,929	0	17,929	0	1	1
Underground	0	2,883	825	3,708	0	4	4
Pad Mounted	0	4,238	197	4,435	0	9	9
Sub-Total	0	25,050	1,022	26,072	0	14	14
Switching/Protective Devices							
Overhead	0	133	0	133	0	11	11
Underground	0	1,158	381	1,539	0	3	3
Pad Mounted	0	146	56	202	0	1	1
Sub-Total	0	1,437	437	1,874	0	15	15
Regulators							
Overhead	0	0	0	0	0	0	0
Underground	0	0	0	0	0	0	0
Pad Mounted	0	0	0	0	0	0	0
Sub-Total	0	0	0	0	0	0	0
Capacitors							
Overhead	0	264	0	264	0	12	12
Underground	0	2	0	2	0	0	0
Pad Mounted	0	43	0	43	0	0	0
Sub-Total	0	309	0	309	0	12	12
Conductors, Cables							
Overhead (Conductor Miles)	0	7,039	0	7,039	0	0	0
Street Lights							
	N/A	24,782	N/A	24,782	0	0	0
Wood Poles							
	0	69,746	0	69,746	0	33	33
Total	0	128,363	1,459	129,822	0	74	74
(1) District is required to patrol 100% of its circuits in 1999. 100% of street lights are planned to be patrolled in 1999.							
(2) Corrective actions planned to be completed in 1999 based on items found through previous inspections.							



General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Santa Barbara District

Distribution Equipment	Inspection Cycles										Circuits					
	(Maximum Intervals In Years)										Total Inventory	Total Circuits	Required	Patrolled (1)	%	
	Patrol		Detailed		Intrusive		Urban		Rural							
	Urban	Rural	Urban	Rural	Urban	Rural	Urban	Rural	Urban	Rural						
Transformers																
Overhead	1	2	5	5	-	-	-	-	9,419							
Underground	1	2	3	3	-	-	-	-	1,553							
Pad Mounted	1	2	5	5	-	-	-	-	1,978							
Sub-Total									12,950							
Switching/Protective Devices																
Overhead	1	2	5	5	-	-	-	-	500							
Underground	1	2	3	3	-	-	-	-	404							
Pad Mounted	1	2	5	5	-	-	-	-	41							
Sub-Total									945							
Regulators																
Overhead	1	2	5	5	-	-	-	-	1							
Underground	1	2	3	3	-	-	-	-	0							
Pad Mounted	1	2	5	5	-	-	-	-	0							
Sub-Total									1							
Capacitors																
Overhead	1	2	5	5	-	-	-	-	176							
Underground	1	2	3	3	-	-	-	-	7							
Pad Mounted	1	2	5	5	-	-	-	-	8							
Sub-Total									191							
Conductors, Cables																
Overhead (Conductor Miles)	1	2	5	5	-	-	-	-	3,370							
Street Lights																
Overhead	1	2	-	-	-	-	-	-	5,183							
Underground	1	2	-	-	-	-	-	-	-							
Pad Mounted	1	2	-	-	-	-	-	-	-							
Wood Poles																
Overhead	1	2	-	-	20	20	-	-	30,802							
Total									53,442							
									75							
									75							
									75							
									100%							

(1) For 1998, SCE patrolled circuits to conduct simple visual inspections of distribution facilities. Underground structures and equipment are not opened on Circuit Patrol Inspections.

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Santa Barbara District

		1998			Inspections		Patrol			
		Planned (1)	Complete (2)	Balance Remaining	Explanation For Balance (> 0)	Recovery Date				
Distribution Equipment										
Transformers										
	Overhead	9,419	9,419	0						
	Underground	1,553	1,553	0						
	Pad Mounted	1,978	1,978	0						
	Sub-Total	12,950	12,950	0						
Switching/Protective Devices										
	Overhead	500	500	0						
	Underground	404	404	0						
	Pad Mounted	41	41	0						
	Sub-Total	945	945	0						
Regulators										
	Overhead	1	1	0						
	Underground	0	0	0						
	Pad Mounted	0	0	0						
	Sub-Total	1	1	0						
Capacitors										
	Overhead	176	176	0						
	Underground	7	7	0						
	Pad Mounted	8	8	0						
	Sub-Total	191	191	0						
Conductors, Cables										
	Overhead (Conductor Miles)	3,370	3,370	0						
Street Lights										
		5,183	5,183	0						
Wood Poles										
		30,802	30,802	0						
	Total	53,442	53,442	0						
		(1) Planned Patrol Inspections are based on Required Circuit Patrols (excl Streetlights). Planned amounts are different from 1997 GO165 Report due to changes in the inventory and the quantity of required circuit patrols. (2) Completed Patrol Inspections are based on the percentage of total patrolled circuits (excl Streetlights).								

**General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Santa Barbara District**

		1998			Inspections		Detail/Intrusive	Explanation For Balance (> 0)	Recovery Date
Distribution Equipment		Planned	Complete	Balance Remaining					
Transformers									
Overhead		0	0	0					
Underground		127	801	0					
Pad Mounted		362	377	0					
	Sub-Total	489	1,178	0					
Switching/Protective Devices									
Overhead		0	0	0					
Underground		213	236	0					
Pad Mounted		6	15	0					
	Sub-Total	219	251	0					
Regulators									
Overhead		0	0	0					
Underground		0	0	0					
Pad Mounted		0	0	0					
	Sub-Total	0	0	0					
Capacitors									
Overhead		0	0	0					
Underground		2	7	0					
Pad Mounted		0	7	0					
	Sub-Total	2	14	0					
Conductors, Cables									
Overhead (Conductor Miles)		0	0	0					
Street Lights									
		N/A	N/A	N/A					
Wood Poles									
		0	438	0					
	Total	710	1,881	0					

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Santa Barbara District

Distribution Equipment	1998		
	Inspections (1)(2)		
	Planned	Complete	Balance Remaining
Transformers			
Overhead	9,419	9,419	0
Underground	1,680	2,354	0
Pad Mounted	2,340	2,355	0
Sub-Total/	13,439	14,128	0
Switching/Protective Devices			
Overhead	500	500	0
Underground	617	640	0
Pad Mounted	47	56	0
Sub-Total/	1,164	1,196	0
Regulators			
Overhead	1	1	0
Underground	0	0	0
Pad Mounted	0	0	0
Sub-Total/	1	1	0
Capacitors			
Overhead	176	176	0
Underground	9	14	0
Pad Mounted	8	15	0
Sub-Total/	193	205	0
Conductors, Cables			
Overhead (Conductor Miles)	3,370	3,370	0
Street Lights			
	5,183	5,183	0
Wood Poles			
	30,802	31,240	0
Total	54,152	55,323	0
(1) Total Inspections may exceed total inventory of an asset as equipment may be inspected twice in a year.			
(2) Includes Patrols + Details/Intrusives.			

**General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Santa Barbara District**

		1998						
		Condition Rating						
		Level 1, 2, 3	Level 4	Level 5		Summary		
		Total	% (1)	Total	% (1)	Total	% (1)	
Distribution Equipment								
Transformers								
Overhead		9,355	99.3%	5	0.1%	59	0.6%	
Underground		2,351	99.9%	2	0.1%	1	0.0%	
Pad Mounted		2,346	99.6%	9	0.4%	0	0.0%	
	<i>Sub-Total</i>	14,052	99.5%	16	0.1%	60	0.4%	
Switching/Protective Devices								
Overhead		491	98.2%	4	0.8%	5	1.0%	
Underground		639	99.8%	1	0.2%	0	0.0%	
Pad Mounted		56	100.0%	0	0.0%	0	0.0%	
	<i>Sub-Total</i>	1,186	99.2%	5	0.4%	5	0.4%	
Regulators								
Overhead		1	100.0%	0	0.0%	0	0.0%	
Underground		0	0.0%	0	0.0%	0	0.0%	
Pad Mounted		0	0.0%	0	0.0%	0	0.0%	
	<i>Sub-Total</i>	1	100.0%	0	0.0%	0	0.0%	
Capacitors								
Overhead		160	90.9%	14	8.0%	2	1.1%	
Underground		14	100.0%	0	0.0%	0	0.0%	
Pad Mounted		15	100.0%	0	0.0%	0	0.0%	
	<i>Sub-Total</i>	189	92.2%	14	6.8%	2	1.0%	
Conductors, Cables								
Overhead (Conductor Miles)		3,370	100.0%	0	0.0%	0	0.0%	
Street Lights								
		5,183	100.0%	0	0.0%	0	0.0%	
Wood Poles								
		31,157	99.7%	53	0.2%	30	0.1%	
	<i>Total</i>	55,138	99.7%	88	0.2%	97	0.2%	
		(1) Percentage of Total Completed Inspections						
		(2) Total condition rating exceeds total inventory as it includes patrol and detailed/inclusive inspections.						

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Santa Barbara District

		1998				Corrective Action			
		Level 4		Level 5					
Distribution Equipment	Scheduled	Completed	Balance Remaining	% (1)	Scheduled	Completed	Balance Remaining	% (1)	
Transformers									
Overhead	0	5	0	0.0%	0	55	0	0.0%	
Underground	4	6	0	0.0%	0	1	0	0.0%	
Pad Mounted	3	3	0	0.0%	0	0	0	0.0%	
Sub-Total	7	14	0	0.0%	0	56	0	0.0%	
Switching/Protective Devices									
Overhead	0	7	0	0.0%	0	5	0	0.0%	
Underground	8	8	0	0.0%	0	0	0	0.0%	
Pad Mounted	0	0	0	0.0%	0	0	0	0.0%	
Sub-Total	8	15	0	0.0%	0	5	0	0.0%	
Regulators									
Overhead	0	0	0	0.0%	0	0	0	0.0%	
Underground	0	0	0	0.0%	0	0	0	0.0%	
Pad Mounted	0	0	0	0.0%	0	0	0	0.0%	
Sub-Total	0	0	0	0.0%	0	0	0	0.0%	
Capacitors									
Overhead	0	23	0	0.0%	0	2	0	0.0%	
Underground	0	0	0	0.0%	0	0	0	0.0%	
Pad Mounted	0	0	0	0.0%	0	0	0	0.0%	
Sub-Total	0	23	0	0.0%	0	2	0	0.0%	
Conductors, Cables									
Overhead (Conductor Miles)	0	0	0	0.0%	0	0	0	0.0%	
Street Lights									
	0	0	0	0.0%	0	0	0	0.0%	
Wood Poles									
	0	304	0	0.0%	25	10	15	60.0%	
Total	15	356	0	0.0%	25	73	15	60.0%	
(1) Percentage of remaining Corrective Actions									

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Santa Barbara District

		1998		Corrective Action		Summary ⁽²⁾				Recovery Date
Distribution Equipment	Scheduled	Completed	Balance Remaining	% (1)	Explanation For Balance (> 0)					
Transformers										
Overhead	0	60	0	0.0%						
Underground	4	7	0	0.0%						
Pad Mounted	3	3	0	0.0%						
Sub-Total	7	70	0	0.0%						
Switching/Protective Devices										
Overhead	0	12	0	0.0%						
Underground	8	8	0	0.0%						
Pad Mounted	0	0	0	0.0%						
Sub-Total	8	20	0	0.0%						
Regulators										
Overhead	0	0	0	0.0%						
Underground	0	0	0	0.0%						
Pad Mounted	0	0	0	0.0%						
Sub-Total	0	0	0	0.0%						
Capacitors										
Overhead	0	25	0	0.0%						
Underground	0	0	0	0.0%						
Pad Mounted	0	0	0	0.0%						
Sub-Total	0	25	0	0.0%						
Conductors, Cables										
Overhead (Conductor Miles)	0	0	0	0.0%						
Street Lights										
	0	0	0	0.0%						
Wood Poles										
	25	314	15	60.0%	Additional repairs/replacements were performed in other districts.					31-Dec-99
Total	40	429	15	37.5%						
(1) Percentage of remaining Corrective Actions										
(2) Summary = Condition Level 4 + Condition Level 5 from Page 6.										

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Santa Barbara District

	1999					
	Inspections			Corrective Actions		
	Detail/Intrusive Remaining	1999 Planned	Total Planned	'98 Balance Remaining	1999 Planned (a)	Total Planned
Distribution Equipment						
Transformers						
Overhead	0	9,419	0	9,419	0	3
Underground	0	1,553	252	1,805	0	1
Pad Mounted	0	1,978	44	2,022	0	9
Sub-Total	0	12,950	296	13,246	0	13
Switching/Protective Devices						
Overhead	0	500	0	500	0	2
Underground	0	404	213	617	0	1
Pad Mounted	0	41	6	47	0	0
Sub-Total	0	945	219	1,164	0	3
Regulators						
Overhead	0	1	0	1	0	0
Underground	0	0	0	0	0	0
Pad Mounted	0	0	0	0	0	0
Sub-Total	0	1	0	1	0	0
Capacitors						
Overhead	0	176	0	176	0	14
Underground	0	7	0	7	0	0
Pad Mounted	0	8	0	8	0	0
Sub-Total	0	191	0	191	0	14
Conductors, Cables						
Overhead (Conductor Miles)	0	3,370	0	3,370	0	0
Street Lights	N/A	5,183	N/A	5,183	0	0
Wood Poles	0	30,802	0	30,802	15	56
Total	0	53,442	515	53,957	15	86
<p>(1) District is required to patrol 100% of its circuits in 1999. 100% of street lights are planned to be patrolled in 1999.</p>						
<p>(2) Corrective actions planned to be completed in 1999 based on items found through previous inspections.</p>						



General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
San Joaquin District

Inspection Cycles										1998		Circuits		
(Maximum Intervals In Years)														
Distribution Equipment	Patrol		Detailed		Intrusive		Total Inventory	Total Circuits	Required	Patrolled (1)	%			
	Urban	Rural	Urban	Rural	Urban	Rural								
Transformers														
Overhead	1	2	5	5	--	--	63,828							
Underground	1	2	3	3	--	--	3,571							
Pad Mounted	1	2	5	5	--	--	3,262							
Sub-Total							70,661							
Switching/Protective Devices														
Overhead	1	2	5	5	--	--	276							
Underground	1	2	3	3	--	--	802							
Pad Mounted	1	2	5	5	--	--	159							
Sub-Total							1,237							
Regulators														
Overhead	1	2	5	5	--	--	11							
Underground	1	2	3	3	--	--	1							
Pad Mounted	1	2	5	5	--	--	0							
Sub-Total							12							
Capacitors														
Overhead	1	2	5	5	--	--	940							
Underground	1	2	3	3	--	--	1							
Pad Mounted	1	2	5	5	--	--	11							
Sub-Total							952							
Conductors, Cables														
Overhead (Conductor Miles)	1	2	5	5	--	--	18,493							
Street Lights														
Overhead	1	2	--	--	--	--	14,626							
Wood Poles														
Overhead	1	2	--	--	20	20	152,883							
Total							258,864	217	217	217	100%			
(1) For 1998, SCE patrolled circuits to conduct simple visual inspections of distribution facilities. Underground structures and equipment are not opened on Circuit Patrol inspections.														

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
San Joaquin District

		1998				
		Inspections				
		Patrol				
					Recovery	
					Date	
Distribution Equipment	Planned (1)	Complete (2)	Balance Remaining	Explanation For Balance (> 0)		
Transformers						
Overhead	63,828	63,828	0			
Underground	3,571	3,571	0			
Pad Mounted	3,262	3,262	0			
Sub-Total	70,661	70,661	0			
Switching/Protective Devices						
Overhead	276	276	0			
Underground	802	802	0			
Pad Mounted	159	159	0			
Sub-Total	1,237	1,237	0			
Regulators						
Overhead	11	11	0			
Underground	1	1	0			
Pad Mounted	0	0	0			
Sub-Total	12	12	0			
Capacitors						
Overhead	940	940	0			
Underground	1	1	0			
Pad Mounted	11	11	0			
Sub-Total	952	952	0			
Conductors, Cables						
Overhead (Conductor Miles)	18,493	18,493	0			
Street Lights						
	14,626	14,626	0			
Wood Poles						
	152,883	152,883	0			
Total	258,864	258,864	0			
		(1) Planned Patrol Inspections are based on Required Circuit Patrols (excl Streetlights).				
		Planned amounts are different from 1997 G0165 Report due to changes in the inventory and the quantity of required circuit patrols.				
		(2) Completed Patrol Inspections are based on the percentage of total patrolled circuits (excl Streetlights).				

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
San Joaquin District

		1998				
		Inspections				
		Detail/Intrusive				
		Planned	Complete	Balance Remaining	Explanation For Balance (> 0)	Recovery Date
Distribution Equipment						
Transformers						
	Overhead	0	0	0		
	Underground	480	706	0		
	Pad Mounted	496	549	0		
	Sub-Total	976	1,255	0		
Switching/Protective Devices						
	Overhead	0	0	0		
	Underground	309	310	0		
	Pad Mounted	30	65	0		
	Sub-Total	339	375	0		
Regulators						
	Overhead	0	0	0		
	Underground	0	0	0		
	Pad Mounted	0	0	0		
	Sub-Total	0	0	0		
Capacitors						
	Overhead	0	0	0		
	Underground	1	1	0		
	Pad Mounted	6	11	0		
	Sub-Total	7	12	0		
Conductors, Cables						
	Overhead (Conductor Miles)	0	0	0		
Street Lights						
		N/A	N/A	N/A		
Wood Poles						
		0	692	0		
	Total	1,322	2,334	0		

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
San Joaquin District

Distribution Equipment	1998		
	Inspections ⁽¹⁾⁽²⁾		
	Planned	Complete	Balance Remaining
Summary			
Transformers			
Overhead	63,828	63,828	0
Underground	4,051	4,277	0
Pad Mounted	3,758	3,811	0
Sub-Total	71,637	71,916	0
Switching/Protective Devices			
Overhead	276	276	0
Underground	1,111	1,112	0
Pad Mounted	189	224	0
Sub-Total	1,576	1,612	0
Regulators			
Overhead	11	11	0
Underground	1	1	0
Pad Mounted	0	0	0
Sub-Total	12	12	0
Capacitors			
Overhead	940	940	0
Underground	2	2	0
Pad Mounted	17	22	0
Sub-Total	959	964	0
Conductors, Cables			
Overhead (Conductor Miles)	18,493	18,493	0
Street Lights			
	14,626	14,626	0
Wood Poles			
	152,883	153,575	0
Total	260,186	261,198	0

(1) Total inspections may exceed total inventory of an asset as equipment may be inspected twice in a year.
(2) Includes Patrols + Details/Intrusives.

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
San Joaquin District

		1998							
		Condition Rating							
		Level 1, 2, 3		Level 4		Level 5		Summary (2)	
Distribution Equipment		Total	% (1)	Total	% (1)	Total	% (1)	Total	% (1)
Transformers									
Overhead		63,659	99.7%	4	0.0%	165	0.3%	63,828	100.0%
Underground		4,277	100.0%	0	0.0%	0	0.0%	4,277	100.0%
Pad Mounted		3,810	100.0%	0	0.0%	1	0.0%	3,811	100.0%
	Sub-Total	71,746	99.8%	4	0.0%	166	0.2%	71,916	100.0%
Switching/Protective Devices									
Overhead		260	94.2%	5	1.8%	11	4.0%	276	100.0%
Underground		1,109	99.7%	2	0.2%	1	0.1%	1,112	100.0%
Pad Mounted		224	100.0%	0	0.0%	0	0.0%	224	100.0%
	Sub-Total	1,593	98.8%	7	0.4%	12	0.7%	1,612	100.0%
Regulators									
Overhead		11	100.0%	0	0.0%	0	0.0%	11	100.0%
Underground		1	100.0%	0	0.0%	0	0.0%	1	100.0%
Pad Mounted		0	0.0%	0	0.0%	0	0.0%	0	0.0%
	Sub-Total	12	100.0%	0	0.0%	0	0.0%	12	100.0%
Capacitors									
Overhead		742	78.9%	166	17.7%	32	3.4%	940	100.0%
Underground		2	100.0%	0	0.0%	0	0.0%	2	100.0%
Pad Mounted		22	100.0%	0	0.0%	0	0.0%	22	100.0%
	Sub-Total	766	79.5%	166	17.2%	32	3.3%	964	100.0%
Conductors, Cables									
Overhead (Conductor Miles)		18,493	100.0%	0	0.0%	0	0.0%	18,493	100.0%
Street Lights									
		14,626	100.0%	0	0.0%	0	0.0%	14,626	100.0%
Wood Poles									
		153,299	99.8%	210	0.1%	66	0.0%	153,575	100.0%
	Total	260,535	99.7%	387	0.1%	276	0.1%	261,198	100.0%
		(1) Percentage of Total Completed Inspections							
		(2) Total condition rating exceeds total inventory as it includes patrol and detailed/intrusive inspections.							

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
San Joaquin District


		1998				Corrective Action			
		Level 4		Balance		Level 5		Balance	
Distribution Equipment	Scheduled	Completed	Remaining	% (1)	Scheduled	Completed	Remaining	% (1)	
Transformers									
Overhead	9	9	0	0.0%	0	161	0	0.0%	
Underground	0	0	0	0.0%	0	0	0	0.0%	
Pad Mounted	0	1	0	0.0%	1	1	0	0.0%	
Sub-Total	9	10	0	0.0%	1	162	0	0.0%	
Switching/Protective Devices									
Overhead	2	23	0	0.0%	0	12	0	0.0%	
Underground	1	1	0	0.0%	0	2	0	0.0%	
Pad Mounted	0	0	0	0.0%	0	0	0	0.0%	
Sub-Total	3	24	0	0.0%	0	14	0	0.0%	
Regulators									
Overhead	0	0	0	0.0%	0	0	0	0.0%	
Underground	0	0	0	0.0%	0	0	0	0.0%	
Pad Mounted	0	0	0	0.0%	0	0	0	0.0%	
Sub-Total	0	0	0	0.0%	0	0	0	0.0%	
Capacitors									
Overhead	1	232	0	0.0%	0	36	0	0.0%	
Underground	0	0	0	0.0%	0	0	0	0.0%	
Pad Mounted	0	0	0	0.0%	0	0	0	0.0%	
Sub-Total	1	232	0	0.0%	0	36	0	0.0%	
Conductors, Cables									
Overhead (Conductor Miles)	0	0	0	0.0%	0	0	0	0.0%	
Street Lights									
	0	0	0	0.0%	0	0	0	0.0%	
Wood Poles									
	2,886	1,618	1,268	43.9%	823	448	375	45.6%	
Total	2,899	1,884	1,268	43.7%	824	660	375	45.5%	
	(1) Percentage of remaining Corrective Actions								

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
San Joaquin District

		1998		Corrective Action		Summary ⁽²⁾		Explanation For Balance (> 0)		Recovery Date	
Distribution Equipment		Scheduled	Completed	Balance Remaining	% (1)						
Transformers											
	Overhead	9	170	0	0.0%						
	Underground	0	0	0	0.0%						
	Pad Mounted	1	2	0	0.0%						
	Sub-Total	10	172	0	0.0%						
Switching/Protective Devices											
	Overhead	2	35	0	0.0%						
	Underground	1	3	0	0.0%						
	Pad Mounted	0	0	0	0.0%						
	Sub-Total	3	38	0	0.0%						
Regulators											
	Overhead	0	0	0	0.0%						
	Underground	0	0	0	0.0%						
	Pad Mounted	0	0	0	0.0%						
	Sub-Total	0	0	0	0.0%						
Capacitors											
	Overhead	1	268	0	0.0%						
	Underground	0	0	0	0.0%						
	Pad Mounted	0	0	0	0.0%						
	Sub-Total	1	268	0	0.0%						
Conductors, Cables											
	Overhead (Conductor Miles)	0	0	0	0.0%						
Street Lights											
		0	0	0	0.0%						
Wood Poles											
		3,709	2,066	1,643	44.3%	Additional repairs/replacements were performed in other districts.					31-Dec-99
	Total	3,723	2,544	1,643	44.1%						
		(1) Percentage of remaining Corrective Actions									
		(2) Summary = Condition Level 4 + Condition Level 5 from Page 6.									

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
San Joaquin District

	1999						
	Inspections			Corrective Actions			
	Detail/Intru '98 Balance Remaining	1999 Planned Patrol ⁽¹⁾	Detail/ Intrusive	Total Planned	'98 Balance Remaining	1999 Planned ⁽²⁾	Total Planned
Distribution Equipment							
Transformers							
Overhead	0	63,828	0	63,828	0	10	10
Underground	0	3,571	1,279	4,850	0	0	0
Pad Mounted	0	3,262	264	3,526	0	0	0
Sub-Total	0	70,661	1,543	72,204	0	10	10
Switching/Protective Devices							
Overhead	0	276	0	276	0	10	10
Underground	0	802	309	1,111	0	2	2
Pad Mounted	0	159	30	189	0	0	0
Sub-Total	0	1,237	339	1,576	0	12	12
Regulators							
Overhead	0	11	0	11	0	0	0
Underground	0	1	0	1	0	0	0
Pad Mounted	0	0	0	0	0	0	0
Sub-Total	0	12	0	12	0	0	0
Capacitors							
Overhead	0	940	0	940	0	0	0
Underground	0	1	0	1	0	0	0
Pad Mounted	0	11	0	11	0	0	0
Sub-Total	0	952	0	952	0	0	0
Conductors, Cables							
Overhead (Conductor Miles)	0	18,493	0	18,493	0	0	0
Street Lights							
	N/A	14,626	N/A	14,626	0	0	0
Wood Poles							
	0	152,883	0	152,883	1,643	343	1,986
Total	0	256,864	1,882	260,746	1,643	365	2,008
	(1) District is required to patrol 100% of its circuits in 1999.						
	100% of street lights are planned to be patrolled in 1999.						
	(2) Corrective actions planned to be completed in 1999 based on items found through previous inspections.						

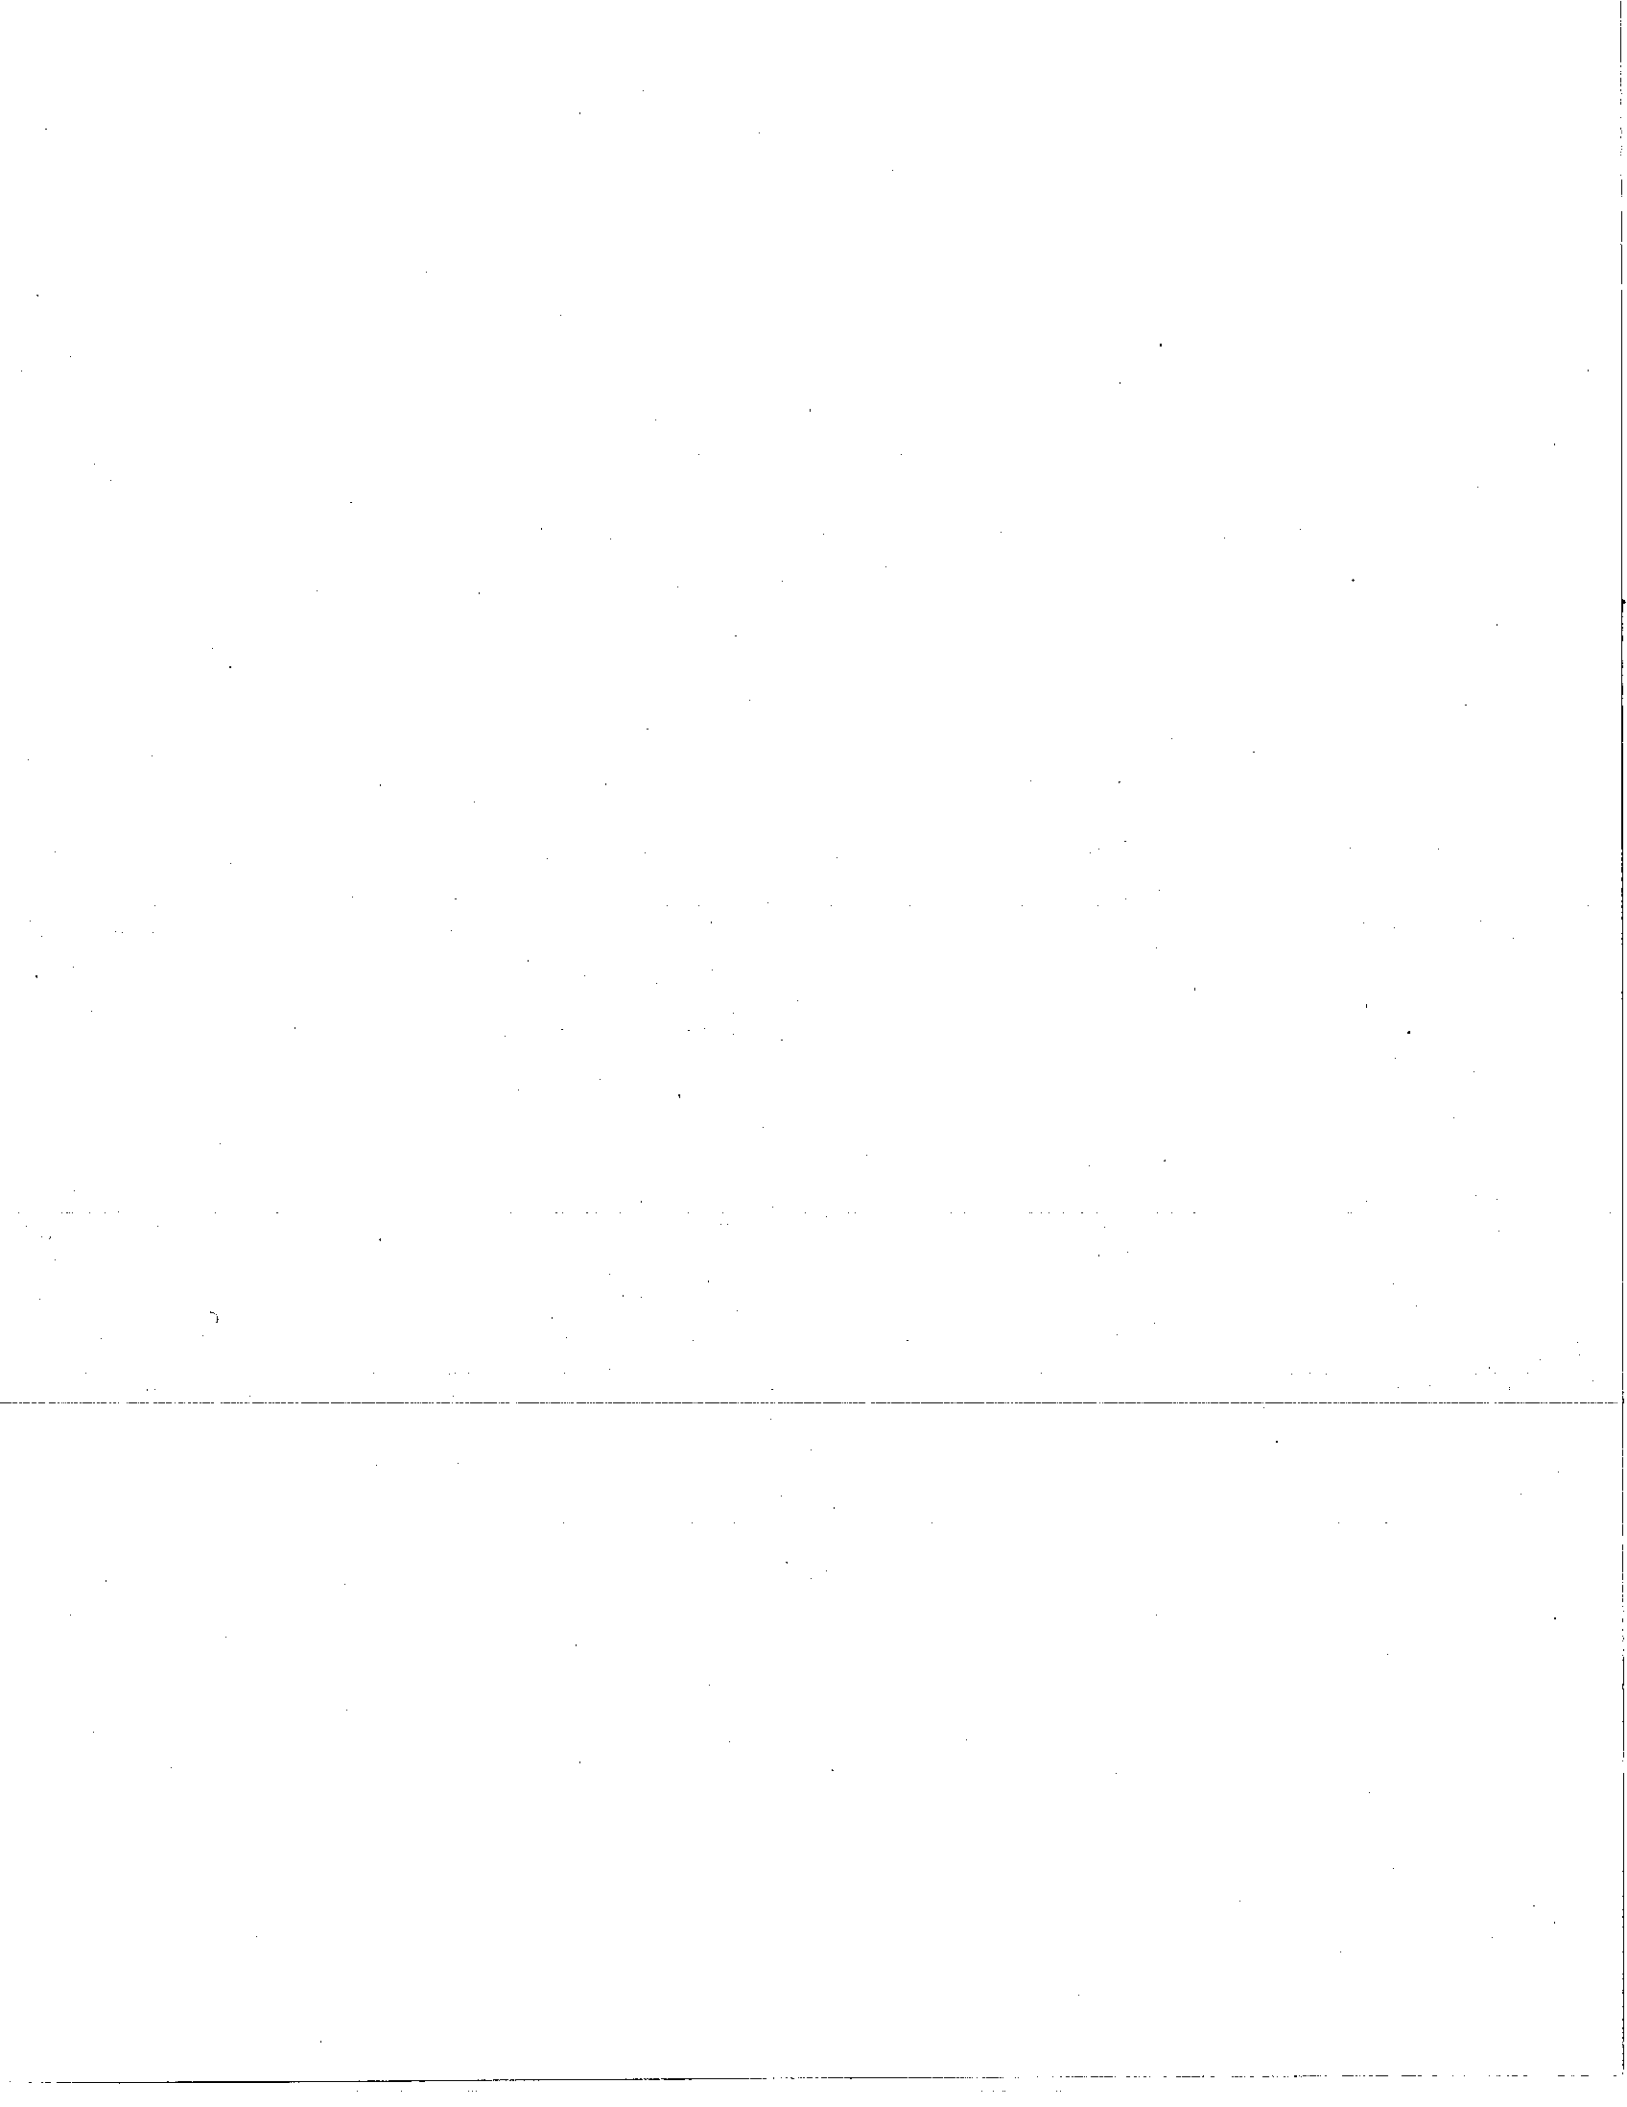

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Valencia District

Distribution Equipment	Inspection Cycles										Circuits		%		
	(Maximum Intervals in Years)										Total Inventory	Total Circuits		Required	Patrolled (1)
	Patrol		Detailed		Intrusive		Total	Circuits	Required	Patrolled (1)					
Urban	Rural	Urban	Rural	Urban	Rural	Urban					Rural	Urban	Rural	Total	Total
Transformers															
Overhead	1	2	5	5	5	5	5	5	5	5	7,893				
Underground	1	2	3	3	3	3	3	3	3	3	1,746				
Pad Mounted	1	2	5	5	5	5	5	5	5	5	4,302				
Sub-Total											13,741				
Switching/Protective Devices															
Overhead	1	2	5	5	5	5	5	5	5	5	90				
Underground	1	2	3	3	3	3	3	3	3	3	988				
Pad Mounted	1	2	5	5	5	5	5	5	5	5	255				
Sub-Total											1,333				
Regulators															
Overhead	1	2	5	5	5	5	5	5	5	5	0				
Underground	1	2	3	3	3	3	3	3	3	3	0				
Pad Mounted	1	2	5	5	5	5	5	5	5	5	0				
Sub-Total											0				
Capacitors															
Overhead	1	2	5	5	5	5	5	5	5	5	182				
Underground	1	2	3	3	3	3	3	3	3	3	2				
Pad Mounted	1	2	5	5	5	5	5	5	5	5	47				
Sub-Total											231				
Conductors, Cables															
Overhead (Conductor Miles)	1	2	5	5	5	5	5	5	5	5	3,306				
Street Lights															
	1	2	5	5	5	5	5	5	5	5	17,276				
Wood Poles															
	1	2	5	5	5	5	5	5	5	5	28,725				
Total											64,612	61	61	61	100%

(1) For 1998, SCE patrolled circuits to conduct simple visual inspections of distribution facilities. Underground structures and equipment are not opened on Circuit Patrol Inspections.

**General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Valencia District**

		1998						
		Inspections						
		Patrol						
Distribution Equipment	Planned (1)	Complete (2)	Balance Remaining	Explanation For Balance (> 0)	Recovery Date			
Transformers								
Overhead	7,693	7,693	0					
Underground	1,746	1,746	0					
Pad Mounted	4,302	4,302	0					
Sub-Total	13,741	13,741	0					
Switching/Protective Devices								
Overhead	90	90	0					
Underground	988	988	0					
Pad Mounted	255	255	0					
Sub-Total	1,333	1,333	0					
Regulators								
Overhead	0	0	0					
Underground	0	0	0					
Pad Mounted	0	0	0					
Sub-Total	0	0	0					
Capacitors								
Overhead	182	182	0					
Underground	2	2	0					
Pad Mounted	47	47	0					
Sub-Total	231	231	0					
Conductors, Cables								
Overhead (Conductor Miles)	3,306	3,306	0					
Street Lights								
	17,276	17,276	0					
Wood Poles								
	28,725	28,725	0					
Total	64,612	64,612	0					
(1) Planned Patrol Inspections are based on Required Circuit Patrols (excl Streetlights). Planned amounts are different from 1997 GO 165 Report due to changes in the inventory and the quantity of required circuit patrols.								
(2) Completed Patrol Inspections are based on the percentage of total patrolled circuits (excl Streetlights).								

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Valencia District

		1998				
		Inspections				
		Detail/Intrusive				
Distribution Equipment	Planned	Complete	Balance Remaining	Explanation For Balance (> 0)	Recovery Date	
Transformers						
Overhead	0	0	0			
Underground	398	538	0			
Pad Mounted	848	896	0			
Sub-Total	1,246	1,434	0			
Switching/Protective Devices						
Overhead	0	0	0			
Underground	483	483	0			
Pad Mounted	38	141	0			
Sub-Total	521	624	0			
Regulators						
Overhead	0	0	0			
Underground	0	0	0			
Pad Mounted	0	0	0			
Sub-Total	0	0	0			
Capacitors						
Overhead	0	0	0			
Underground	0	0	0			
Pad Mounted	3	43	0			
Sub-Total	3	43	0			
Conductors, Cables						
Overhead (Conductor Miles)	0	0	0			
Street Lights						
	N/A	N/A	N/A			
Wood Poles						
	0	91	0			
Total	1,770	2,192	0			

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Valencia District

		1998		
		Inspections (1)(2)		
		Summary		
Distribution Equipment		Planned	Complete	Balance Remaining
Transformers				
	Overhead	7,693	7,693	0
	Underground	2,144	2,284	0
	Pad Mounted	5,150	5,198	0
	Sub-Total	14,987	15,175	0
Switching/Protective Devices				
	Overhead	90	90	0
	Underground	1,471	1,471	0
	Pad Mounted	293	396	0
	Sub-Total	1,854	1,957	0
Regulators				
	Overhead	0	0	0
	Underground	0	0	0
	Pad Mounted	0	0	0
	Sub-Total	0	0	0
Capacitors				
	Overhead	182	182	0
	Underground	2	2	0
	Pad Mounted	50	90	0
	Sub-Total	234	274	0
Conductors, Cables				
	Overhead (Conductor Miles)	3,306	3,306	0
Street Lights				
		17,276	17,276	0
Wood Poles				
		28,725	28,816	0
	Total	66,382	66,804	0

(1) Total inspections may exceed total inventory of an asset as equipment may be inspected twice in a year.
(2) Includes Patrols + Details/Intrusives.

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Valencia District

		1998						
		Condition Rating						
Distribution Equipment	Level 1, 2, 3 Total	Level 4 Total	Level 5 Total	Summary (2)				
				% (1)	Total	% (1)	Total	
Transformers								
Overhead	7,669	99.7%	4	0.1%	20	0.3%	7,693	
Underground	2,284	100.0%	0	0.0%	0	0.0%	2,284	
Pad Mounted	5,176	99.6%	22	0.4%	0	0.0%	5,198	
Sub-Total	15,129	99.7%	26	0.2%	20	0.1%	15,175	
Switching/Protective Devices								
Overhead	86	95.6%	3	3.3%	1	1.1%	90	
Underground	1,464	99.5%	7	0.5%	0	0.0%	1,471	
Pad Mounted	389	98.2%	3	0.8%	4	1.0%	396	
Sub-Total	1,939	99.1%	13	0.7%	5	0.3%	1,957	
Regulators								
Overhead	0	0.0%	0	0.0%	0	0.0%	0	
Underground	0	0.0%	0	0.0%	0	0.0%	0	
Pad Mounted	0	0.0%	0	0.0%	0	0.0%	0	
Sub-Total	0	0.0%	0	0.0%	0	0.0%	0	
Capacitors								
Overhead	173	95.1%	6	3.3%	3	1.6%	182	
Underground	2	100.0%	0	0.0%	0	0.0%	2	
Pad Mounted	90	100.0%	0	0.0%	0	0.0%	90	
Sub-Total	265	96.7%	6	2.2%	3	1.1%	274	
Conductors, Cables								
Overhead (Conductor Miles)	3,306	100.0%	0	0.0%	0	0.0%	3,306	
Street Lights								
	17,276	100.0%	0	0.0%	0	0.0%	17,276	
Wood Poles								
	28,806	100.0%	8	0.0%	2	0.0%	28,816	
Total	66,721	99.9%	53	0.1%	30	0.0%	66,804	
		(1) Percentage of Total Completed Inspections						
		(2) Total condition rating exceeds total inventory as it includes patrol and detailed/intrusive inspections.						

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Valencia District

		1998							
		Corrective Action							
		Level 4				Level 5			
Distribution Equipment	Scheduled	Completed	Balance		Scheduled	Completed	Balance		
			Remaining	% (1)			Remaining	% (1)	
Transformers									
Overhead	4	4	0	0.0%	0	20	0	0.0%	
Underground	0	0	0	0.0%	0	0	0	0.0%	
Pad Mounted	23	23	0	0.0%	0	4	0	0.0%	
Sub-Total	27	27	0	0.0%	0	24	0	0.0%	
Switching/Protective Devices									
Overhead	2	5	0	0.0%	0	3	0	0.0%	
Underground	2	4	0	0.0%	0	0	0	0.0%	
Pad Mounted	0	1	0	0.0%	0	0	0	0.0%	
Sub-Total	4	10	0	0.0%	0	3	0	0.0%	
Regulators									
Overhead	0	0	0	0.0%	0	0	0	0.0%	
Underground	0	0	0	0.0%	0	0	0	0.0%	
Pad Mounted	0	0	0	0.0%	0	0	0	0.0%	
Sub-Total	0	0	0	0.0%	0	0	0	0.0%	
Capacitors									
Overhead	0	10	0	0.0%	0	13	0	0.0%	
Underground	0	0	0	0.0%	0	0	0	0.0%	
Pad Mounted	0	0	0	0.0%	0	0	0	0.0%	
Sub-Total	0	10	0	0.0%	0	13	0	0.0%	
Conductors, Cables									
Overhead (Conductor Miles)	0	0	0	0.0%	0	0	0	0.0%	
Street Lights									
	0	0	0	0.0%	0	0	0	0.0%	
Wood Poles									
	0	64	0	0.0%	0	3	0	0.0%	
Total	31	111	0	0.0%	0	43	0	0.0%	
				(1) Percentage of remaining Corrective Actions					


General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Valencia District

		1998			Corrective Action Summary ⁽²⁾		Recovery Date	
Distribution Equipment		Scheduled	Completed	Balance Remaining	% (1)	Explanation For Balance (> 0)		
Transformers								
	Overhead	4	24	0	0.0%			
	Underground	0	0	0	0.0%			
	Pad Mounted	23	27	0	0.0%			
	Sub-Total	27	51	0	0.0%			
Switching/Protective Devices								
	Overhead	2	8	0	0.0%			
	Underground	2	4	0	0.0%			
	Pad Mounted	0	1	0	0.0%			
	Sub-Total	4	13	0	0.0%			
Regulators								
	Overhead	0	0	0	0.0%			
	Underground	0	0	0	0.0%			
	Pad Mounted	0	0	0	0.0%			
	Sub-Total	0	0	0	0.0%			
Capacitors								
	Overhead	0	23	0	0.0%			
	Underground	0	0	0	0.0%			
	Pad Mounted	0	0	0	0.0%			
	Sub-Total	0	23	0	0.0%			
Conductors, Cables								
	Overhead (Conductor Miles)	0	0	0	0.0%			
Street Lights								
		0	0	0	0.0%			
Wood Poles								
		0	67	0	0.0%			
	Total	31	154	0	0.0%			
		(1) Percentage of remaining Corrective Actions						
		(2) Summary = Condition Level 4 + Condition Level 5 from Page 6.						

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Valencia District

	1999						
	Inspections			Corrective Actions			
	Detail/Intru '98 Balance Remaining	1999 Planned Patrol (1)	Detail/ Intrusive	Total Planned	'98 Balance Remaining	1999 Planned (2)	Total Planned
Distribution Equipment							
Transformers							
Overhead	0	7,693	0	7,693	0	4	4
Underground	0	1,746	706	2,452	0	0	0
Pad Mounted	0	4,302	623	4,925	0	14	14
Sub-Total	0	13,741	1,329	15,070	0	18	18
Switching/Protective Devices							
Overhead	0	90	0	90	0	2	2
Underground	0	988	483	1,471	0	5	5
Pad Mounted	0	255	38	293	0	4	4
Sub-Total	0	1,333	521	1,854	0	11	11
Regulators							
Overhead	0	0	0	0	0	0	0
Underground	0	0	0	0	0	0	0
Pad Mounted	0	0	0	0	0	0	0
Sub-Total	0	0	0	0	0	0	0
Capacitors							
Overhead	0	182	0	182	0	1	1
Underground	0	2	3	5	0	0	0
Pad Mounted	0	47	1	48	0	1	1
Sub-Total	0	231	4	235	0	2	2
Conductors, Cables							
Overhead (Conductor Miles)	0	3,306	0	3,306	0	0	0
Street Lights							
	N/A	17,276	N/A	17,276	0	0	0
Wood Poles							
	0	28,725	0	28,725	0	4	4
Total	0	64,612	1,854	66,466	0	35	35

(1) District is required to patrol 100% of its circuits in 1999.
100% of street lights are planned to be patrolled in 1999.
(2) Corrective actions planned to be completed in 1999 based on items found through previous inspections.



General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Rurals

Distribution Equipment	Inspection Cycles										Circuits				
	(Maximum Intervals in Years)										Total Inventory	Total Circuits	Planned	Completed (1)	%
	Patrol		Detailed		Instructive		Total								
	Urban	Rural	Urban	Rural	Urban	Rural	Urban	Rural	Urban	Rural					
Transformers															
Overhead	1	2	5	5	-	-	-	-	41,280						
Underground	1	2	3	3	-	-	-	-	1,136						
Pad Mounted	1	2	5	5	-	-	-	-	4,272						
Sub-Total									46,688						
Switching/Protective Devices															
Overhead	1	2	5	5	-	-	-	-	918						
Underground	1	2	3	3	-	-	-	-	517						
Pad Mounted	1	2	5	5	-	-	-	-	326						
Sub-Total									1,761						
Regulators															
Overhead	1	2	5	5	-	-	-	-	19						
Underground	1	2	3	3	-	-	-	-	1						
Pad Mounted	1	2	5	5	-	-	-	-	0						
Sub-Total									20						
Capacitors															
Overhead	1	2	5	5	-	-	-	-	507						
Underground	1	2	3	3	-	-	-	-	0						
Pad Mounted	1	2	5	5	-	-	-	-	3						
Sub-Total									510						
Conductors, Cables															
Overhead (Conductor Miles)	1	2	5	5	-	-	-	-	20,959						
Street Lights															
	1	2	-	-	-	-	-	-	7,328						
Wood Poles															
	1	2	-	-	20	20	-	-	163,164	▼	▼	▼	▼	▼	▼
Total									240,430	324	86	299	100%		
(1) For 1998, SCE patrolled circuits to conduct simple visual inspections of distribution facilities. Underground structures and equipment are not opened on Circuit Patrol Inspections.															

**General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Rurals**

		1998				
		Inspections				
		Patrol				
		Planned (1)	Complete (2)	Balance Remaining	Explanation For Balance (> 0)	Recovery Date
Distribution Equipment						
Transformers						
Overhead		16,167	35,661	0		
Underground		384	981	0		
Pad Mounted		1,603	3,908	0		
	Sub-Total	18,154	40,551	0		
Switching/Protective Devices						
Overhead		206	847	0		
Underground		189	463	0		
Pad Mounted		127	296	0		
	Sub-Total	523	1,606	0		
Regulators						
Overhead		5	17	0		
Underground		0	1	0		
Pad Mounted		0	0	0		
	Sub-Total	5	18	0		
Capacitors						
Overhead		169	456	0		
Underground		0	0	0		
Pad Mounted		1	3	0		
	Sub-Total	170	459	0		
Conductors, Cables						
Overhead (Conductor Miles)		7,107	18,366	0		
Street Lights						
		0	4,976	0		
Wood Poles						
		55,442	142,321	0		
	Total	81,402	208,296	0		
<p>(1) Planned Patrol Inspections are based on the Circuit Patrol Inspection Plan (excl Streetlights).</p> <p>Planned amounts are different from 1997 GO 165 Report due to changes in the inventory and the quantity of required circuit patrols.</p> <p>(2) Completed Patrol Inspections are based on the percentage of completed Required Circuit Patrols (excl Streetlights).</p>						

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Rurals

		1998				
		Inspections				
		Detail/Intrusive				
Distribution Equipment	Planned	Complete	Balance Remaining	Explanation For Balance (> 0)	Recovery Date	
Transformers						
Overhead	0	0	0			
Underground	60	159	0			
Pad Mounted	474	555	0			
Sub-Total	534	714	0			
Switching/Protective Devices						
Overhead	0	0	0			
Underground	319	324	0			
Pad Mounted	50	204	0			
Sub-Total	369	528	0			
Regulators						
Overhead	0	0	0			
Underground	0	0	0			
Pad Mounted	0	0	0			
Sub-Total	0	0	0			
Capacitors						
Overhead	0	0	0			
Underground	0	0	0			
Pad Mounted	0	3	0			
Sub-Total	0	3	0			
Conductors, Cables						
Overhead (Conductor Miles)	0	0	0			
Street Lights						
	N/A	N/A	N/A			
Wood Poles						
	295	1,705	0			
Total	1,198	2,950	0			

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Rurals

		1998		
		Inspections ⁽¹⁾⁽²⁾		
		Summary		
Distribution Equipment		Planned	Complete	Balance
				Remaining
Transformers				
	Overhead	16,167	35,661	0
	Underground	444	1,140	0
	Pad Mounted	2,077	4,463	0
	Sub-Total	18,688	41,265	0
Switching/Protective Devices				
	Overhead	206	847	0
	Underground	508	787	0
	Pad Mounted	177	500	0
	Sub-Total	892	2,134	0
Regulators				
	Overhead	5	17	0
	Underground	0	1	0
	Pad Mounted	0	0	0
	Sub-Total	5	18	0
Capacitors				
	Overhead	169	456	0
	Underground	0	0	0
	Pad Mounted	1	6	0
	Sub-Total	170	462	0
Conductors, Cables				
	Overhead (Conductor Miles)	7,107	18,366	0
Street Lights				
		0	4,976	0
Wood Poles				
		55,737	144,026	0
	Total	82,600	211,246	0
(1) Total inspections may exceed total inventory of an asset as equipment may be inspected twice in a year.				
(2) Includes Patrols + Details/Intrusives.				

**General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Rurals**

		1998							
		Condition Rating							
		Level 1, 2, 3		Level 4		Level 5		Summary (e)	
		Total	% (1)	Total	% (1)	Total	% (1)	Total	% (1)
Distribution Equipment									
Transformers									
Overhead		35,646	100.0%	6	0.0%	9	0.0%	35,661	100.0%
Underground		1,140	100.0%	0	0.0%	0	0.0%	1,140	100.0%
Pad Mounted		4,463	100.0%	0	0.0%	0	0.0%	4,463	100.0%
	Sub-Total	41,250	100.0%	6	0.0%	9	0.0%	41,265	100.0%
Switching/Protective Devices									
Overhead		842	99.4%	5	0.6%	0	0.0%	847	100.0%
Underground		785	99.7%	1	0.1%	1	0.1%	787	100.0%
Pad Mounted		500	100.0%	0	0.0%	0	0.0%	500	100.0%
	Sub-Total	2,127	99.7%	6	0.3%	1	0.0%	2,134	100.0%
Regulators									
Overhead		17	100.0%	0	0.0%	0	0.0%	17	100.0%
Underground		1	100.0%	0	0.0%	0	0.0%	1	100.0%
Pad Mounted		0	0.0%	0	0.0%	0	0.0%	0	0.0%
	Sub-Total	18	100.0%	0	0.0%	0	0.0%	18	100.0%
Capacitors									
Overhead		431	94.5%	24	5.3%	1	0.2%	456	100.0%
Underground		0	0.0%	0	0.0%	0	0.0%	0	0.0%
Pad Mounted		6	100.0%	0	0.0%	0	0.0%	6	100.0%
	Sub-Total	437	94.6%	24	5.2%	1	0.2%	462	100.0%
Conductors, Cables									
Overhead (Conductor Miles)		18,366	100.0%	0	0.0%	0	0.0%	18,366	100.0%
Street Lights		4,976	100.0%	0	0.0%	0	0.0%	4,976	100.0%
Wood Poles		143,938	99.9%	85	0.1%	3	0.0%	144,026	100.0%
	Total	211,111	99.9%	121	0.1%	14	0.0%	211,246	100.0%
		(1) Percentage of Total Completed Inspections							
		(2) Total condition rating exceeds total inventory as it includes patrol and detailed/intrusive inspections.							

**General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Rurals**


1998										
Corrective Action										
	Level 4					Level 5				
	Scheduled	Completed	Balance Remaining	% (1)	Scheduled	Completed	Balance Remaining	% (1)		
Distribution Equipment										
Transformers										
Overhead	3	14	0	0.0%	0	3	0	0.0%		
Underground	0	0	0	0.0%	0	0	0	0.0%		
Pad Mounted	0	0	0	0.0%	0	0	0	0.0%		
Sub-Total	3	14	0	0.0%	0	3	0	0.0%		
Switching/Protective Devices										
Overhead	0	9	0	0.0%	0	0	0	0.0%		
Underground	1	3	0	0.0%	0	0	0	0.0%		
Pad Mounted	0	0	0	0.0%	0	0	0	0.0%		
Sub-Total	1	12	0	0.0%	0	0	0	0.0%		
Regulators										
Overhead	0	0	0	0.0%	0	0	0	0.0%		
Underground	0	0	0	0.0%	0	0	0	0.0%		
Pad Mounted	0	0	0	0.0%	0	0	0	0.0%		
Sub-Total	0	0	0	0.0%	0	0	0	0.0%		
Capacitors										
Overhead	0	58	0	0.0%	0	2	0	0.0%		
Underground	0	0	0	0.0%	0	0	0	0.0%		
Pad Mounted	0	0	0	0.0%	0	0	0	0.0%		
Sub-Total	0	58	0	0.0%	0	2	0	0.0%		
Conductors, Cables										
Overhead (Conductor Miles)	0	0	0	0.0%	0	0	0	0.0%		
Street Lights										
	0	0	0	0.0%	0	0	0	0.0%		
Wood Poles										
	72	168	65	90.3%	8	6	4	50.0%		
Total	76	252	65	85.5%	8	11	4	50.0%		
(1) Percentage of remaining Corrective Actions										

**General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Rurals**

		1998		Corrective Action				
		Summary (2)						
Distribution Equipment	Scheduled	Completed	Balance Remaining	% (1)	Explanation For Balance (> 0)		Recovery Date	
Transformers								
Overhead	3	17	0	0.0%				
Underground	0	0	0	0.0%				
Pad Mounted	0	0	0	0.0%				
Sub-Total	3	17	0	0.0%				
Switching/Protective Devices								
Overhead	0	9	0	0.0%				
Underground	1	3	0	0.0%				
Pad Mounted	0	0	0	0.0%				
Sub-Total	1	12	0	0.0%				
Regulators								
Overhead	0	0	0	0.0%				
Underground	0	0	0	0.0%				
Pad Mounted	0	0	0	0.0%				
Sub-Total	0	0	0	0.0%				
Capacitors								
Overhead	0	60	0	0.0%				
Underground	0	0	0	0.0%				
Pad Mounted	0	0	0	0.0%				
Sub-Total	0	60	0	0.0%				
Conductors, Cables								
Overhead (Conductor Miles)	0	0	0	0.0%				
Street Lights								
	0	0	0	0.0%				
Wood Poles								
	80	174	69	86.3%	Additional replacements/repairs were completed in some districts.		31-Dec-99	
Total	84	263	69	82.1%				
	(1) Percentage of remaining Corrective Actions							
	(2) Summary = Condition Level 4 + Condition Level 5 from Page 6.							

**General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Rurals**

	1999									
	Inspections					Corrective Actions				
	Detail/Intru	1999 Planned		Total	'98 Balance	1999		Total		
'98 Balance	Patrol (1)	Detail/	Planned	Remaining	Planned (2)	Planned	Planned			
		Intrusive								
Distribution Equipment										
Transformers										
Overhead	0	5,814	0	5,814	0	0	0	0	0	0
Underground	0	171	534	705	0	0	0	0	0	0
Pad Mounted	0	396	229	625	0	0	0	0	0	0
Sub-Total	0	6,382	763	7,145	0	0	0	0	0	0
Switching/Protective Devices										
Overhead	0	73	0	73	0	4	4	4	4	4
Underground	0	60	145	205	0	0	0	0	0	0
Pad Mounted	0	33	76	109	0	0	0	0	0	0
Sub-Total	0	165	221	386	0	4	4	4	4	4
Regulators										
Overhead	0	2	0	2	0	0	0	0	0	0
Underground	0	0	0	0	0	0	0	0	0	0
Pad Mounted	0	0	0	0	0	0	0	0	0	0
Sub-Total	0	2	0	2	0	0	0	0	0	0
Capacitors										
Overhead	0	55	0	55	0	4	4	4	4	4
Underground	0	0	0	0	0	0	0	0	0	0
Pad Mounted	0	0	0	0	0	0	0	0	0	0
Sub-Total	0	55	0	55	0	4	4	4	4	4
Conductors, Cables										
Overhead (Conductor Miles)	0	2,707	0	2,707	0	0	0	0	0	0
Street Lights										
	N/A	2,352	N/A	2,352	0	0	0	0	0	0
Wood Poles										
	0	21,683	18,000	39,683	69	39	39	108	108	108
Total	0	33,345	18,984	52,329	69	47	47	116	116	116
<p>(1) Rurals are required to patrol 8% of its circuits in 1999. 32% of street lights are planned to be patrolled in 1999.</p> <p>(2) Corrective actions planned to be completed in 1999 based on items found through previous inspections.</p>										

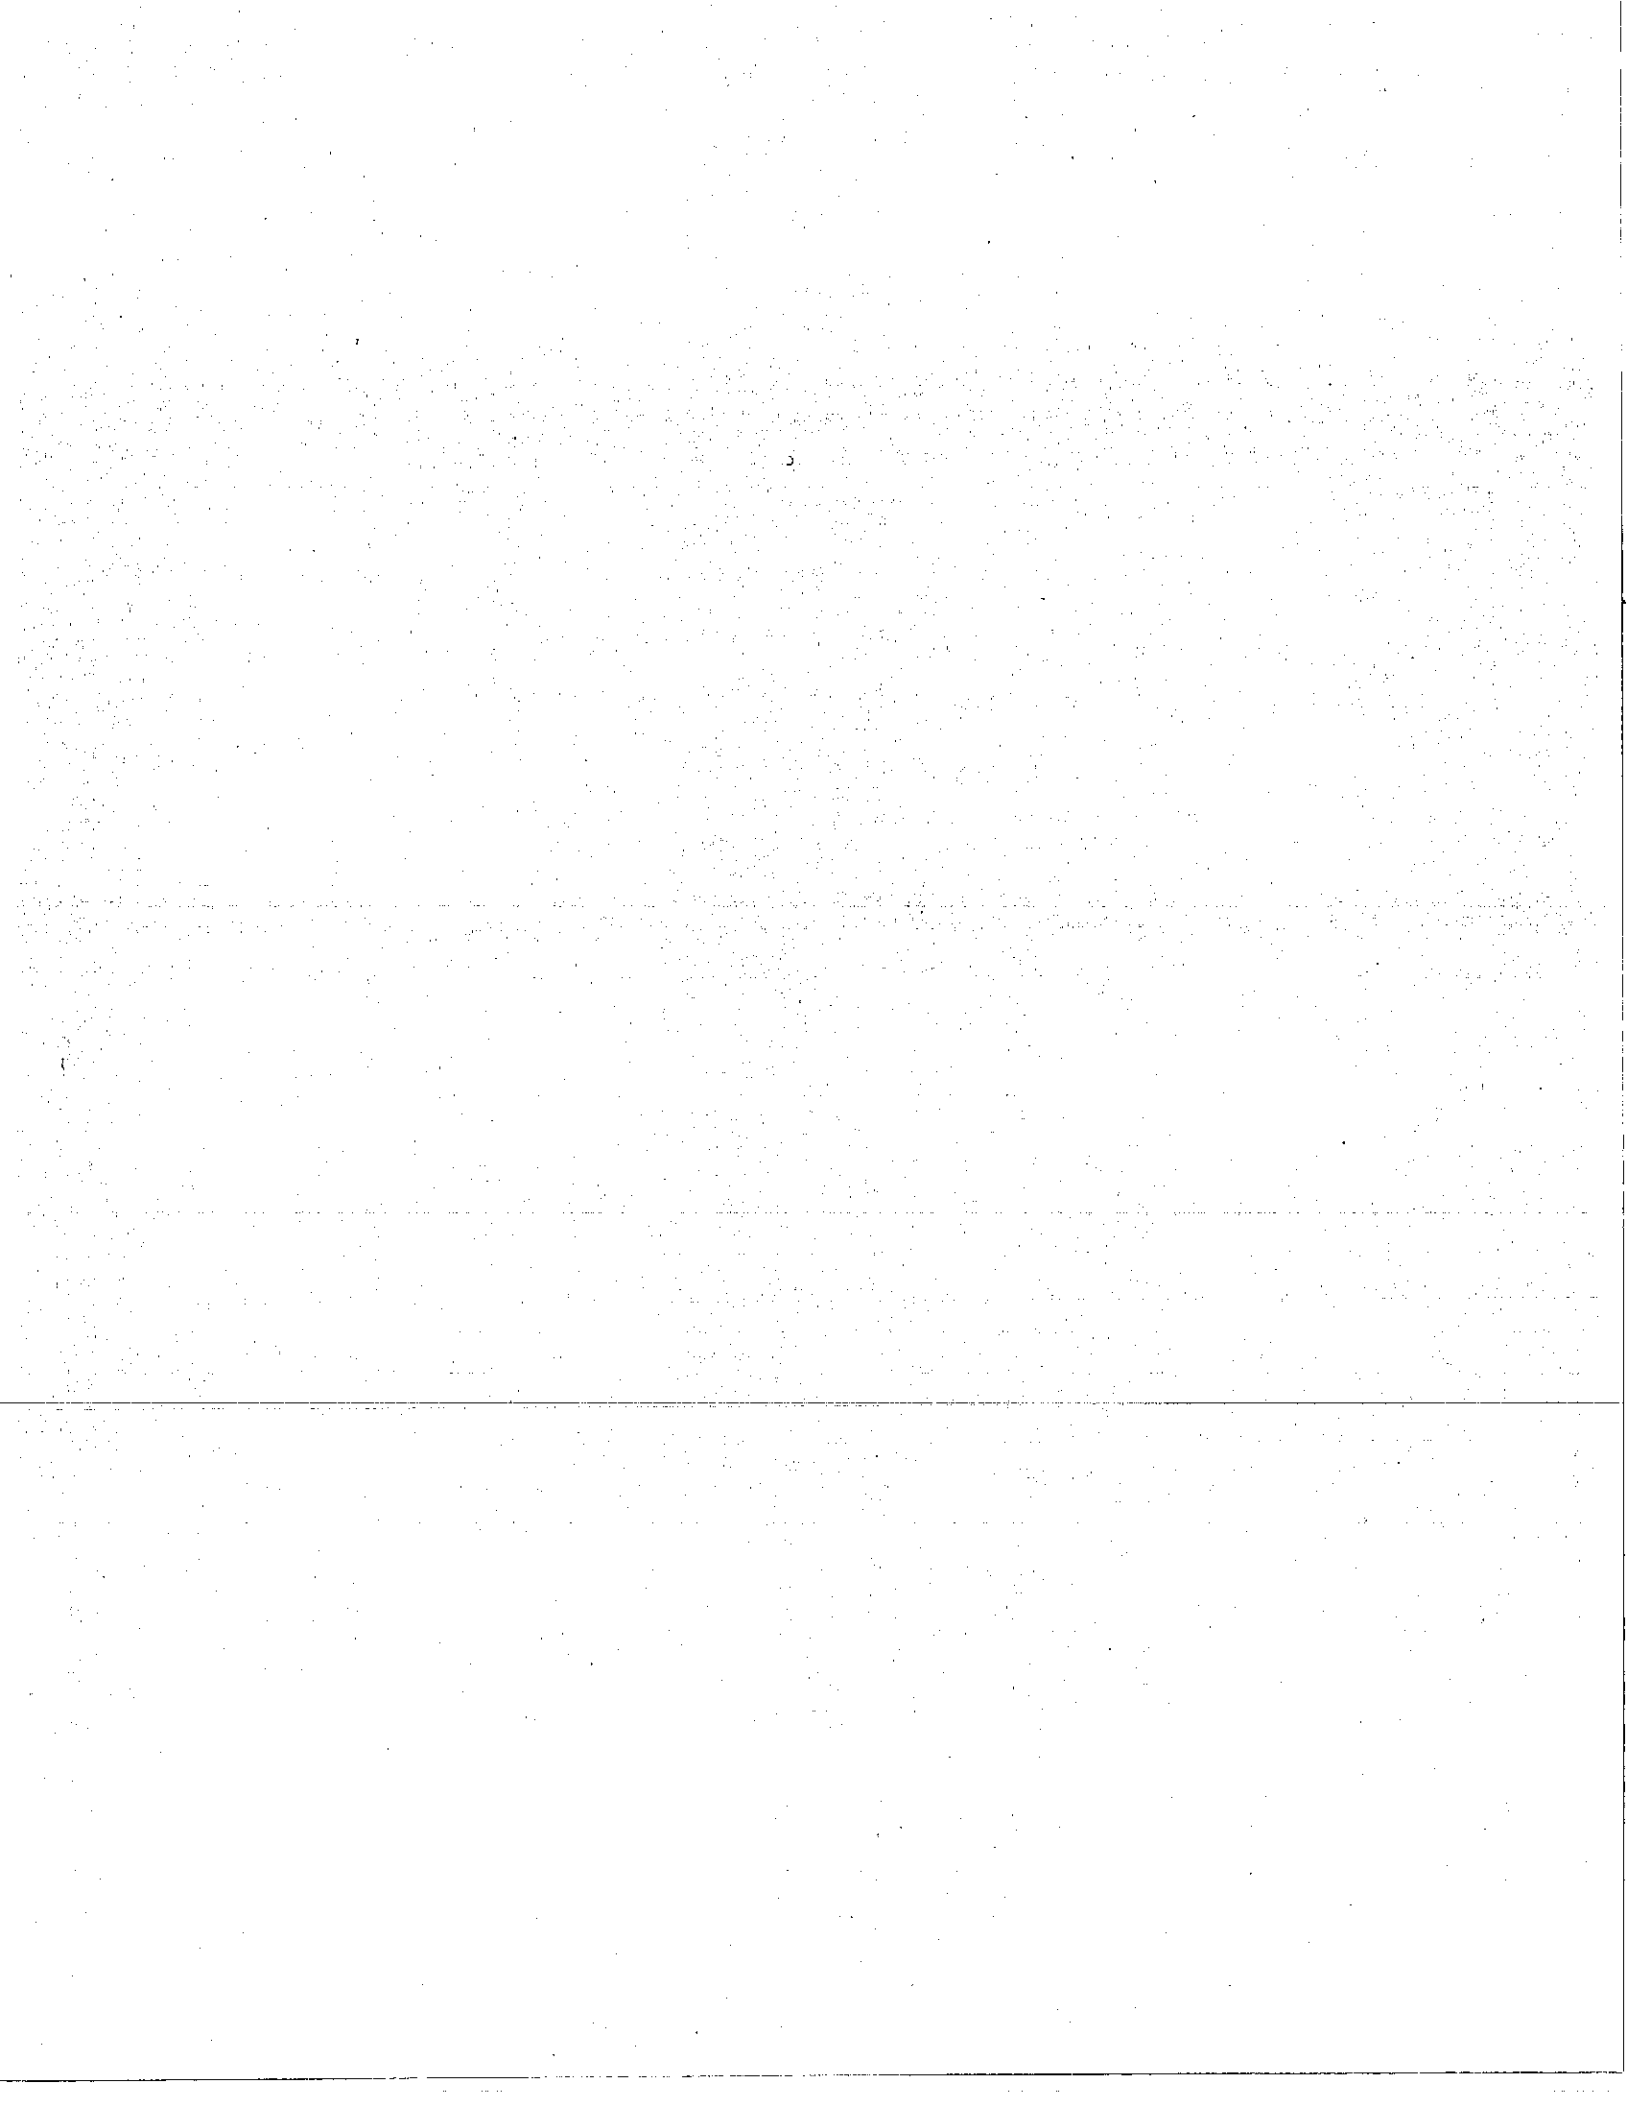

**General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Arrowhead District**

		1998												
		Inspection Cycles												
		(Maximum Intervals in Years)												
Distribution Equipment		Patrol		Detailed		Intrusive		Total Inventory	Total Circuits	Circuits Patrolled (%)				
		Urban	Rural	Urban	Rural	Urban	Rural			Required	Total	%		
Transformers														
Overhead		1	2	5	5	-	-	3,163						
Underground		1	2	3	3	-	-	145						
Pad Mounted		1	2	5	5	-	-	287						
Sub-Total								3,595						
Switching/Protective Devices														
Overhead		1	2	5	5	-	-	395						
Underground		1	2	3	3	-	-	35						
Pad Mounted		1	2	5	5	-	-	27						
Sub-Total								457						
Regulators														
Overhead		1	2	5	5	-	-	0						
Underground		1	2	3	3	-	-	1						
Pad Mounted		1	2	5	5	-	-	0						
Sub-Total								1						
Capacitors														
Overhead		1	2	5	5	-	-	51						
Underground		1	2	3	3	-	-	0						
Pad Mounted		1	2	5	5	-	-	0						
Sub-Total								51						
Conductors, Cables														
Overhead (Conductor Miles)		1	2	5	5	-	-	1,614						
Street Lights		1	2	-	-	-	-	262						
Wood Poles		1	2	-	-	20	20	14,073						
Total								20,053	43	0	43	100%		

(1) For 1998, SCE patrolled circuits to conduct simple visual inspections of distribution facilities. Underground structures and equipment are not opened on Circuit Patrol Inspections.

**General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Arrowhead District**

		1998				
		Inspections				
		Patrol				
Distribution Equipment	Planned (1)	Complete (2)	Balance Remaining	Explanation For Balance (> 0)	Recovery Date	
Transformers						
Overhead	0	3,163	0			
Underground	0	145	0			
Pad Mounted	0	287	0			
Sub-Total	0	3,595	0			
Switching/Protective Devices						
Overhead	0	395	0			
Underground	0	35	0			
Pad Mounted	0	27	0			
Sub-Total	0	457	0			
Regulators						
Overhead	0	0	0			
Underground	0	1	0			
Pad Mounted	0	0	0			
Sub-Total	0	1	0			
Capacitors						
Overhead	0	51	0			
Underground	0	0	0			
Pad Mounted	0	0	0			
Sub-Total	0	51	0			
Conductors, Cables						
Overhead (Conductor Miles)	0	1,614	0			
Street Lights						
	0	262	0			
Wood Poles						
	0	14,073	0			
Total	0	20,053	0			
(1) Planned Patrol Inspections are based on Required Circuit Patrols (excl Streetlights).						
Planned amounts are different from 1997 GO 165 Report due to changes in the inventory and the quantity of required circuit patrols						
(2) Completed Patrol Inspections are based on the percentage of total patrolled circuits (excl Streetlights).						

**General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Arrowhead District**

		1998		Inspections		Detail/Intrusive			
Distribution Equipment	Planned	Complete	Balance Remaining	Explanation For Balance (> 0)	Recovery Date				
Transformers									
Overhead	0	0	0						
Underground	0	40	0						
Pad Mounted	27	51	0						
Sub-Total	27	91	0						
Switching/Protective Devices									
Overhead	0	0	0						
Underground	17	17	0						
Pad Mounted	13	18	0						
Sub-Total	30	35	0						
Regulators									
Overhead	0	0	0						
Underground	0	0	0						
Pad Mounted	0	0	0						
Sub-Total	0	0	0						
Capacitors									
Overhead	0	0	0						
Underground	0	0	0						
Pad Mounted	0	0	0						
Sub-Total	0	0	0						
Conductors, Cables									
Overhead (Conductor Miles)	0	0	0						
Street Lights									
	N/A	N/A	N/A						
Wood Poles									
	0	4	0						
Total	57	130	0						

**General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Arrowhead District**

		1998		
		Inspections (1),(2)		
		Summary		
Distribution Equipment		Planned	Complete	Balance Remaining
Transformers				
Overhead		0	3,163	0
Underground		0	165	0
Pad Mounted		27	338	0
	Sub-Total	27	3,686	0
Switching/Protective Devices				
Overhead		0	395	0
Underground		17	52	0
Pad Mounted		13	45	0
	Sub-Total	30	492	0
Regulators				
Overhead		0	0	0
Underground		0	1	0
Pad Mounted		0	0	0
	Sub-Total	0	1	0
Capacitors				
Overhead		0	51	0
Underground		0	0	0
Pad Mounted		0	0	0
	Sub-Total	0	51	0
Conductors, Cables				
Overhead (Conductor Miles)		0	1,614	0
Street Lights				
		0	262	0
Wood Poles				
		0	14,077	0
	Total	57	20,183	0
		(1) Total inspections may exceed total inventory of an asset as equipment may be inspected twice in a year.		
		(2) Includes Patrols + Details/Intrusives		

**General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Arrowhead District**

		1998					
		Condition Rating					
Distribution Equipment	Level 1, 2, 3 Total	Level 4 Total	Level 5 Total	Summary Total	%	%	
							% (1)
Transformers							
Overhead	3,163	0	0	3,163	0.0%	100.0%	
Underground	185	0	0	185	0.0%	100.0%	
Pad Mounted	338	0	0	338	0.0%	100.0%	
Sub-Total	3,686	0	0	3,686	0.0%	100.0%	
Switching/Protective Devices							
Overhead	395	0	0	395	0.0%	100.0%	
Underground	52	0	0	52	0.0%	100.0%	
Pad Mounted	45	0	0	45	0.0%	100.0%	
Sub-Total	492	0	0	492	0.0%	100.0%	
Regulators							
Overhead	0	0	0	0	0.0%	0.0%	
Underground	1	0	0	1	0.0%	100.0%	
Pad Mounted	0	0	0	0	0.0%	0.0%	
Sub-Total	1	0	0	1	0.0%	100.0%	
Capacitors							
Overhead	51	0	0	51	0.0%	100.0%	
Underground	0	0	0	0	0.0%	0.0%	
Pad Mounted	0	0	0	0	0.0%	0.0%	
Sub-Total	51	0	0	51	0.0%	100.0%	
Conductors, Cables							
Overhead (Conductor Miles)	1,614	0	0	1,614	0.0%	100.0%	
Street Lights							
Overhead	262	0	0	262	0.0%	100.0%	
Wood Poles							
Overhead	14,077	0	0	14,077	0.0%	100.0%	
Total	20,183	0	0	20,183	0.0%	100.0%	
(1) Percentage of Total Completed Inspections							
(2) Total condition rating exceeds total inventory as it includes patrol and detailed/intrusive inspections.							

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Arrowhead District


1998									
Corrective Action									
Distribution Equipment	Level 4				Level 5				
	Scheduled	Completed	Balance Remaining	% (1)	Scheduled	Completed	Balance Remaining	% (1)	
Transformers									
Overhead	0	1	0	0.0%	0	0	0	0.0%	0.0%
Underground	0	0	0	0.0%	0	0	0	0.0%	0.0%
Pad Mounted	0	0	0	0.0%	0	0	0	0.0%	0.0%
Sub-Total	0	1	0	0.0%	0	0	0	0.0%	0.0%
Switching/Protective Devices									
Overhead	0	1	0	0.0%	0	0	0	0.0%	0.0%
Underground	0	0	0	0.0%	0	0	0	0.0%	0.0%
Pad Mounted	0	0	0	0.0%	0	0	0	0.0%	0.0%
Sub-Total	0	1	0	0.0%	0	0	0	0.0%	0.0%
Regulators									
Overhead	0	0	0	0.0%	0	0	0	0.0%	0.0%
Underground	0	0	0	0.0%	0	0	0	0.0%	0.0%
Pad Mounted	0	0	0	0.0%	0	0	0	0.0%	0.0%
Sub-Total	0	0	0	0.0%	0	0	0	0.0%	0.0%
Capacitors									
Overhead	0	3	0	0.0%	0	1	0	0.0%	0.0%
Underground	0	0	0	0.0%	0	0	0	0.0%	0.0%
Pad Mounted	0	0	0	0.0%	0	0	0	0.0%	0.0%
Sub-Total	0	3	0	0.0%	0	1	0	0.0%	0.0%
Conductors, Cables									
Overhead (Conductor Miles)	0	0	0	0.0%	0	0	0	0.0%	0.0%
Street Lights									
	0	0	0	0.0%	0	0	0	0.0%	0.0%
Wood Poles									
	23	2	21	91.3%	1	0	1	100.0%	
Total	23	7	21	91.3%	1	1	1	100.0%	
	(1) Percentage of remaining Corrective Actions								

**General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Arrowhead District**

		1998		Corrective Action		Summary ⁽²⁾			
Distribution Equipment	Scheduled	Completed	Balance Remaining	% (1)	Explanation For Balance (> 0)	Recovery Date			
Transformers									
Overhead	0	1	0	0.0%					
Underground	0	0	0	0.0%					
Pad Mounted	0	0	0	0.0%					
Sub-Total	0	1	0	0.0%					
Switching/Protective Devices									
Overhead	0	1	0	0.0%					
Underground	0	0	0	0.0%					
Pad Mounted	0	0	0	0.0%					
Sub-Total	0	1	0	0.0%					
Regulators									
Overhead	0	0	0	0.0%					
Underground	0	0	0	0.0%					
Pad Mounted	0	0	0	0.0%					
Sub-Total	0	0	0	0.0%					
Capacitors									
Overhead	0	4	0	0.0%					
Underground	0	0	0	0.0%					
Pad Mounted	0	0	0	0.0%					
Sub-Total	0	4	0	0.0%					
Conductors, Cables									
Overhead (Conductor Miles)	0	0	0	0.0%					
Street Lights									
	0	0	0	0.0%					
Wood Poles									
	24	2	22	91.7%	Additional repairs/replacements were performed in other districts.	31-Dec-99			
Total	24	8	22	91.7%					
(1) Percentage of remaining Corrective Actions									
(2) Summary = Condition level 4 + Condition Level 5 from Page 6.									

**General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Arrowhead District**

Distribution Equipment	1999									
	Inspections					Corrective Actions				
	Detail/Intru '98 Balance Remaining	1999 Planned Patrol (1)	Detail/ Intrusive	Total Planned	'98 Balance Remaining	1999 Planned (2)	Total Planned			
Transformers										
Overhead	0	0	0	0	0	0	0	0	0	0
Underground	0	0	49	49	0	0	0	0	0	0
Pad Mounted	0	0	22	22	0	0	0	0	0	0
Sub-Total	0	0	71	71	0	0	0	0	0	0
Switching/Protective Devices										
Overhead	0	0	0	0	0	0	0	0	0	0
Underground	0	0	2	2	0	0	0	0	0	0
Pad Mounted	0	0	5	5	0	0	0	0	0	0
Sub-Total	0	0	7	7	0	0	0	0	0	0
Regulators										
Overhead	0	0	0	0	0	0	0	0	0	0
Underground	0	0	0	0	0	0	0	0	0	0
Pad Mounted	0	0	0	0	0	0	0	0	0	0
Sub-Total	0	0	0	0	0	0	0	0	0	0
Capacitors										
Overhead	0	0	0	0	0	0	0	0	0	0
Underground	0	0	0	0	0	0	0	0	0	0
Pad Mounted	0	0	0	0	0	0	0	0	0	0
Sub-Total	0	0	0	0	0	0	0	0	0	0
Conductors, Cables										
Overhead (Conductor Miles)	0	0	0	0	0	0	0	0	0	0
Street Lights										
	N/A	0	N/A	0	0	0	0	0	0	0
Wood Poles										
	0	0	0	0	22	1	23	23	23	23
Total	0	0	78	78	22	1	23	23	23	23
	(1) District is not required to patrol circuits in 1999. No street lights are planned to be patrolled in 1999.									
	(2) Corrective actions planned to be completed in 1999 based on items found through previous inspections.									



General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Big Creek District

		1998															
		Inspection Cycles															
		(Maximum Intervals in Years)															
Distribution Equipment		Patrol			Detailed			Intrusive			Total Inventory	Total Circuits	Circuits Patrolled (1)				
		Urban	Rural		Urban	Rural		Urban	Rural				Required	Total	%		
Transformers																	
Overhead		1	2	5	5						459						
Underground		1	2	3	3						16						
Pad Mounted		1	2	5	5						124						
	Sub-Total										599						
Switching/Protective Devices																	
Overhead		1	2	5	5						16						
Underground		1	2	3	3						15						
Pad Mounted		1	2	5	5						16						
	Sub-Total										47						
Regulators																	
Overhead		1	2	5	5						1						
Underground		1	2	3	3						0						
Pad Mounted		1	2	5	5						0						
	Sub-Total										1						
Capacitors																	
Overhead		1	2	5	5						8						
Underground		1	2	3	3						0						
Pad Mounted		1	2	5	5						1						
	Sub-Total										9						
Conductors, Cables																	
Overhead (Conductor Miles)		1	2	5	5						389						
Street Lights		1	2	-	-						27						
Wood Poles		1	2	-	-						5,337						
	Total										6,409			23	0	23	100%
(1) For 1998, SCE patrolled circuits to conduct simple visual inspections of distribution facilities. Underground structures and equipment are not opened on Circuit Patrol Inspections.																	

**General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Big Creek District**

		1998		Inspections		Patrol			
Distribution Equipment	Planned (1)	Complete (2)	Balance Remaining	Explanation For Balance (> 0)	Recovery Date				
Transformers									
Overhead	0	459	0						
Underground	0	16	0						
Pad Mounted	0	124	0						
Sub-Total	0	599	0						
Switching/Protective Devices									
Overhead	0	16	0						
Underground	0	15	0						
Pad Mounted	0	16	0						
Sub-Total	0	47	0						
Regulators									
Overhead	0	1	0						
Underground	0	0	0						
Pad Mounted	0	0	0						
Sub-Total	0	1	0						
Capacitors									
Overhead	0	8	0						
Underground	0	0	0						
Pad Mounted	0	1	0						
Sub-Total	0	9	0						
Conductors, Cables									
Overhead (Conductor Miles)	0	389	0						
Street Lights									
	0	27	0						
Wood Poles									
	0	5,337	0						
Total	0	6,409	0						
<p>(1) Planned Patrol Inspections are based on Required Circuit Patrols (excl Streetlights). Planned amounts are different from 1997 GO 165 Report due to changes in the inventory and the quantity of required circuit patrols.</p> <p>(2) Completed Patrol Inspections are based on the percentage of total patrolled circuits (excl Streetlights).</p>									

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Big Creek District

		1998		Inspections				
				Detail/Intrusive				
Distribution Equipment	Planned	Complete	Balance Remaining	Explanation For Balance (>0)	Recovery Date			
Transformers								
Overhead	0	0	0					
Underground	0	1	0					
Pad Mounted	8	9	0					
Sub-Total	8	10	0					
Switching/Protective Devices								
Overhead	0	0	0					
Underground	14	14	0					
Pad Mounted	5	12	0					
Sub-Total	19	26	0					
Regulators								
Overhead	0	0	0					
Underground	0	0	0					
Pad Mounted	0	0	0					
Sub-Total	0	0	0					
Capacitors								
Overhead	0	0	0					
Underground	0	0	0					
Pad Mounted	0	1	0					
Sub-Total	0	1	0					
Conductors, Cables								
Overhead (Conductor Miles)	0	0	0					
Street Lights								
	N/A	N/A	N/A					
Wood Poles								
	0	0	0					
Total	27	37	0					

**General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Big Creek District**

		1999						Corrective Actions	
Distribution Equipment	Detail/Intru '98 Balance Remaining	Inspections			Total Planned	'98 Balance Remaining	1999 Planned (2)	Total Planned	
		Patrol (1)	Detail/ Intrusive	1999 Planned					
Transformers									
Overhead	0	0	0	0	0	0	0	0	
Underground	0	0	11	0	11	0	0	0	
Pad Mounted	0	0	4	0	4	0	0	0	
Sub-Total	0	0	15	0	15	0	0	0	
Switching/Protective Devices									
Overhead	0	0	0	0	0	0	1	1	
Underground	0	0	4	0	4	0	0	0	
Pad Mounted	0	0	5	0	5	0	0	0	
Sub-Total	0	0	9	0	9	0	1	1	
Regulators									
Overhead	0	0	0	0	0	0	0	0	
Underground	0	0	0	0	0	0	0	0	
Pad Mounted	0	0	0	0	0	0	0	0	
Sub-Total	0	0	0	0	0	0	0	0	
Capacitors									
Overhead	0	0	0	0	0	0	1	1	
Underground	0	0	0	0	0	0	0	0	
Pad Mounted	0	0	0	0	0	0	0	0	
Sub-Total	0	0	0	0	0	0	1	1	
Conductors, Cables									
Overhead (Conductor Miles)	0	0	0	0	0	0	0	0	
Street Lights									
	N/A	0	N/A	0	0	0	0	0	
Wood Poles									
	0	0	0	0	0	28	0	28	
Total	0	0	24	0	24	28	2	30	
(1) District is not required to patrol circuits in 1999.									
No street lights are planned to be patrolled in 1999.									
(2) Corrective actions planned to be completed in 1999 based on items found through previous inspections.									



General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Tehachapi District

		1998														
		Inspection Cycles														
		(Maximum Intervals in Years)														
Distribution Equipment		Patrol			Detailed			Instructive			Total Inventory	Total Circuits	Required	Circuits Patrolled (%)		
		Urban	Rural		Urban	Rural		Urban	Rural							
Transformers																
Overhead		1	2	5	5						4,644					
Underground		1	2	3	3						46					
Pad Mounted		1	2	5	5						462					
	Sub-Total										5,152					
Switching/Protective Devices																
Overhead		1	2	5	5						61					
Underground		1	2	3	3						28					
Pad Mounted		1	2	5	5						47					
	Sub-Total										136					
Regulators																
Overhead		1	2	5	5						1					
Underground		1	2	3	3						0					
Pad Mounted		1	2	5	5						0					
	Sub-Total										1					
Capacitors																
Overhead		1	2	5	5						52					
Underground		1	2	3	3						0					
Pad Mounted		1	2	5	5						0					
	Sub-Total										52					
Conductors, Cables																
Overhead (Conductor Miles)		1	2	5	5						1,465					
Street Lights		1	2								627					
Wood Poles		1	2								9,650					
	Total										17,083				15	18
																100%
<p>(1) For 1998, SCE patrolled circuits to conduct simple visual inspections of distribution facilities. Underground structures and equipment are not opened on Circuit Patrol Inspections.</p>																

**General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Tehachapi District**

		1998					
		Inspections				Patrol	
Distribution Equipment	Planned (1)	Complete (2)	Balance Remaining	Explanation For Balances (>0)	Recovery Date		
Transformers							
Overhead	3,870	4,644	0				
Underground	38	46	0				
Pad Mounted	385	462	0				
Sub-Total	4,293	5,152	0				
Switching/Protective Devices							
Overhead	51	61	0				
Underground	23	28	0				
Pad Mounted	39	47	0				
Sub-Total	113	136	0				
Regulators							
Overhead	1	1	0				
Underground	0	0	0				
Pad Mounted	0	0	0				
Sub-Total	1	1	0				
Capacitors							
Overhead	43	52	0				
Underground	0	0	0				
Pad Mounted	0	0	0				
Sub-Total	43	52	0				
Conductors, Cables							
Overhead (Conductor Miles)	1,221	1,465	0				
Street Lights							
	0	0	0				
Wood Poles							
	8,042	9,650	0				
Total	13,713	16,456	0				
<p>(1) Planned Patrol Inspections are based on Required Circuit Patrols (excl Streetlights).</p> <p>Planned amounts are different from 1997 GO 165 Report due to changes in the inventory and the quantity of required circuit patrols</p>							
<p>(2) Completed Patrol Inspections are based on the percentage of total patrolled circuits (excl Streetlights).</p>							

**General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Tehachapi District**

		1998		
		Inspections (1)(2)		
		Summary		
Distribution Equipment		Planned	Complete	Balance Remaining
Transformers				
Overhead		3,870	4,644	0
Underground		38	49	0
Pad Mounted		413	502	0
	Sub-Total	4,321	5,195	0
Switching/Protective Devices				
Overhead		51	61	0
Underground		36	41	0
Pad Mounted		50	69	0
	Sub-Total	137	171	0
Regulators				
Overhead		1	1	0
Underground		0	0	0
Pad Mounted		0	0	0
	Sub-Total	1	1	0
Capacitors				
Overhead		43	52	0
Underground		0	0	0
Pad Mounted		0	0	0
	Sub-Total	43	52	0
Conductors, Cables				
Overhead (Conductor Miles)		1,221	1,465	0
Street Lights				
		0	0	0
Wood Poles				
		8,042	9,717	0
	Total	13,765	16,601	0
		(1) Total inspections may exceed total inventory of an asset as equipment may be inspected twice in a year.		
		(2) Includes Patrols + Details/Intrusives.		

**General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Tehachapi District**

		1998						
		Condition Rating						
Distribution Equipment	Total	Level 1, 2, 3		Level 4		Level 5		Summary (2)
		Total	% (1)	Total	% (1)	Total	% (1)	
Transformers								
Overhead	4,642	100.0%	0.0%	0	0.0%	2	0.0%	4,644
Underground	49	100.0%	0.0%	0	0.0%	0	0.0%	49
Pad Mounted	502	100.0%	0.0%	0	0.0%	0	0.0%	502
Sub-Total	5,193	100.0%	0.0%	0	0.0%	2	0.0%	5,195
Switching/Protective Devices								
Overhead	59	96.7%	3.3%	2	3.3%	0	0.0%	61
Underground	41	100.0%	0.0%	0	0.0%	0	0.0%	41
Pad Mounted	69	100.0%	0.0%	0	0.0%	0	0.0%	69
Sub-Total	169	98.8%	1.2%	2	1.2%	0	0.0%	171
Regulators								
Overhead	1	100.0%	0.0%	0	0.0%	0	0.0%	1
Underground	0	0.0%	0.0%	0	0.0%	0	0.0%	0
Pad Mounted	0	0.0%	0.0%	0	0.0%	0	0.0%	0
Sub-Total	1	100.0%	0.0%	0	0.0%	0	0.0%	1
Capacitors								
Overhead	47	90.4%	9.6%	5	9.6%	0	0.0%	52
Underground	0	0.0%	0.0%	0	0.0%	0	0.0%	0
Pad Mounted	0	0.0%	0.0%	0	0.0%	0	0.0%	0
Sub-Total	47	90.4%	9.6%	5	9.6%	0	0.0%	52
Conductors, Cables								
Overhead (Conductor Miles)	1,465	100.0%	0.0%	0	0.0%	0	0.0%	1,465
Street Lights								
	0	0.0%	0.0%	0	0.0%	0	0.0%	0
Wood Poles								
	9,716	100.0%	0.0%	1	0.0%	0	0.0%	9,717
Total	16,591	99.9%	0.0%	8	0.0%	2	0.0%	16,601
		(1) Percentage of Total Completed Inspections						
		(2) Total condition rating exceeds total inventory as it includes patrol and detailed/intrusive inspections.						

**General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Tehachapi District**

		1998		Corrective Action		Summary (2)			
Distribution Equipment	Scheduled	Completed	Balance Remaining	% (1)	Explanation For Balance (> 0)	Recovery Date			
Transformers									
Overhead	0	2	0	0.0%					
Underground	0	0	0	0.0%					
Pad Mounted	0	0	0	0.0%					
Sub-Total	0	2	0	0.0%					
Switching/Protective Devices									
Overhead	0	2	0	0.0%					
Underground	0	0	0	0.0%					
Pad Mounted	0	0	0	0.0%					
Sub-Total	0	2	0	0.0%					
Regulators									
Overhead	0	0	0	0.0%					
Underground	0	0	0	0.0%					
Pad Mounted	0	0	0	0.0%					
Sub-Total	0	0	0	0.0%					
Capacitors									
Overhead	0	7	0	0.0%					
Underground	0	0	0	0.0%					
Pad Mounted	0	0	0	0.0%					
Sub-Total	0	7	0	0.0%					
Conductors, Cables									
Overhead (Conductor Miles)	0	0	0	0.0%					
Street Lights									
Overhead	0	0	0	0.0%					
Wood Poles									
Overhead	0	3	0	0.0%					
Total	0	14	0	0.0%					
							(1) Percentage of remaining Corrective Actions		
							(2) Summary = Condition Level 4 + Condition Level 5 from Page 6.		

**General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Tehachapi District**

Distribution Equipment	1999						Corrective Actions		
	Inspections			Inspections			'98 Balance Remaining	1999 Planned	Total Planned
	Detail/Intru '98 Balance Remaining	1999 Planned Patrol (1)	Detail/ Intrusive	Total Planned	'98 Balance Remaining	1999 Planned			
Transformers									
Overhead	0	0	0	0	0	0	0	0	0
Underground	0	0	11	11	0	0	0	0	0
Pad Mounted	0	0	28	28	0	0	0	0	0
Sub-Total	0	0	39	39	0	0	0	0	0
Switching/Protective Devices									
Overhead	0	0	0	0	0	0	0	2	2
Underground	0	0	19	19	0	0	0	0	0
Pad Mounted	0	0	20	20	0	0	0	0	0
Sub-Total	0	0	39	39	0	0	0	2	2
Regulators									
Overhead	0	0	0	0	0	0	0	0	0
Underground	0	0	0	0	0	0	0	0	0
Pad Mounted	0	0	0	0	0	0	0	0	0
Sub-Total	0	0	0	0	0	0	0	0	0
Capacitors									
Overhead	0	0	0	0	0	0	0	1	1
Underground	0	0	0	0	0	0	0	0	0
Pad Mounted	0	0	0	0	0	0	0	0	0
Sub-Total	0	0	0	0	0	0	0	1	1
Conductors, Cables Overhead (Conductor Miles)									
	0	0	0	0	0	0	0	0	0
Street Lights									
	N/A	627	N/A	627	0	0	0	0	0
Wood Poles									
	0	0	0	0	0	0	0	10	10
Total	0	627	78	705	0	13	0	13	13
	(1) District is not required to patrol circuits in 1999.								
	100% of street lights are planned to be patrolled in 1999.								
	(2) Corrective actions planned to be completed in 1999 based on items found through previous inspections.								



**General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Kernville District**

		1998										
		Inspection Cycles										
		(Maximum Intervals in Years)										
Distribution Equipment		Patrol		Detailed		Intrusive		Total Inventory	Total Circuits	Circuits Required	Circuits Patrolled (1)	
		Urban	Rural	Urban	Rural	Urban	Rural				Total	%
Transformers												
Overhead		1	2	5	5	--	--	3,766				
Underground		1	2	3	3	--	--	77				
Pad Mounted		1	2	5	5	--	--	183				
	Sub-Total							4,026				
Switching/Protective Devices												
Overhead		1	2	5	5	--	--	17				
Underground		1	2	3	3	--	--	28				
Pad Mounted		1	2	5	5	--	--	7				
	Sub-Total							52				
Regulators												
Overhead		1	2	5	5	--	--	3				
Underground		1	2	3	3	--	--	0				
Pad Mounted		1	2	5	5	--	--	0				
	Sub-Total							3				
Capacitors												
Overhead		1	2	5	5	--	--	38				
Underground		1	2	3	3	--	--	0				
Pad Mounted		1	2	5	5	--	--	0				
	Sub-Total							38				
Conductors, Cables												
Overhead (Conductor Miles)		1	2	5	5	--	--	1,794				
Street Lights		1	2	--	--	--	--	100				
Wood Poles		1	2	--	--	20	20	16,798				
	Total							22,811	17	0	17	100%

(1) For 1998, SCE patrolled circuits to conduct simple visual inspections of distribution facilities. Underground structures and equipment are not opened on Circuit Patrol Inspections.

**General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Kernville District**

		1998				
		Inspections				
		Patrol				
Distribution Equipment	Planned (1)	Complete (2)	Balance Remaining	Explanation For Balance (> 0)	Recovery Date	
Transformers						
Overhead	0	3,766	0			
Underground	0	77	0			
Pad Mounted	0	183	0			
Sub-Total	0	4,026	0			
Switching/Protective Devices						
Overhead	0	17	0			
Underground	0	28	0			
Pad Mounted	0	7	0			
Sub-Total	0	52	0			
Regulators						
Overhead	0	3	0			
Underground	0	0	0			
Pad Mounted	0	0	0			
Sub-Total	0	3	0			
Capacitors						
Overhead	0	38	0			
Underground	0	0	0			
Pad Mounted	0	0	0			
Sub-Total	0	38	0			
Conductors, Cables						
Overhead (Conductor Miles)	0	1,794	0			
Street Lights						
Overhead	0	0	0			
Wood Poles						
Overhead	0	16,798	0			
Total	0	22,711	0			
(1) Planned Patrol Inspections are based on Required Circuit Patrols (excl Streetlights). Planned amounts are different from 1997 GO 165 Report due to changes in the inventory and the quantity of required circuit patrols.						
(2) Completed Patrol Inspections are based on the percentage of total patrolled circuits (excl Streetlights).						

**General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Kernville District**

		1998		Inspections		Detail/Intrusive			
Distribution Equipment	Planned	Complete	Balance Remaining	Explanation For Balance (>0)	Recovery Date				
Transformers									
Overhead	0	0	0						
Underground	14	19	0						
Pad Mounted	4	4	0						
Sub-Total	18	23	0						
Switching/Protective Devices									
Overhead	0	0	0						
Underground	19	21	0						
Pad Mounted	0	0	0						
Sub-Total	19	21	0						
Regulators									
Overhead	0	0	0						
Underground	0	0	0						
Pad Mounted	0	0	0						
Sub-Total	0	0	0						
Capacitors									
Overhead	0	0	0						
Underground	0	0	0						
Pad Mounted	0	0	0						
Sub-Total	0	0	0						
Conductors, Cables									
Overhead (Conductor Miles)	0	0	0						
Street Lights									
	N/A	N/A	N/A						
Wood Poles									
	0	27	0						
Total	37	71	0						

**General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Kernville District**


		1998		
		Inspections (1)(2)		
		Summary		
Distribution Equipment	Planned	Complete	Balance Remaining	
Transformers				
Overhead	0	3,766	0	
Underground	14	96	0	
Pad Mounted	4	187	0	
Sub-Total	18	4,049	0	
Switching/Protective Devices				
Overhead	0	17	0	
Underground	19	49	0	
Pad Mounted	0	7	0	
Sub-Total	19	73	0	
Regulators				
Overhead	0	3	0	
Underground	0	0	0	
Pad Mounted	0	0	0	
Sub-Total	0	3	0	
Capacitors				
Overhead	0	38	0	
Underground	0	0	0	
Pad Mounted	0	0	0	
Sub-Total	0	38	0	
Conductors, Cables (Overhead (Conductor Miles))	0	1,794	0	
Street Lights	0	0	0	
Wood Poles	0	16,825	0	
Total	37	22,782	0	
	(1) Total inspections may exceed total inventory of an asset as equipment may be inspected twice in a year.			
	(2) Includes Patrols + Details/Intrusives.			

**General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Kernville District**

1998 Corrective Action									
Distribution Equipment	Level 4			Level 5			Balance Remaining	%	%
	Scheduled	Completed	Balance Remaining	Scheduled	Completed	Balance Remaining			
Transformers									
Overhead	1	1	0	0	0	0	0.0%	0.0%	0.0%
Underground	0	0	0	0	0	0	0.0%	0.0%	0.0%
Pad Mounted	0	0	0	0	0	0	0.0%	0.0%	0.0%
Sub-Total	1	1	0	0	0	0	0.0%	0.0%	0.0%
Switching/Protective Devices									
Overhead	0	1	0	0	0	0	0.0%	0.0%	0.0%
Underground	0	0	0	0	0	0	0.0%	0.0%	0.0%
Pad Mounted	0	0	0	0	0	0	0.0%	0.0%	0.0%
Sub-Total	0	1	0	0	0	0	0.0%	0.0%	0.0%
Regulators									
Overhead	0	0	0	0	0	0	0.0%	0.0%	0.0%
Underground	0	0	0	0	0	0	0.0%	0.0%	0.0%
Pad Mounted	0	0	0	0	0	0	0.0%	0.0%	0.0%
Sub-Total	0	0	0	0	0	0	0.0%	0.0%	0.0%
Capacitors									
Overhead	0	7	0	0	1	0	0.0%	0.0%	0.0%
Underground	0	0	0	0	0	0	0.0%	0.0%	0.0%
Pad Mounted	0	0	0	0	0	0	0.0%	0.0%	0.0%
Sub-Total	0	7	0	0	1	0	0.0%	0.0%	0.0%
Conductors, Cables									
Overhead (Conductor Miles)	0	0	0	0	0	0	0.0%	0.0%	0.0%
Street Lights									
Overhead	0	0	0	0	0	0	0.0%	0.0%	0.0%
Wood Poles									
Overhead	21	5	16	5	2	3	76.2%	60.0%	60.0%
Total	22	14	16	5	3	3	72.7%	60.0%	60.0%
(1) Percentage of remaining Corrective Actions									

**General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Kernville District**

		1998				Corrective Action		Recovery
		Summary (2)				Explanation For Balance (> 0)	Date	
Distribution Equipment	Scheduled	Completed	Balance Remaining	% (1)				
Transformers								
Overhead	1	1	0	0.0%				
Underground	0	0	0	0.0%				
Pad Mounted	0	0	0	0.0%				
Sub-Total	1	1	0	0.0%				
Switching/Protective Devices								
Overhead	0	1	0	0.0%				
Underground	0	0	0	0.0%				
Pad Mounted	0	0	0	0.0%				
Sub-Total	0	1	0	0.0%				
Regulators								
Overhead	0	0	0	0.0%				
Underground	0	0	0	0.0%				
Pad Mounted	0	0	0	0.0%				
Sub-Total	0	0	0	0.0%				
Capacitors								
Overhead	0	8	0	0.0%				
Underground	0	0	0	0.0%				
Pad Mounted	0	0	0	0.0%				
Sub-Total	0	8	0	0.0%				
Conductors, Cables								
Overhead (Conductor Miles)	0	0	0	0.0%				
Street Lights								
	0	0	0	0.0%				
Wood Poles								
	26	7	19	73.1%	Additional repairs/replacements were performed in other districts.		31-Dec-99	
Total	27	17	19	70.4%				
(1) Percentage of remaining Corrective Actions								
(2) Summary = Condition Level 4 + Condition Level 5 from Page 6.								

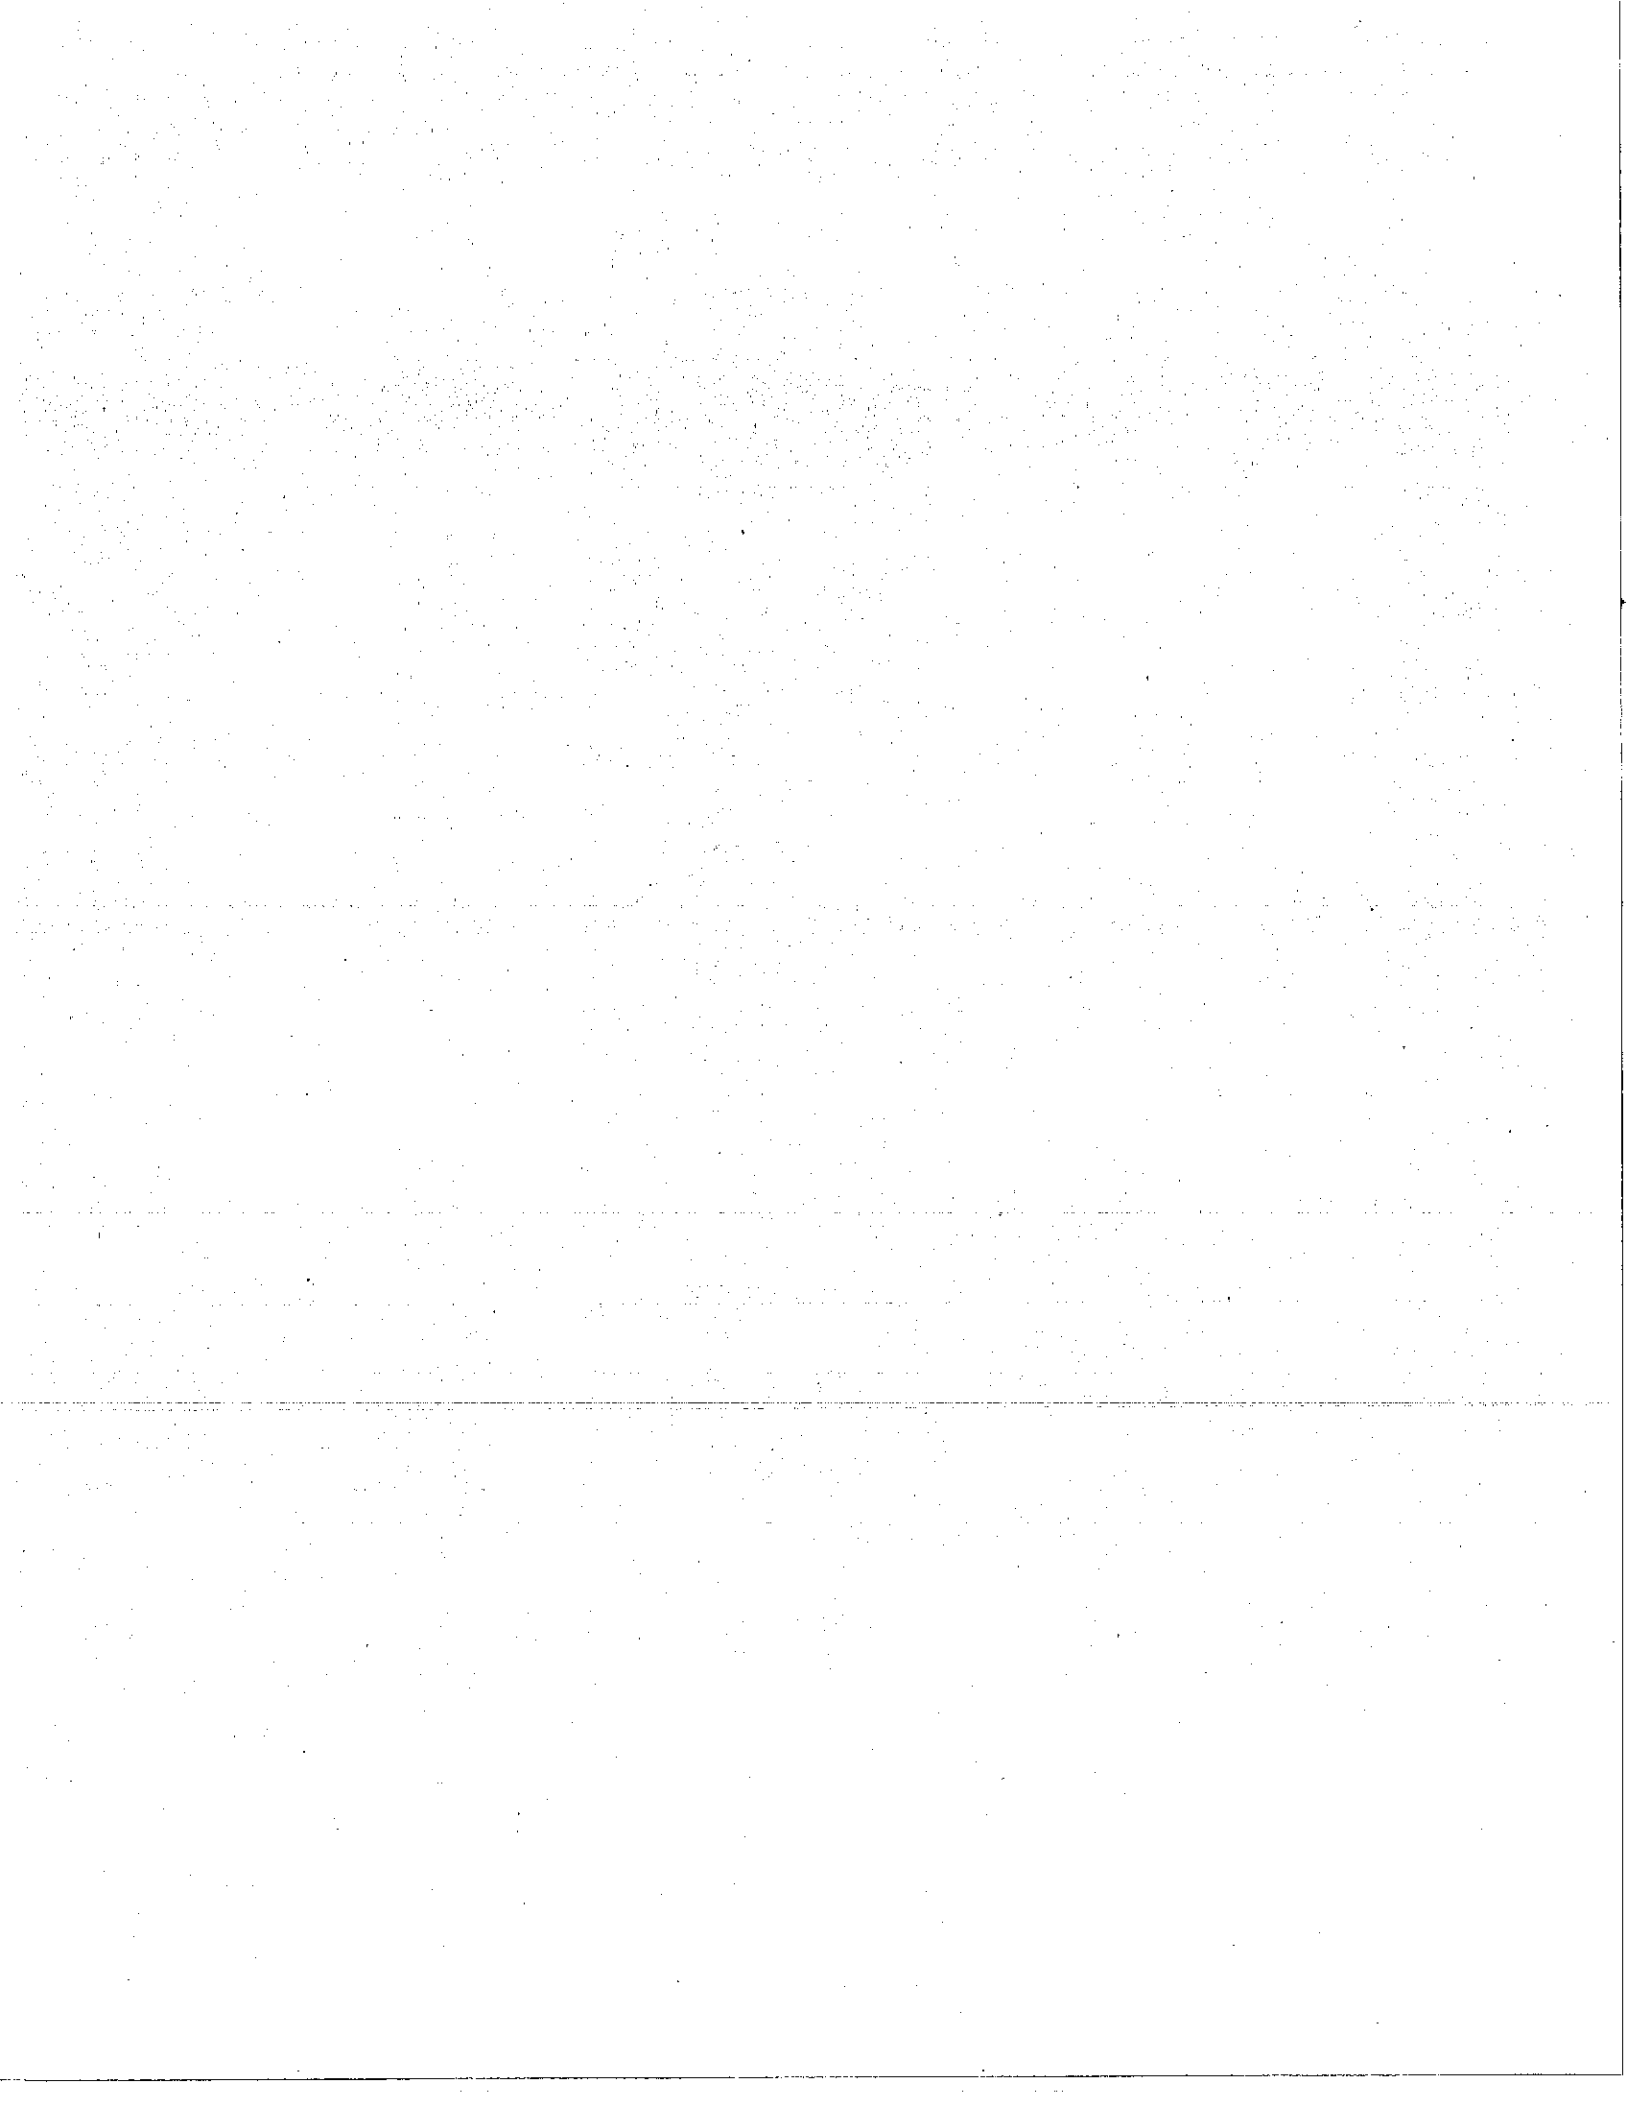

**General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Catalina District**

1998												
Inspection Cycles												
Distribution Equipment	(Maximum Intervals in Years)										Circuits	
	Patrol		Detailed		Intrusive		Total Inventory		Total Circuits	Required	Patrolled (1)	%
	Urban	Rural	Urban	Rural	Urban	Rural	Urban	Rural				
Transformers												
Overhead	1	2	5	5	-	-	225	-				
Underground	1	2	3	3	-	-	53	-				
Pad Mounted	1	2	5	5	-	-	45	-				
Sub-Total							323					
Switching/Protective Devices												
Overhead	1	2	5	5	-	-	0	-				
Underground	1	2	3	3	-	-	23	-				
Pad Mounted	1	2	5	5	-	-	2	-				
Sub-Total							25					
Regulators												
Overhead	1	2	5	5	-	-	0	-				
Underground	1	2	3	3	-	-	0	-				
Pad Mounted	1	2	5	5	-	-	0	-				
Sub-Total							0					
Capacitors												
Overhead	1	2	5	5	-	-	1	-				
Underground	1	2	3	3	-	-	0	-				
Pad Mounted	1	2	5	5	-	-	0	-				
Sub-Total							1					
Conductors, Cables												
Overhead (Conductor Miles)	1	2	5	5	-	-	199	-				
	1	2	-	-	-	-	213	-				
Street Lights												
Wood Poles	1	2	-	-	20	20	1,346	20	4	0	4	100%
Total							2,107		4	0	4	100%
(1) For 1998, SCE patrolled circuits to conduct simple visual inspections of distribution facilities. Underground structures and equipment are not opened on Circuit Patrol Inspections.												

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Catalina District

		1998		Inspections ⁽¹⁾⁽²⁾	
		Summary		Balance	
Distribution Equipment	Planned	Complete	Remaining		
Transformers					
Overhead	0	225	0		
Underground	6	78	0		
Pad Mounted	7	53	0		
Sub-Total	13	356	0		
Switching/Protective Devices					
Overhead	0	0	0		
Underground	18	44	0		
Pad Mounted	0	4	0		
Sub-Total	18	48	0		
Regulators					
Overhead	0	0	0		
Underground	0	0	0		
Pad Mounted	0	0	0		
Sub-Total	0	0	0		
Capacitors					
Overhead	0	1	0		
Underground	0	0	0		
Pad Mounted	0	0	0		
Sub-Total	0	1	0		
Conductors, Cables					
Overhead (Conductor Miles)	0	199	0		
Street Lights					
	0	0	0		
Wood Poles					
	0	1,346	0		
Total	31	1,950	0		
(1) Total inspections may exceed total inventory of an asset as equipment may be inspected twice in a year.					
(2) Includes Patrols + Details/Intrusives.					

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Catalina District

		1998						
		Condition Rating						
Distribution Equipment	Total	Level 1, 2, 3	Level 4	Level 5	Summary (2)			
		Total	% (1)	Total	% (1)	Total	% (1)	
Transformers								
Overhead	225	100.0%	0	0.0%	0	0.0%	225	100.0%
Underground	78	100.0%	0	0.0%	0	0.0%	78	100.0%
Pad Mounted	53	100.0%	0	0.0%	0	0.0%	53	100.0%
Sub-Total	356	100.0%	0	0.0%	0	0.0%	356	100.0%
Switching/Protective Devices								
Overhead	0	0.0%	0	0.0%	0	0.0%	0	0.0%
Underground	44	100.0%	0	0.0%	0	0.0%	44	100.0%
Pad Mounted	4	100.0%	0	0.0%	0	0.0%	4	100.0%
Sub-Total	48	100.0%	0	0.0%	0	0.0%	48	100.0%
Regulators								
Overhead	0	0.0%	0	0.0%	0	0.0%	0	0.0%
Underground	0	0.0%	0	0.0%	0	0.0%	0	0.0%
Pad Mounted	0	0.0%	0	0.0%	0	0.0%	0	0.0%
Sub-Total	0	0.0%	0	0.0%	0	0.0%	0	0.0%
Capacitors								
Overhead	1	100.0%	0	0.0%	0	0.0%	1	100.0%
Underground	0	0.0%	0	0.0%	0	0.0%	0	0.0%
Pad Mounted	0	0.0%	0	0.0%	0	0.0%	0	0.0%
Sub-Total	1	100.0%	0	0.0%	0	0.0%	1	100.0%
Conductors, Cables								
Overhead (Conductor Miles)	199	100.0%	0	0.0%	0	0.0%	199	100.0%
Street Lights								
Overhead	0	0.0%	0	0.0%	0	0.0%	0	0.0%
Wood Poles								
Overhead	1,346	100.0%	0	0.0%	0	0.0%	1,346	100.0%
Total	1,950	100.0%	0	0.0%	0	0.0%	1,950	100.0%
		(1) Percentage of Total Completed Inspections						
		(2) Total condition rating exceeds total inventory as it includes patrol and detailed/intrusive inspections.						

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Catalina District

		1998				Corrective Action			
		Level 4		Level 5					
Distribution Equipment	Scheduled	Completed	Balance Remaining	% (1)	Scheduled	Completed	Balance Remaining	% (1)	
Transformers									
Overhead	0	0	0	0.0%	0	0	0	0.0%	
Underground	0	0	0	0.0%	0	0	0	0.0%	
Pad Mounted	0	0	0	0.0%	0	0	0	0.0%	
Sub-Total	0	0	0	0.0%	0	0	0	0.0%	
Switching/Protective Devices									
Overhead	0	0	0	0.0%	0	0	0	0.0%	
Underground	0	0	0	0.0%	0	0	0	0.0%	
Pad Mounted	0	0	0	0.0%	0	0	0	0.0%	
Sub-Total	0	0	0	0.0%	0	0	0	0.0%	
Regulators									
Overhead	0	0	0	0.0%	0	0	0	0.0%	
Underground	0	0	0	0.0%	0	0	0	0.0%	
Pad Mounted	0	0	0	0.0%	0	0	0	0.0%	
Sub-Total	0	0	0	0.0%	0	0	0	0.0%	
Capacitors									
Overhead	0	0	0	0.0%	0	0	0	0.0%	
Underground	0	0	0	0.0%	0	0	0	0.0%	
Pad Mounted	0	0	0	0.0%	0	0	0	0.0%	
Sub-Total	0	0	0	0.0%	0	0	0	0.0%	
Conductors, Cables									
Overhead (Conductor Miles)	0	0	0	0.0%	0	0	0	0.0%	
Street Lights									
	0	0	0	0.0%	0	0	0	0.0%	
Wood Poles									
	0	0	0	0.0%	0	0	0	0.0%	
Total	0	0	0	0.0%	0	0	0	0.0%	
(1) Percentage of remaining Corrective Actions									

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Catalina District

		1998		Corrective Action		Summary (2)		Explanation For Balance (> 0)		Recovery Date	
Distribution Equipment		Scheduled	Completed	Balance Remaining	% (1)						
Transformers											
	Overhead	0	0	0	0.0%						
	Underground	0	0	0	0.0%						
	Pad Mounted	0	0	0	0.0%						
	Sub-Total	0	0	0	0.0%						
Switching/Protective Devices											
	Overhead	0	0	0	0.0%						
	Underground	0	0	0	0.0%						
	Pad Mounted	0	0	0	0.0%						
	Sub-Total	0	0	0	0.0%						
Regulators											
	Overhead	0	0	0	0.0%						
	Underground	0	0	0	0.0%						
	Pad Mounted	0	0	0	0.0%						
	Sub-Total	0	0	0	0.0%						
Capacitors											
	Overhead	0	0	0	0.0%						
	Underground	0	0	0	0.0%						
	Pad Mounted	0	0	0	0.0%						
	Sub-Total	0	0	0	0.0%						
Conductors, Cables											
	Overhead (Conductor Miles)	0	0	0	0.0%						
Street Lights											
		0	0	0	0.0%						
Wood Poles											
		0	0	0	0.0%						
	Total	0	0	0	0.0%						
		(1) Percentage of remaining Corrective Actions									
		(2) Summary = Condition Level 4 + Condition Level 5 form Page 6.									

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Catalina District

	1999						
	Inspections			Corrective Actions			
	Detail/Intru	1999 Planned	Detail/ Intrusive	Total Planned	'98 Balance Remaining	1999 Planned (a)	Total Planned
Distribution Equipment	'98 Balance Remaining	Patrol (a)		Total Planned	'98 Balance Remaining	1999 Planned (a)	Total Planned
Transformers							
Overhead	0	0	0	0	0	0	0
Underground	0	0	21	21	0	0	0
Pad Mounted	0	0	2	2	0	0	0
Sub-Total	0	0	23	23	0	0	0
Switching/Protective Devices							
Overhead	0	0	0	0	0	0	0
Underground	0	0	2	2	0	0	0
Pad Mounted	0	0	0	0	0	0	0
Sub-Total	0	0	2	2	0	0	0
Regulators							
Overhead	0	0	0	0	0	0	0
Underground	0	0	0	0	0	0	0
Pad Mounted	0	0	0	0	0	0	0
Sub-Total	0	0	0	0	0	0	0
Capacitors							
Overhead	0	0	0	0	0	0	0
Underground	0	0	0	0	0	0	0
Pad Mounted	0	0	0	0	0	0	0
Sub-Total	0	0	0	0	0	0	0
Conductors, Cables							
Overhead (Conductor Miles)	0	0	0	0	0	0	0
Street Lights							
	N/A	213	N/A	213	0	0	0
Wood Poles							
	0	0	0	0	0	0	0
Total	0	213	25	238	0	0	0
(1) District is not required to patrol circuits in 1999. 100% of street lights are planned to be patrolled in 1999.							
(2) Corrective actions planned to be completed in 1999 based on items found through previous inspections.							



General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Barstow District

Inspection Cycles										1998		Circuits		
(Maximum Intervals in Years)														
Distribution Equipment	Patrol		Detailed		Instructive		Total Inventory	Total Circuits	Required	Total	Patrolled (%)	%		
	Urban	Rural	Urban	Rural	Urban	Rural								
Transformers														
Overhead	1	2	5	5	--	--	6,497							
Underground	1	2	3	3	--	--	194							
Pad Mounted	1	2	5	5	--	--	411							
Sub-Total							7,102							
Switching/Protective Devices														
Overhead	1	2	5	5	--	--	43							
Underground	1	2	3	3	--	--	51							
Pad Mounted	1	2	5	5	--	--	21							
Sub-Total							115							
Regulators														
Overhead	1	2	5	5	--	--	4							
Underground	1	2	3	3	--	--	0							
Pad Mounted	1	2	5	5	--	--	0							
Sub-Total							4							
Capacitors														
Overhead	1	2	5	5	--	--	77							
Underground	1	2	3	3	--	--	0							
Pad Mounted	1	2	5	5	--	--	0							
Sub-Total							77							
Conductors, Cables														
Overhead (Conductor Miles)	1	2	5	5	--	--	4,216							
Street Lights														
Overhead	1	2	--	--	--	--	1,003							
Wood Poles														
Overhead	1	2	--	--	20	20	26,733							
Total							39,250	57	2	57	100%			
(1) For 1998, SCE patrolled circuits to conduct simple visual inspections of distribution facilities. Underground structures and equipment are not opened on Circuit Patrol Inspections.														

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Barstow District

		1998				
		Inspections				
		Patrol				
Distribution Equipment	Planned (1)	Complete (2)	Balance Remaining	Explanation For Balance (> 0)	Recovery Date	
Transformers						
Overhead	228	6,497	0			
Underground	7	194	0			
Pad Mounted	14	411	0			
Sub-Total	249	7,102	0			
Switching/Protective Devices						
Overhead	2	43	0			
Underground	2	51	0			
Pad Mounted	1	21	0			
Sub-Total	4	115	0			
Regulators						
Overhead	0	4	0			
Underground	0	0	0			
Pad Mounted	0	0	0			
Sub-Total	0	4	0			
Capacitors						
Overhead	3	77	0			
Underground	0	0	0			
Pad Mounted	0	0	0			
Sub-Total	3	77	0			
Conductors, Cables						
Overhead (Conductor Miles)	148	4,216	0			
Street Lights						
	0	1,003	0			
Wood Poles						
	938	26,733	0			
Total	1,342	39,250	0			
(1) Planned Patrol Inspections are based on Required Circuit Patrols (excl Streetlights). Planned amounts are different from 1997 GO 165 Report due to changes in the inventory and the quantity of required circuit patrols. (2) Completed Patrol Inspections are based on the percentage of total patrolled circuits (excl Streetlights).						

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Barstow District

		1998		
		Inspections (1)(2)		
		Summary		
Distribution Equipment	Planned	Complete	Remaining	Balance
Transformers				
Overhead	228	6,497	0	
Underground	16	216	0	
Pad Mounted	57	454	0	
Sub-Total	301	7,167	0	
Switching/Protective Devices				
Overhead	2	43	0	
Underground	35	84	0	
Pad Mounted	5	31	0	
Sub-Total	41	158	0	
Regulators				
Overhead	0	4	0	
Underground	0	0	0	
Pad Mounted	0	0	0	
Sub-Total	0	4	0	
Capacitors				
Overhead	3	77	0	
Underground	0	0	0	
Pad Mounted	0	0	0	
Sub-Total	3	77	0	
Conductors, Cables				
Overhead (Conductor Miles)	148	4,216	0	
Street Lights				
	0	1,003	0	
Wood Poles				
	938	27,149	0	
Total	1,431	39,774	0	


(1) Total inspections may exceed total inventory of an asset as equipment may be inspected twice in a year.
(2) Includes Patrols + Details/Intrusives.

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Barstow District

		1998				Corrective Action			
		Level 4		Level 5		Level 4		Level 5	
Distribution Equipment	Scheduled	Completed	Balance		Scheduled	Completed	Balance		
			Remaining	% (1)			Remaining	% (1)	
Transformers									
Overhead	0	3	0	0.0%	0	0	0	0.0%	
Underground	0	0	0	0.0%	0	0	0	0.0%	
Pad Mounted	0	0	0	0.0%	0	0	0	0.0%	
Sub-Total	0	3	0	0.0%	0	0	0	0.0%	
Switching/Protective Devices									
Overhead	0	4	0	0.0%	0	0	0	0.0%	
Underground	0	0	0	0.0%	0	0	0	0.0%	
Pad Mounted	0	0	0	0.0%	0	0	0	0.0%	
Sub-Total	0	4	0	0.0%	0	0	0	0.0%	
Regulators									
Overhead	0	0	0	0.0%	0	0	0	0.0%	
Underground	0	0	0	0.0%	0	0	0	0.0%	
Pad Mounted	0	0	0	0.0%	0	0	0	0.0%	
Sub-Total	0	0	0	0.0%	0	0	0	0.0%	
Capacitors									
Overhead	0	10	0	0.0%	0	0	0	0.0%	
Underground	0	0	0	0.0%	0	0	0	0.0%	
Pad Mounted	0	0	0	0.0%	0	0	0	0.0%	
Sub-Total	0	10	0	0.0%	0	0	0	0.0%	
Conductors, Cables									
Overhead (Conductor Miles)	0	0	0	0.0%	0	0	0	0.0%	
Street Lights									
	0	0	0	0.0%	0	0	0	0.0%	
Wood Poles									
	0	13	0	0.0%	0	0	0	0.0%	
Total	0	30	0	0.0%	0	0	0	0.0%	
(1) Percentage of remaining Corrective Actions									

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Barstow District

	1999				1999			
	Inspections				Corrective Actions			
	Detail/Intr '98 Balance Remaining	1999 Planned Patrol (1)	Detail/ Intrusive	Total Planned	'98 Balance Remaining	1999 Planned (2)	Total Planned	
Distribution Equipment								
Transformers								
Overhead	0	0	0	0	0	0	0	
Underground	0	0	65	65	0	0	0	
Pad Mounted	0	0	27	27	0	0	0	
Sub-Total	0	0	92	92	0	0	0	
Switching/Protective Devices								
Overhead	0	0	0	0	0	1	1	
Underground	0	0	8	8	0	0	0	
Pad Mounted	0	0	3	3	0	0	0	
Sub-Total	0	0	11	11	0	1	1	
Regulators								
Overhead	0	0	0	0	0	0	0	
Underground	0	0	0	0	0	0	0	
Pad Mounted	0	0	0	0	0	0	0	
Sub-Total	0	0	0	0	0	0	0	
Capacitors								
Overhead	0	0	0	0	0	1	1	
Underground	0	0	0	0	0	0	0	
Pad Mounted	0	0	0	0	0	0	0	
Sub-Total	0	0	0	0	0	1	1	
Conductors, Cables								
Overhead (Conductor Miles)	0	0	0	0	0	0	0	
Street Lights								
N/A	N/A	0	N/A	0	0	0	0	
Wood Poles								
0	0	0	18,000	18,000	0	10	10	
Total	0	0	18,103	18,103	0	12	12	
<p>(1) District is not required to patrol any of its circuits in 1999. No street lights are planned to be patrolled in 1999.</p> <p>(2) Corrective actions planned to be completed in 1999 based on items found through previous inspections.</p>								

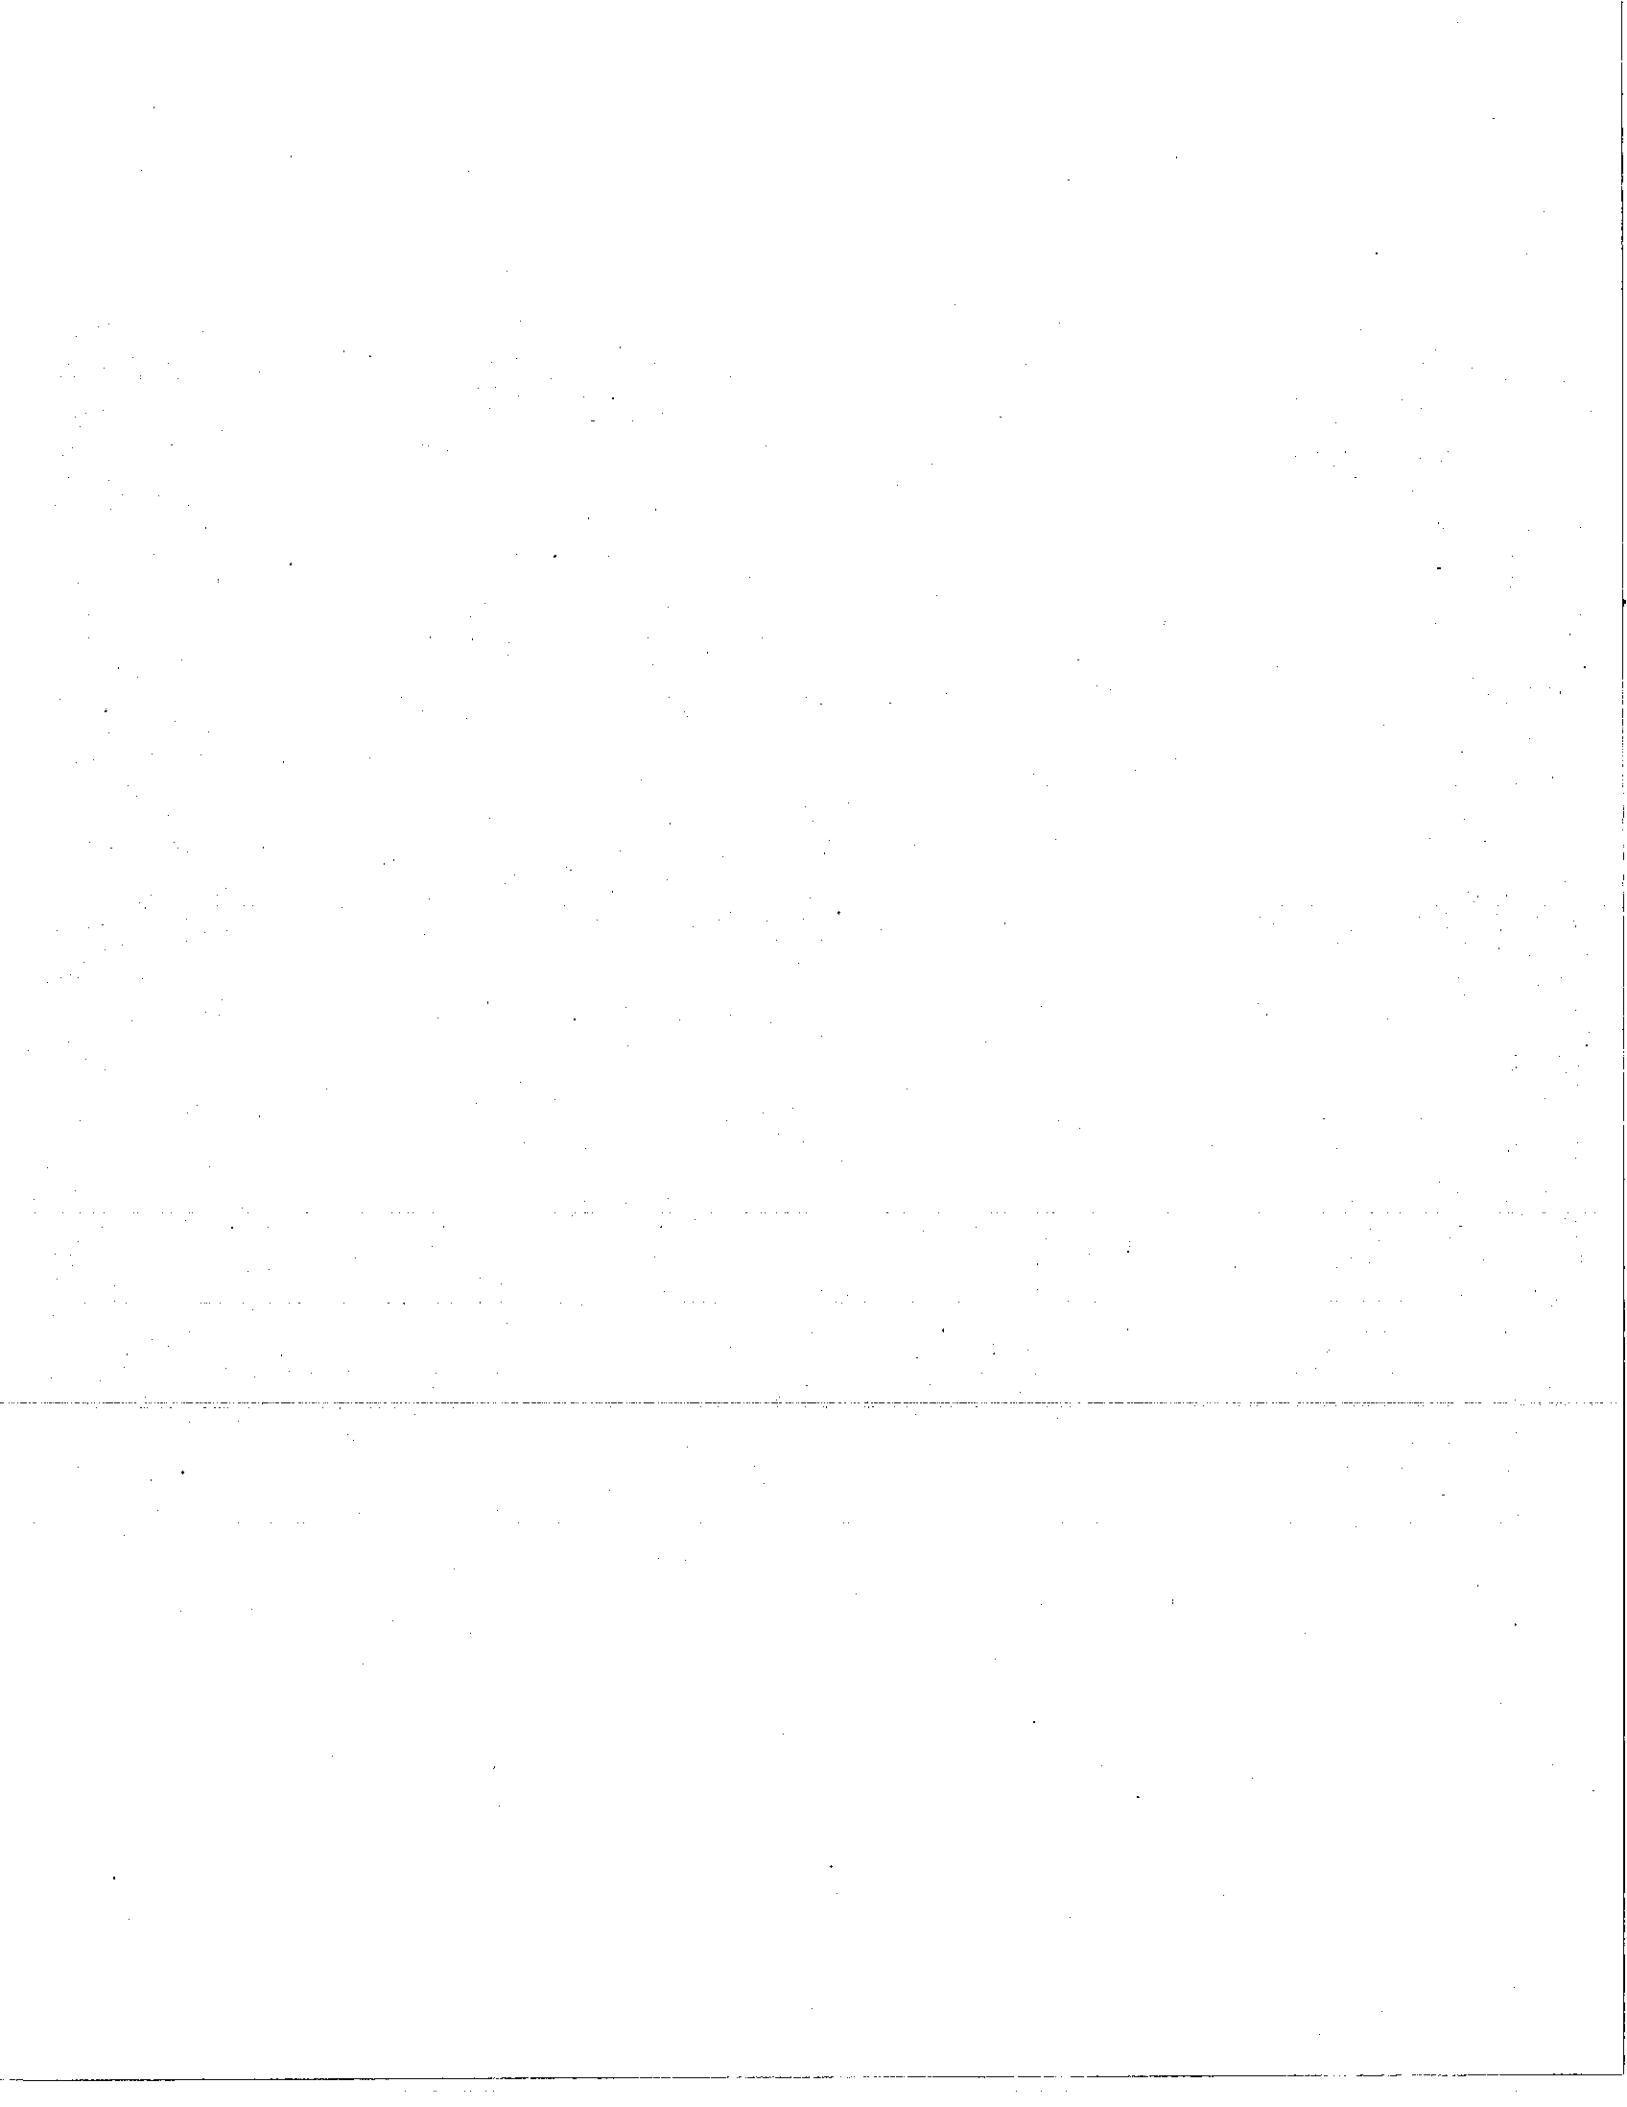

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
29 Palms District

		1998			Inspections		Patrol			
		Planned (1)	Complete (2)	Balance Remaining	Explanation For Balance (> 0)				Recovery Date	
Distribution Equipment										
Transformers										
	Overhead	7,923	7,923	0						
	Underground	66	66	0						
	Pad Mounted	223	223	0						
	Sub-Total	8,213	8,213	0						
Switching/Protective Devices										
	Overhead	117	117	0						
	Underground	27	27	0						
	Pad Mounted	16	16	0						
	Sub-Total	159	159	0						
Regulators										
	Overhead	2	2	0						
	Underground	0	0	0						
	Pad Mounted	0	0	0						
	Sub-Total	2	2	0						
Capacitors										
	Overhead	45	45	0						
	Underground	0	0	0						
	Pad Mounted	0	0	0						
	Sub-Total	45	45	0						
Conductors, Cables										
	Overhead (Conductor Miles)	3,322	3,322	0						
Street Lights										
		0	0	0						
Wood Poles										
		27,741	27,741	0						
	Total	39,481	39,481	0						
<p>(1) Planned Patrol Inspections are based on Required Circuit Patrols (excl Streetlights). Planned amounts are different from 1997 GO 165 Report due to changes in the inventory and the quantity of required circuit patrols</p> <p>(2) Completed Patrol Inspections are based on the percentage of total patrolled circuits (excl Streetlights).</p>										

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
29 Palms District

		1998		
		Inspections (1)(2)		
		Summary		
Distribution Equipment	Planned	Complete	Balance Remaining	
Transformers				
Overhead	7,923	7,923	0	
Underground	69	72	0	
Pad Mounted	277	280	0	
	Sub-Total	8,270	8,276	0
Switching/Protective Devices				
Overhead	117	117	0	
Underground	41	41	0	
Pad Mounted	22	35	0	
	Sub-Total	179	192	0
Regulators				
Overhead	2	2	0	
Underground	0	0	0	
Pad Mounted	0	0	0	
	Sub-Total	2	2	0
Capacitors				
Overhead	45	45	0	
Underground	0	0	0	
Pad Mounted	0	0	0	
	Sub-Total	45	45	0
Conductors, Cables				
Overhead (Conductor Miles)	3,322	3,322	0	
Street Lights				
	0	0	0	
Wood Poles				
	27,741	28,234	0	
	Total	39,558	40,070	0

(1) Total inspections may exceed total inventory of an asset as equipment may be inspected twice in a year.
(2) Includes Patrols + Details/Intrusives.

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
29 Palms District

		1998				Corrective Action (1)			
		Level 4		Balance		Level 5		Balance	
Distribution Equipment	Scheduled	Completed	Remaining	% (1)	Scheduled	Completed	Remaining	% (1)	
Transformers									
Overhead	0	7	0	0.0%	0	0	0	0.0%	
Underground	0	0	0	0.0%	0	0	0	0.0%	
Pad Mounted	0	0	0	0.0%	0	0	0	0.0%	
Sub-Total	0	7	0	0.0%	0	0	0	0.0%	
Switching/Protective Devices									
Overhead	0	0	0	0.0%	0	0	0	0.0%	
Underground	0	0	0	0.0%	0	0	0	0.0%	
Pad Mounted	0	0	0	0.0%	0	0	0	0.0%	
Sub-Total	0	0	0	0.0%	0	0	0	0.0%	
Regulators									
Overhead	0	0	0	0.0%	0	0	0	0.0%	
Underground	0	0	0	0.0%	0	0	0	0.0%	
Pad Mounted	0	0	0	0.0%	0	0	0	0.0%	
Sub-Total	0	0	0	0.0%	0	0	0	0.0%	
Capacitors									
Overhead	0	17	0	0.0%	0	0	0	0.0%	
Underground	0	0	0	0.0%	0	0	0	0.0%	
Pad Mounted	0	0	0	0.0%	0	0	0	0.0%	
Sub-Total	0	17	0	0.0%	0	0	0	0.0%	
Conductors, Cables									
Overhead (Conductor Miles)	0	0	0	0.0%	0	0	0	0.0%	
Street Lights									
	0	0	0	0.0%	0	0	0	0.0%	
Wood Poles									
	0	23	0	0.0%	0	0	0	0.0%	
Total	0	47	0	0.0%	0	0	0	0.0%	
(1) Condition Ratings									
1, 2, 3 No Action Required									
4 Replacements/Repairs between 1 - 2 years.									
5 Replacements/Repairs between 60 - 180 days.									
(2) Percentage of remaining Corrective Actions									

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
29 Palms District

	1999				1999		
	Inspections		Corrective Actions				
	Detail/Intr	1999 Planned	Detail/Intrusive	Total Planned	'98 Balance Remaining	1999 Planned	Total Planned
Distribution Equipment	'98 Balance Remaining	Patrol (1)					
Transformers							
Overhead	0	4,172	0	4,172	0	0	0
Underground	0	35	37	72	0	0	0
Pad Mounted	0	118	34	152	0	0	0
Sub-Total	0	4,325	71	4,396	0	0	0
Switching/Protective Devices							
Overhead	0	61	0	61	0	0	0
Underground	0	14	8	22	0	0	0
Pad Mounted	0	8	4	12	0	0	0
Sub-Total	0	84	12	96	0	0	0
Regulators							
Overhead	0	1	0	1	0	0	0
Underground	0	0	0	0	0	0	0
Pad Mounted	0	0	0	0	0	0	0
Sub-Total	0	1	0	1	0	0	0
Capacitors							
Overhead	0	23	0	23	0	0	0
Underground	0	0	0	0	0	0	0
Pad Mounted	0	0	0	0	0	0	0
Sub-Total	0	23	0	23	0	0	0
Conductors, Cables							
Overhead (Conductor Miles)	0	1,749	0	1,749	0	0	0
Street Lights							
	N/A	918	N/A	918	0	0	0
Wood Poles							
	0	14,608	0	14,608	0	0	0
Total	0	21,708	83	21,791	0	0	0
(1) District is required to patrol 34% of its circuits in 1999.							
100% of street lights are planned to be patrolled in 1999.							
(2) Corrective actions planned to be complete in 1999 based on items found through previous inspections.							

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Bishop District

		Inspection Cycles						1998		Circuits		
		(Maximum Intervals in Years)										
Distribution Equipment	Patrol	Urban		Rural		Instructive	Total Inventory	Total Circuits	Required	Patrolled (1)	%	
		Urban	Rural	Urban	Rural							
Transformers												
Overhead	1	2	5	5	5	--	2,317					
Underground	1	2	3	3	3	--	11					
Pad Mounted	1	2	5	5	5	--	1,233					
Sub-Total							3,561					
Switching/Protective Devices												
Overhead	1	2	5	5	5	--	23					
Underground	1	2	3	3	3	--	140					
Pad Mounted	1	2	5	5	5	--	64					
Sub-Total							227					
Regulators												
Overhead	1	2	5	5	5	--	1					
Underground	1	2	3	3	3	--	0					
Pad Mounted	1	2	5	5	5	--	0					
Sub-Total							1					
Capacitors												
Overhead	1	2	5	5	5	--	41					
Underground	1	2	3	3	3	--	0					
Pad Mounted	1	2	5	5	5	--	2					
Sub-Total							43					
Conductors, Cables												
Overhead (Conductor Miles)	1	2	5	5	5	--	1,326					
Street Lights												
	1	2	--	--	--	--	494					
Wood Poles												
	1	2	--	--	--	--	12,603	▼	▼	▼	▼	
Total							18,255	44	15	44	100%	
(1) For 1998, SCE patrolled circuits to conduct simple visual inspections of distribution facilities. Underground structures and equipment are not opened on Circuit Patrol inspections.												

**General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Bishop District**

		1998			Balance Remaining	Explanation For Balance (> 0)	Recovery Date
		Inspections Patrol					
Distribution Equipment		Planned (1)	Complete (2)				
Transformers							
	Overhead	790	2,317	0			
	Underground	4	11	0			
	Pad Mounted	420	1,233	0			
	Sub-Total	1,214	3,561	0			
Switching/Protective Devices							
	Overhead	8	23	0			
	Underground	48	140	0			
	Pad Mounted	22	64	0			
	Sub-Total	77	227	0			
Regulators							
	Overhead	0	1	0			
	Underground	0	0	0			
	Pad Mounted	0	0	0			
	Sub-Total	0	1	0			
Capacitors							
	Overhead	14	41	0			
	Underground	0	0	0			
	Pad Mounted	1	2	0			
	Sub-Total	15	43	0			
Conductors, Cables							
	Overhead (Conductor Miles)	452	1,326	0			
Street Lights							
		0	0	0			
Wood Poles							
		4,296	12,603	0			
	Total	6,055	17,761	0			
<p>(1) Planned Patrol Inspections are based on Required Circuit Patrols (excl Streetlights). Planned amounts are different from 1997 GO 165 due to changes in the inventory and the quantity of required circuit patrols. (2) Completed Patrol Inspections are based on the percentage of total patrolled circuits (excl Streetlights).</p>							

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Bishop District

		1998		
		Inspections ⁽¹⁾⁽²⁾		
		Summary		
		Balance		
Distribution Equipment	Planned	Complete	Remaining	
Transformers				
Overhead	790	2,317	0	
Underground	4	11	0	
Pad Mounted	594	1,415	0	
Sub-Total	1,388	3,743	0	
Switching/Protective Devices				
Overhead	8	23	0	
Underground	139	231	0	
Pad Mounted	25	106	0	
Sub-Total	171	360	0	
Regulators				
Overhead	0	1	0	
Underground	0	0	0	
Pad Mounted	0	0	0	
Sub-Total	0	1	0	
Capacitors				
Overhead	14	41	0	
Underground	0	0	0	
Pad Mounted	1	4	0	
Sub-Total	15	45	0	
Conductors, Cables				
Overhead (Conductor Miles)	452	1,326	0	
Street Lights				
	0	0	0	
Wood Poles				
	4,296	12,642	0	
Total	6,323	18,117	0	
(1) Total Inspections may exceed total inventory of an asset as equipment may be inspected twice in a year.				
(2) Includes Patrols + Details/Intrusives.				

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Bishop District

		1998						
		Condition Rating						
		Level 1, 2, 3		Level 4	Level 5	Summary (2)		
		Total	% (1)	Total	% (1)	Total	% (1)	
Distribution Equipment								
Transformers								
	Overhead	2,317	100.0%	0	0.0%	0	0.0%	
	Underground	11	100.0%	0	0.0%	11	100.0%	
	Pad Mounted	1,415	100.0%	0	0.0%	1,415	100.0%	
	Sub-Total	3,743	100.0%	0	0.0%	3,743	100.0%	
Switching/Protective Devices								
	Overhead	23	100.0%	0	0.0%	23	100.0%	
	Underground	230	99.6%	1	0.4%	231	100.0%	
	Pad Mounted	106	100.0%	0	0.0%	106	100.0%	
	Sub-Total	359	99.7%	1	0.3%	360	100.0%	
Regulators								
	Overhead	1	100.0%	0	0.0%	1	100.0%	
	Underground	0	0.0%	0	0.0%	0	0.0%	
	Pad Mounted	0	0.0%	0	0.0%	0	0.0%	
	Sub-Total	1	100.0%	0	0.0%	1	100.0%	
Capacitors								
	Overhead	41	100.0%	0	0.0%	41	100.0%	
	Underground	0	0.0%	0	0.0%	0	0.0%	
	Pad Mounted	4	100.0%	0	0.0%	4	100.0%	
	Sub-Total	45	100.0%	0	0.0%	45	100.0%	
Conductors, Cables								
	Overhead (Conductor Miles)	1,326	100.0%	0	0.0%	1,326	100.0%	
Street Lights								
		0	0.0%	0	0.0%	0	0.0%	
Wood Poles								
		12,626	99.9%	16	0.1%	12,642	100.0%	
	Total	18,100	99.9%	17	0.1%	18,117	100.0%	
		(1) Percentage of Total Completed Inspections						
		(2) Total condition rating exceeds total inventory as it includes patrol and detailed/intrusive inspections.						

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Bishop District


		1998									
		Corrective Action									
		Level 4					Level 5				
Distribution Equipment	Scheduled	Completed	Balance		% (1)	Scheduled	Completed	Balance		% (1)	
			Remaining					Remaining			
Transformers											
Overhead	1	1	0	0	0.0%	0	0	0	0	0.0%	
Underground	0	0	0	0	0.0%	0	0	0	0	0.0%	
Pad Mounted	0	0	0	0	0.0%	0	0	0	0	0.0%	
Sub-Total	1	1	0	0	0.0%	0	0	0	0	0.0%	
Switching/Protective Devices											
Overhead	0	0	0	0	0.0%	0	0	0	0	0.0%	
Underground	0	1	0	0	0.0%	0	0	0	0	0.0%	
Pad Mounted	0	0	0	0	0.0%	0	0	0	0	0.0%	
Sub-Total	0	1	0	0	0.0%	0	0	0	0	0.0%	
Regulators											
Overhead	0	0	0	0	0.0%	0	0	0	0	0.0%	
Underground	0	0	0	0	0.0%	0	0	0	0	0.0%	
Pad Mounted	0	0	0	0	0.0%	0	0	0	0	0.0%	
Sub-Total	0	0	0	0	0.0%	0	0	0	0	0.0%	
Capacitors											
Overhead	0	0	0	0	0.0%	0	0	0	0	0.0%	
Underground	0	0	0	0	0.0%	0	0	0	0	0.0%	
Pad Mounted	0	0	0	0	0.0%	0	0	0	0	0.0%	
Sub-Total	0	0	0	0	0.0%	0	0	0	0	0.0%	
Conductors, Cables											
Overhead (Conductor Miles)	0	0	0	0	0.0%	0	0	0	0	0.0%	
Street Lights											
	0	0	0	0	0.0%	0	0	0	0	0.0%	
Wood Poles											
	0	52	0	0	0.0%	0	0	0	0	0.0%	
Total	1	54	0	0	0.0%	0	0	0	0	0.0%	
		(1) Percentage of remaining Corrective Actions									

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Bishop District

		1998		Corrective Action		Summary (2)		Recovery	
Distribution Equipment		Scheduled	Completed	Balance Remaining	% (1)	Explanation For Balance (> 0)		Date	
Transformers									
	Overhead	1	1	0	0.0%				
	Underground	0	0	0	0.0%				
	Pad Mounted	0	0	0	0.0%				
	Sub-Total	1	1	0	0.0%				
Switching/Protective Devices									
	Overhead	0	0	0	0.0%				
	Underground	0	1	0	0.0%				
	Pad Mounted	0	0	0	0.0%				
	Sub-Total	0	1	0	0.0%				
Regulators									
	Overhead	0	0	0	0.0%				
	Underground	0	0	0	0.0%				
	Pad Mounted	0	0	0	0.0%				
	Sub-Total	0	0	0	0.0%				
Capacitors									
	Overhead	0	0	0	0.0%				
	Underground	0	0	0	0.0%				
	Pad Mounted	0	0	0	0.0%				
	Sub-Total	0	0	0	0.0%				
Conductors, Cables									
	Overhead (Conductor Miles)	0	0	0	0.0%				
Street Lights									
	Overhead	0	0	0	0.0%				
Wood Poles									
	Overhead	0	52	0	0.0%				
	Total	1	54	0	0.0%				
		(1) Percentage of remaining Corrective Actions							
		(2) Summary = Condition Level 4 + Condition Level 5 from page 6.							

**General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Bishop District**

	1999						
	Inspections			Corrective Actions			
	Detail/Intru '98 Balance Remaining	1999 Planned Patrol (1)	Detail/ Intrusive	Total Planned	'98 Balance Remaining	1999 Planned (2)	Total Planned
Distribution Equipment							
Transformers							
Overhead	0	0	0	0	0	0	0
Underground	0	0	10	10	0	0	0
Pad Mounted	0	0	33	33	0	0	0
Sub-Total	0	0	43	43	0	0	0
Switching/Protective Devices							
Overhead	0	0	0	0	0	0	0
Underground	0	0	43	43	0	0	0
Pad Mounted	0	0	16	16	0	0	0
Sub-Total	0	0	59	59	0	0	0
Regulators							
Overhead	0	0	0	0	0	0	0
Underground	0	0	0	0	0	0	0
Pad Mounted	0	0	0	0	0	0	0
Sub-Total	0	0	0	0	0	0	0
Capacitors							
Overhead	0	0	0	0	0	0	0
Underground	0	0	0	0	0	0	0
Pad Mounted	0	0	0	0	0	0	0
Sub-Total	0	0	0	0	0	0	0
Conductors, Cables							
Overhead (Conductor Miles)	0	0	0	0	0	0	0
Street Lights							
N/A	N/A	494	N/A	494	0	0	0
Wood Poles							
0	0	0	0	0	0	0	0
Total	0	494	102	596	0	3	3
(1) District is not required to patrol circuits in 1999. 100% of street lights are planned to be patrolled in 1999.							
(2) Corrective actions planned to be completed in 1999 based on items found through previous inspections.							

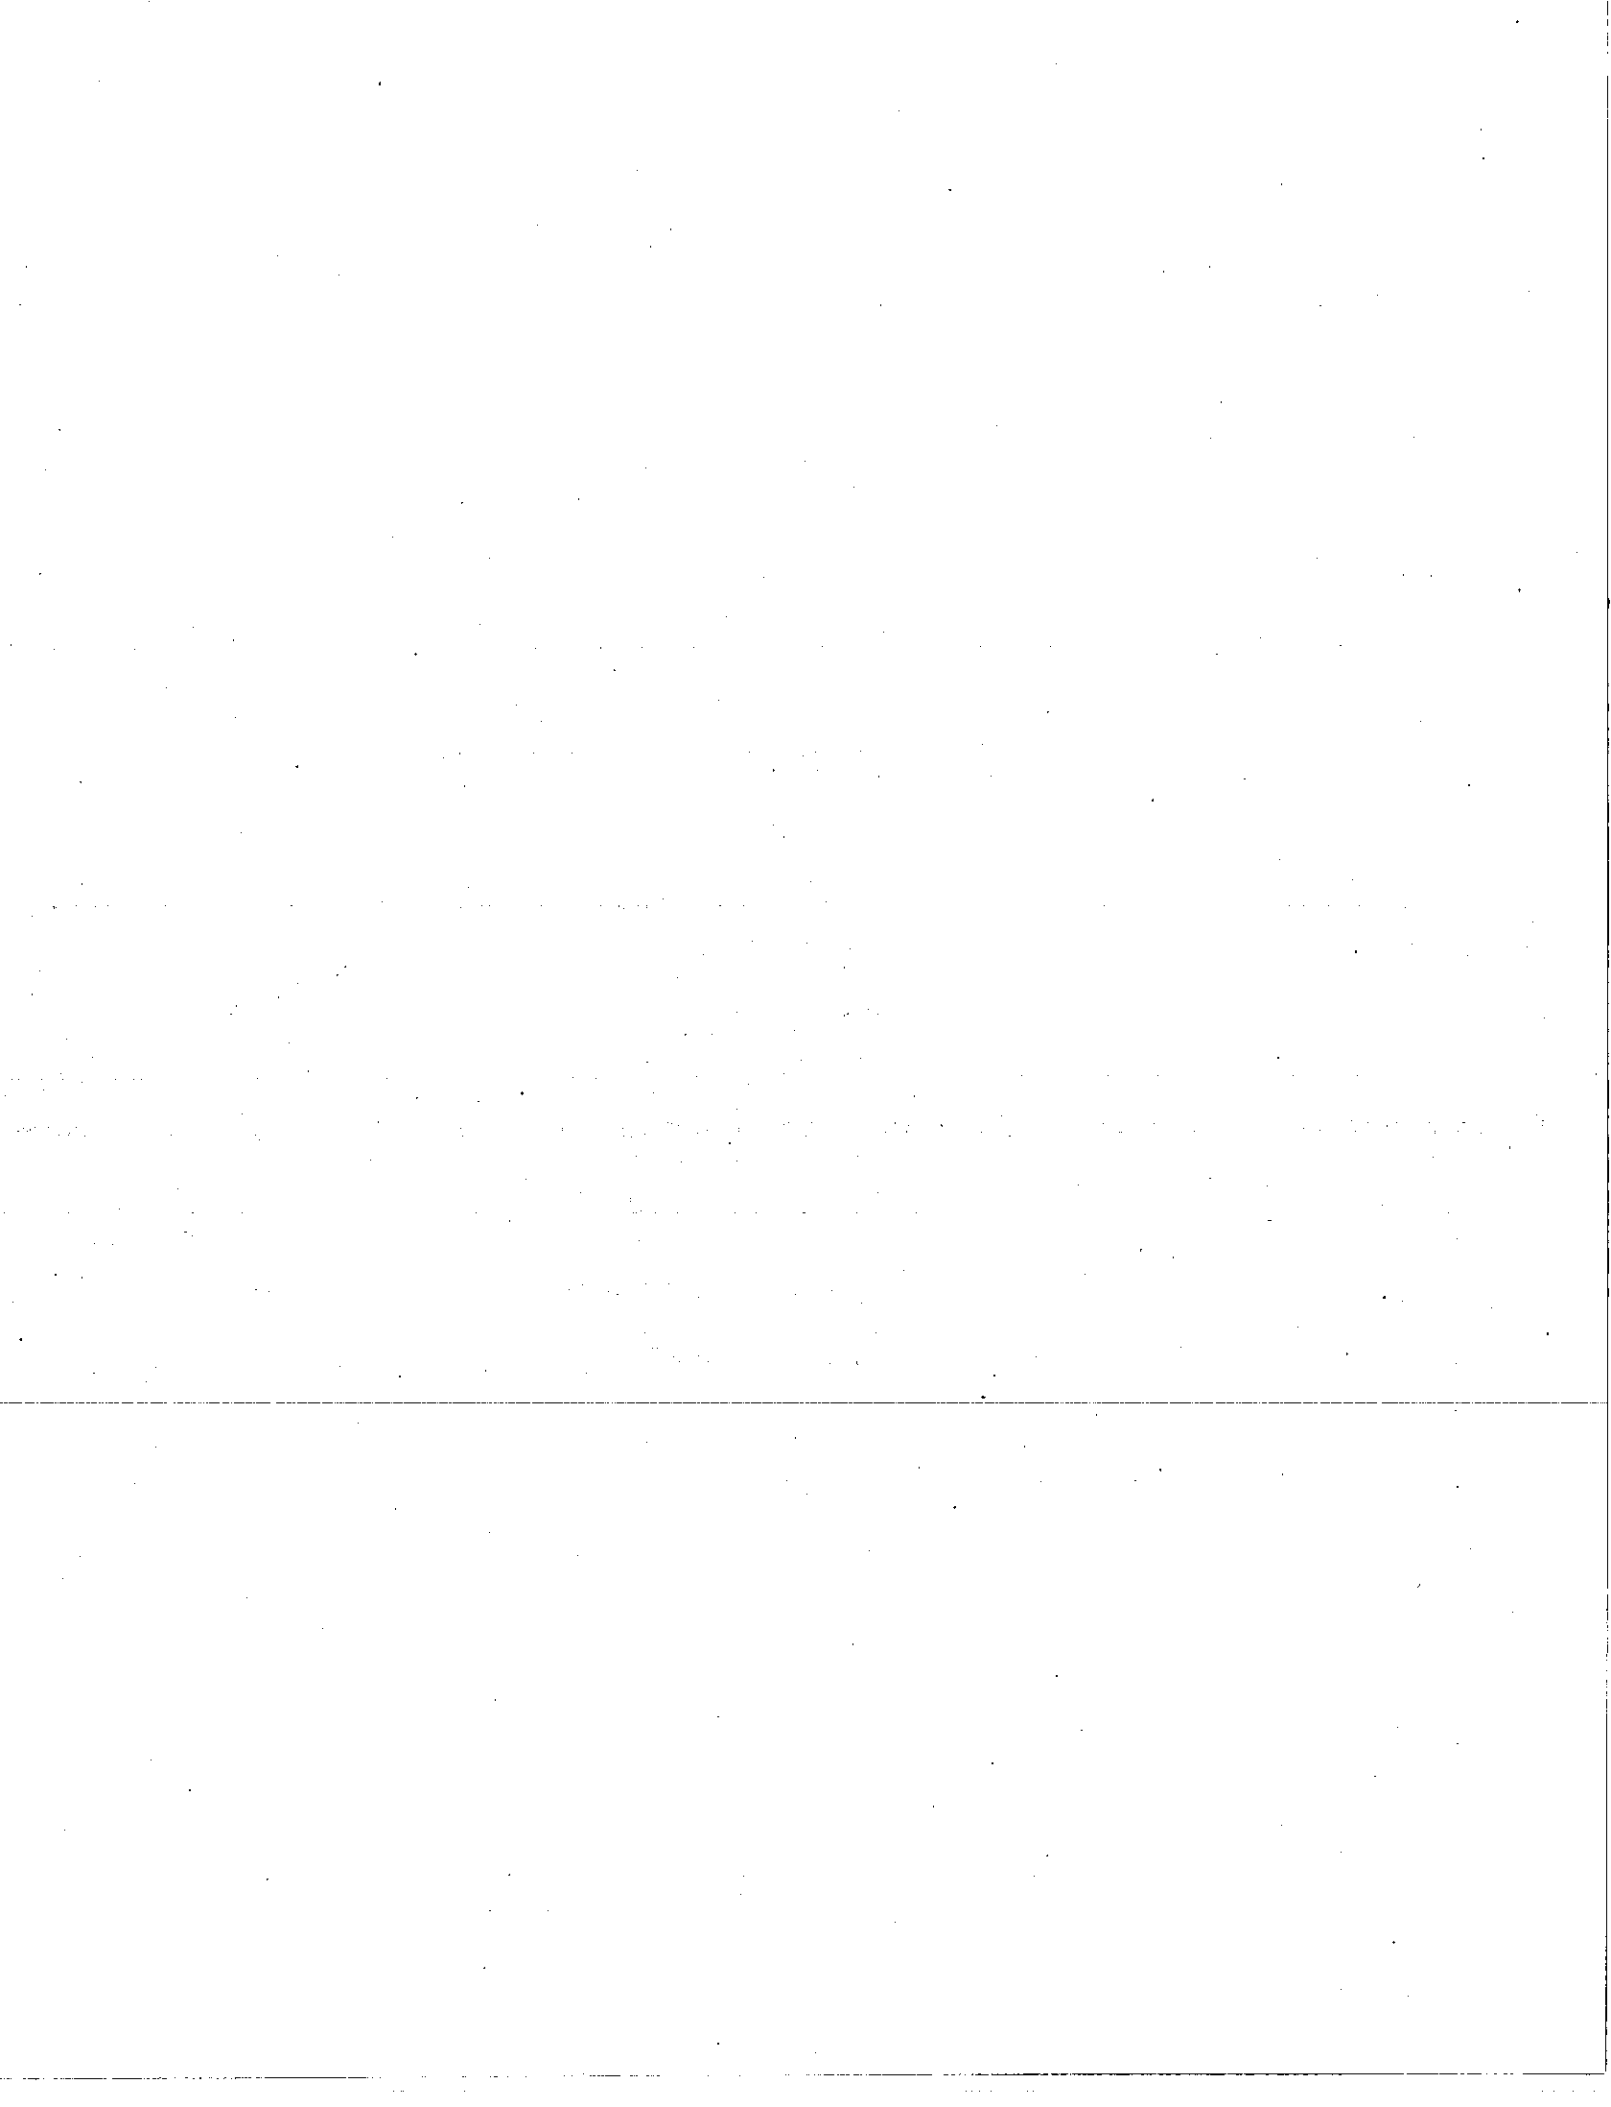

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Ridgecrest District

		Inspection Cycles						1998		Circuits			
		(Maximum Intervals In Years)											
Distribution Equipment	Patrol	Urban		Rural		Instructive	Total	Total	Required	Total	%		
		Detailed	Urban	Detailed	Rural							Inventory	Circuits
Transformers													
Overhead	1	2	5	5	5	--	4,829						
Underground	1	2	3	3	3	--	401						
Pad Mounted	1	2	5	5	5	--	820						
Sub-Total							6,050						
Switching/Protective Devices													
Overhead	1	2	5	5	5	--	33						
Underground	1	2	3	3	3	--	134						
Pad Mounted	1	2	5	5	5	--	72						
Sub-Total							239						
Regulators													
Overhead	1	2	5	5	5	--	2						
Underground	1	2	3	3	3	--	0						
Pad Mounted	1	2	5	5	5	--	0						
Sub-Total							2						
Capacitors													
Overhead	1	2	5	5	5	--	92						
Underground	1	2	3	3	3	--	0						
Pad Mounted	1	2	5	5	5	--	0						
Sub-Total							92						
Conductors, Cables													
Overhead (Conductor Miles)	1	2	5	5	5	--	2,816						
Street Lights													
	1	2	--	--	--	--	2,499						
Wood Poles													
	1	2	--	--	--	--	20,810						
Total							32,508	50	33	35	100%		

(1) For 1998, SCE patrolled circuits to conduct simple visual inspections of distribution facilities. Underground structures and equipment are not opened on Circuit Patrol Inspections.

**General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Ridgecrest District**

		1998			Inspections ^{(1), (2)}		Patrol		Explanation For Balance (> 0)		Recovery Date	
Distribution Equipment		Planned	Complete	Balance Remaining								
Transformers												
	Overhead	3,187	3,380	0								
	Underground	265	281	0								
	Pad Mounted	541	574	0								
	Sub-Total	3,993	4,235	0								
Switching/Protective Devices												
	Overhead	22	23	0								
	Underground	88	94	0								
	Pad Mounted	48	50	0								
	Sub-Total	158	167	0								
Regulators												
	Overhead	1	1	0								
	Underground	0	0	0								
	Pad Mounted	0	0	0								
	Sub-Total	1	1	0								
Capacitors												
	Overhead	61	64	0								
	Underground	0	0	0								
	Pad Mounted	0	0	0								
	Sub-Total	61	64	0								
Conductors, Cables												
	Overhead (Conductor Miles)	1,859	1,971	0								
Street Lights												
		0	2,499	0								
Wood Poles												
		13,735	14,567	0								
	Total	19,806	23,505	0								
<p>(1) Planned Patrol Inspections are based on Required Circuit Patrols (excl Streetlights). Planned amounts are different from 1997 GO 165 Report due to changes in the inventory and the quantity of required circuit patrols</p> <p>(2) Completed Patrol Inspections are based on the percentage of total patrolled circuits (excl Streetlights).</p>												

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Ridgecrest District

		1998		
		Inspections (1)(2)		
		Summary		
Distribution Equipment	Planned	Complete	Balance Remaining	
Transformers				
Overhead	3,187	3,380	0	
Underground	283	312	0	
Pad Mounted	632	694	0	
Sub-Total	4,102	4,386	0	
Switching/Protective Devices				
Overhead	22	23	0	
Underground	159	165	0	
Pad Mounted	48	100	0	
Sub-Total	229	288	0	
Regulators				
Overhead	1	1	0	
Underground	0	0	0	
Pad Mounted	0	0	0	
Sub-Total	1	1	0	
Capacitors				
Overhead	61	64	0	
Underground	0	0	0	
Pad Mounted	0	0	0	
Sub-Total	61	64	0	
Conductors, Cables				
Overhead (Conductor Miles)	1,859	1,971	0	
Street Lights				
	0	2,499	0	
Wood Poles				
	13,735	14,649	0	
Total	19,986	23,859	0	

(1) Total inspections may exceed total inventory of an asset as equipment may be inspected twice in a year.

(2) Includes Patrols + Details/Intrusives.

**General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Ridgecrest District**

		1998							
		Condition Rating							
		Level 1, 2, 3		Level 4		Level 5		Summary (a)	
		Total	% (1)	Total	% (1)	Total	% (1)	Total	% (1)
Distribution Equipment									
	Transformers								
	Overhead	3,379	100.0%	0	0.0%	1	0.0%	3,380	100.0%
	Underground	312	100.0%	0	0.0%	0	0.0%	312	100.0%
	Pad Mounted	694	100.0%	0	0.0%	0	0.0%	694	100.0%
	Sub-Total	4,385	100.0%	0	0.0%	1	0.0%	4,386	100.0%
	Switching/Protective Devices								
	Overhead	22	95.7%	1	4.3%	0	0.0%	23	100.0%
	Underground	164	99.4%	0	0.0%	1	0.6%	165	100.0%
	Pad Mounted	100	100.0%	0	0.0%	0	0.0%	100	100.0%
	Sub-Total	286	99.3%	1	0.3%	1	0.3%	288	100.0%
	Regulators								
	Overhead	1	100.0%	0	0.0%	0	0.0%	1	100.0%
	Underground	0	0.0%	0	0.0%	0	0.0%	0	0.0%
	Pad Mounted	0	0.0%	0	0.0%	0	0.0%	0	0.0%
	Sub-Total	1	100.0%	0	0.0%	0	0.0%	1	100.0%
	Capacitors								
	Overhead	57	89.1%	7	10.9%	0	0.0%	64	100.0%
	Underground	0	0.0%	0	0.0%	0	0.0%	0	0.0%
	Pad Mounted	0	0.0%	0	0.0%	0	0.0%	0	0.0%
	Sub-Total	57	89.1%	7	10.9%	0	0.0%	64	100.0%
	Conductors, Cables								
	Overhead (Conductor Miles)	1,971	100.0%	0	0.0%	0	0.0%	1,971	100.0%
	Street Lights								
		2,499	100.0%	0	0.0%	0	0.0%	2,499	100.0%
	Wood Poles								
		14,649	100.0%	0	0.0%	0	0.0%	14,649	100.0%
	Total	23,849	100.0%	8	0.0%	2	0.0%	23,859	100.0%
		(1) Percentage of Total Completed Inspections							
		(2) Total condition rating exceeds total inventory as it includes patrol and detailed/intrusive inspections.							

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Ridgecrest District


		1998				Corrective Action			
		Level 4		Level 5					
Distribution Equipment	Scheduled	Completed	Balance Remaining	% (1)	Scheduled	Completed	Balance Remaining	% (1)	
Transformers									
Overhead	1	1	0	0.0%	0	1	0	0.0%	
Underground	0	0	0	0.0%	0	0	0	0.0%	
Pad Mounted	0	0	0	0.0%	0	0	0	0.0%	
Sub-Total	1	1	0	0.0%	0	1	0	0.0%	
Switching/Protective Devices									
Overhead	0	1	0	0.0%	0	0	0	0.0%	
Underground	1	2	0	0.0%	0	0	0	0.0%	
Pad Mounted	0	0	0	0.0%	0	0	0	0.0%	
Sub-Total	1	3	0	0.0%	0	0	0	0.0%	
Regulators									
Overhead	0	0	0	0.0%	0	0	0	0.0%	
Underground	0	0	0	0.0%	0	0	0	0.0%	
Pad Mounted	0	0	0	0.0%	0	0	0	0.0%	
Sub-Total	0	0	0	0.0%	0	0	0	0.0%	
Capacitors									
Overhead	0	14	0	0.0%	0	0	0	0.0%	
Underground	0	0	0	0.0%	0	0	0	0.0%	
Pad Mounted	0	0	0	0.0%	0	0	0	0.0%	
Sub-Total	0	14	0	0.0%	0	0	0	0.0%	
Conductors, Cables									
Overhead (Conductor Miles)	0	0	0	0.0%	0	0	0	0.0%	
Street Lights									
	0	0	0	0.0%	0	0	0	0.0%	
Wood Poles									
	0	21	0	0.0%	0	1	0	0.0%	
Total	2	39	0	0.0%	0	2	0	0.0%	
(1) Percentage of remaining Corrective Actions									

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Ridgecrest District

				1998		Corrective Action		Summary (2)					
Distribution Equipment		Scheduled	Completed	Balance Remaining	% (1)	Explanation For Balance (> 0)				Recovery Date			
Transformers													
	Overhead	1	2	0	0.0%								
	Underground	0	0	0	0.0%								
	Pad Mounted	0	0	0	0.0%								
	Sub-Total	1	2	0	0.0%								
Switching/Protective Devices													
	Overhead	0	1	0	0.0%								
	Underground	1	2	0	0.0%								
	Pad Mounted	0	0	0	0.0%								
	Sub-Total	1	3	0	0.0%								
Regulators													
	Overhead	0	0	0	0.0%								
	Underground	0	0	0	0.0%								
	Pad Mounted	0	0	0	0.0%								
	Sub-Total	0	0	0	0.0%								
Capacitors													
	Overhead	0	14	0	0.0%								
	Underground	0	0	0	0.0%								
	Pad Mounted	0	0	0	0.0%								
	Sub-Total	0	14	0	0.0%								
Conductors, Cables													
	Overhead (Conductor Miles)	0	.0	0	0.0%								
Street Lights													
		0	0	0	0.0%								
Wood Poles													
		0	22	0	0.0%								
	Total	2	41	0	0.0%								
		(1) Percentage of remaining Corrective Actions											
		(2) Summary = Condition Level 4 + condition Level 5 from Page 6.											

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Ridgecrest District

	1999				1999			
	Inspections				Corrective Actions			
	Detail/Intru	1998 Planned	Detail/Intrusive	Total Planned	'98 Balance Remaining	1999 Planned (1)	Total Planned	
	'98 Balance Remaining	Patrol (2)						
Distribution Equipment								
Transformers								
Overhead	0	1,642	0	1,642	0	0	0	
Underground	0	136	272	408	0	0	0	
Pad Mounted	0	279	48	327	0	0	0	
Sub-Total	0	2,057	320	2,377	0	0	0	
Switching/Protective Devices								
Overhead	0	11	0	11	0	0	0	
Underground	0	46	44	90	0	0	0	
Pad Mounted	0	24	13	37	0	0	0	
Sub-Total	0	81	57	138	0	0	0	
Regulators								
Overhead	0	1	0	1	0	0	0	
Underground	0	0	0	0	0	0	0	
Pad Mounted	0	0	0	0	0	0	0	
Sub-Total	0	1	0	1	0	0	0	
Capacitors								
Overhead	0	31	0	31	0	0	0	
Underground	0	0	0	0	0	0	0	
Pad Mounted	0	0	0	0	0	0	0	
Sub-Total	0	31	0	31	0	0	0	
Conductors, Cables								
Overhead (Conductor Miles)	0	957	0	957	0	0	0	
Street Lights								
	N/A	0	N/A	0	0	0	0	
Wood Poles								
	0	7,075	0	7,075	0	2	2	
Total	0	10,203	377	10,580	0	2	2	
<p>(1) District is required to patrol 34% of its circuits in 1999. No street lights are planned to be patrolled in 1999. (2) Corrective actions planned to be completed in 1999 based on items found through previous inspections.</p>								

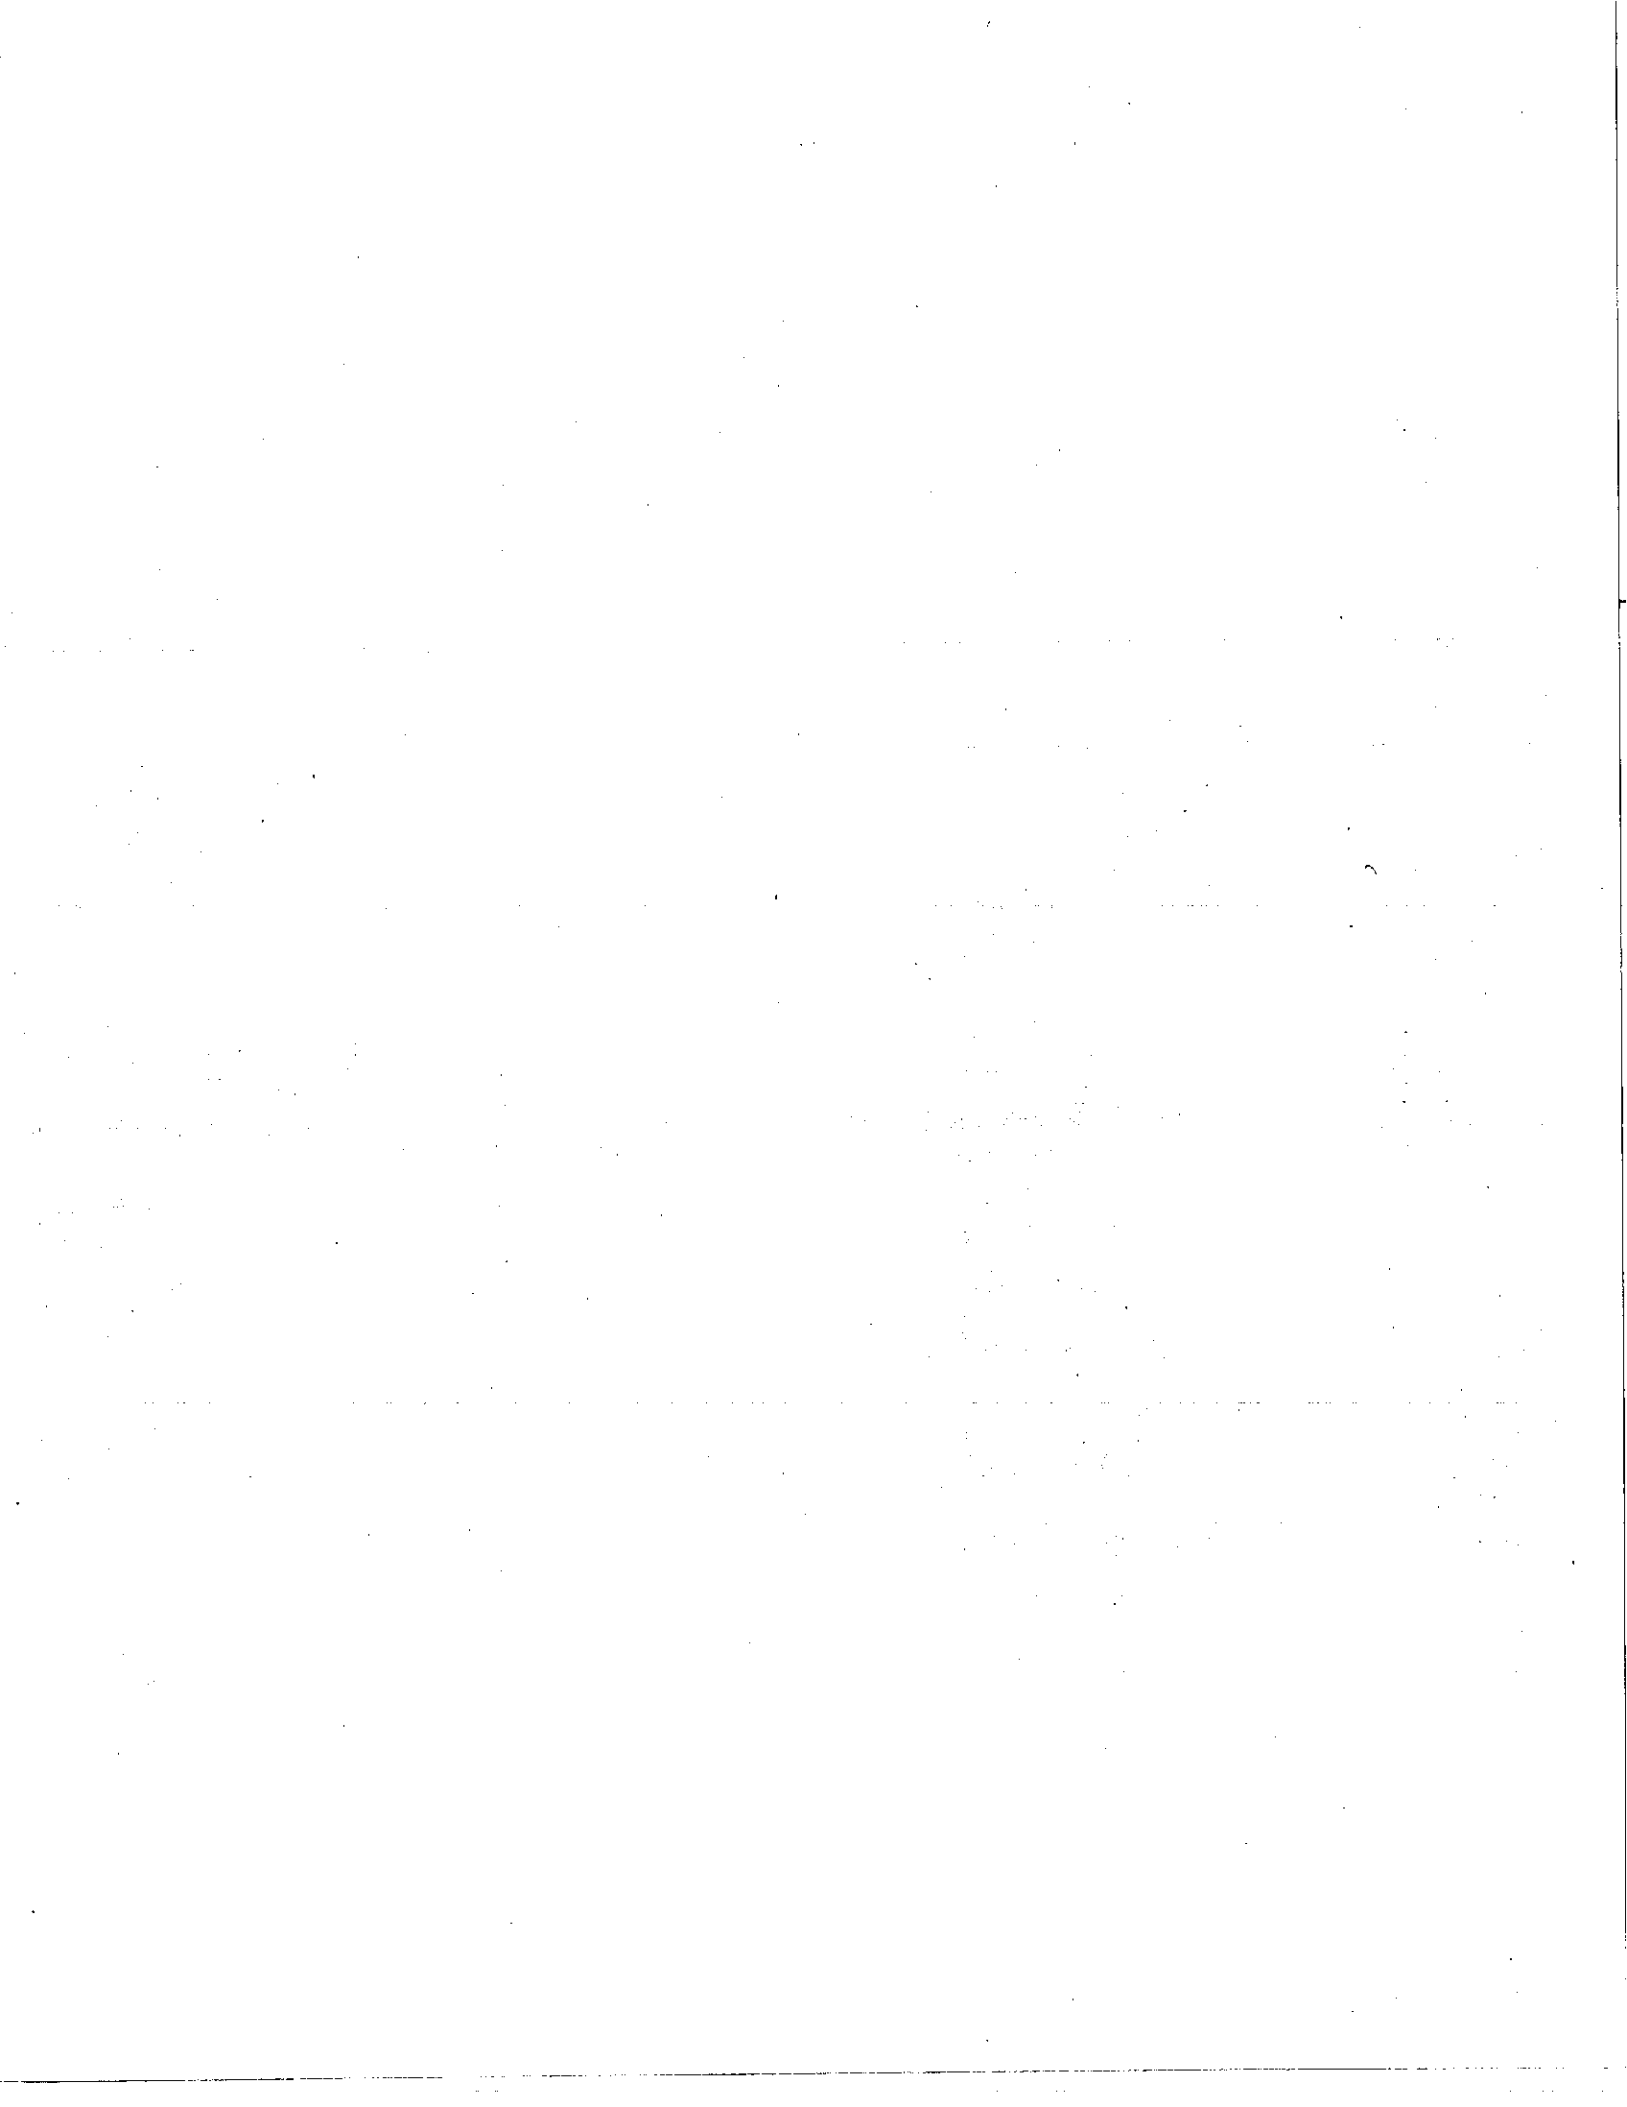

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Blythe District

Inspection Cycles										1998		Circuits			
(Maximum Intervals In Years)															
Distribution Equipment	Patrol		Detailed		Intrusive		Total Inventory	Total Circuits	Required	Patrolled (%)	Total	%			
	Urban	Rural	Urban	Rural	Urban	Rural									
Transformers															
Overhead	1	2	5	5	—	—	3,287								
Underground	1	2	3	3	—	—	92								
Pad Mounted	1	2	5	5	—	—	366								
Sub-Total							3,745								
Switching/Protective Devices															
Overhead	1	2	5	5	—	—	152								
Underground	1	2	3	3	—	—	22								
Pad Mounted	1	2	5	5	—	—	46								
Sub-Total							220								
Regulators															
Overhead	1	2	5	5	—	—	4								
Underground	1	2	3	3	—	—	0								
Pad Mounted	1	2	5	5	—	—	0								
Sub-Total							4								
Capacitors															
Overhead	1	2	5	5	—	—	79								
Underground	1	2	3	3	—	—	0								
Pad Mounted	1	2	5	5	—	—	0								
Sub-Total							79								
Conductors, Cables															
Overhead (Conductor Miles)	1	2	5	5	—	—	2,070								
Street Lights															
	1	2	—	—	—	—	1,185								
Wood Poles															
	1	2	—	—	20	20	13,473								
Total							20,776	39	2		39	100%			

(1) For 1998, SCE patrolled circuits to conduct simple visual inspections of distribution facilities. Underground structures and equipment are not opened on Circuit Patrol Inspections.

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Blythe District

		1998			Explanation For Balance (> 0)	Recovery Date
		Inspections				
		Patrol				
Distribution Equipment	Planned (1)	Complete (2)	Balance Remaining			
Transformers						
Overhead	169	3,287	0			
Underground	5	92	0			
Pad Mounted	19	366	0			
Sub-Total	192	3,745	0			
Switching/Protective Devices						
Overhead	8	152	0			
Underground	1	22	0			
Pad Mounted	2	46	0			
Sub-Total	11	220	0			
Regulators						
Overhead	0	4	0			
Underground	0	0	0			
Pad Mounted	0	0	0			
Sub-Total	0	4	0			
Capacitors						
Overhead	4	79	0			
Underground	0	0	0			
Pad Mounted	0	0	0			
Sub-Total	4	79	0			
Conductors, Cables						
Overhead (Conductor Miles)	106	2,070	0			
Street Lights						
	0	1,185	0			
Wood Poles						
	691	13,473	0			
Total	1,005	20,776	0			
(1) Planned Patrol Inspections are based on Required Circuit Patrols (excl Streetlights). Planned amounts are different from 1997 GO 165 Report due to changes in the inventory and the quantity of required circuit patrols (2) Completed Patrol Inspections are based on the percentage of total patrolled circuits (excl Streetlights).						

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Blythe District

		1998		
		Inspections ⁽¹⁾⁽²⁾		
		Summary		
Distribution Equipment		Planned	Complete	Balance Remaining
Transformers				
Overhead		169	3,287	0
Underground		15	104	0
Pad Mounted		57	407	0
	Sub-Total	240	3,798	0
Switching/Protective Devices				
Overhead		8	152	0
Underground		30	51	0
Pad Mounted		10	75	0
	Sub-Total	48	278	0
Regulators				
Overhead		0	4	0
Underground		0	0	0
Pad Mounted		0	0	0
	Sub-Total	0	4	0
Capacitors				
Overhead		4	79	0
Underground		0	0	0
Pad Mounted		0	0	0
	Sub-Total	4	79	0
Conductors, Cables				
Overhead (Conductor Miles)		106	2,070	0
Street Lights				
		0	1,185	0
Wood Poles				
		986	14,050	0
	Total	1,385	21,464	0
<p>(1) Total inspections may exceed total inventory of an asset as equipment may be inspected twice in a year.</p> <p>(2) Includes Patrols + Details/Intrusives.</p>				

**General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Blythe District**


		1998						
		Condition Rating						
		Level 1, 2, 3	Level 4	Level 5	Summary			
		Total	% (1)	Total	% (1)	Total	% (1)	
Distribution Equipment								
Transformers								
Overhead		3,287	100.0%	0	0.0%	3,287	100.0%	
Underground		104	100.0%	0	0.0%	104	100.0%	
Pad Mounted		407	100.0%	0	0.0%	407	100.0%	
Sub-Total		3,798	100.0%	0	0.0%	3,798	100.0%	
Switching/Protective Devices								
Overhead		152	100.0%	0	0.0%	152	100.0%	
Underground		51	100.0%	0	0.0%	51	100.0%	
Pad Mounted		75	100.0%	0	0.0%	75	100.0%	
Sub-Total		278	100.0%	0	0.0%	278	100.0%	
Regulators								
Overhead		4	100.0%	0	0.0%	4	100.0%	
Underground		0	0.0%	0	0.0%	0	0.0%	
Pad Mounted		0	0.0%	0	0.0%	0	0.0%	
Sub-Total		4	100.0%	0	0.0%	4	100.0%	
Capacitors								
Overhead		79	100.0%	0	0.0%	79	100.0%	
Underground		0	0.0%	0	0.0%	0	0.0%	
Pad Mounted		0	0.0%	0	0.0%	0	0.0%	
Sub-Total		79	100.0%	0	0.0%	79	100.0%	
Conductors, Cables								
Overhead (Conductor Miles)		2,070	100.0%	0	0.0%	2,070	100.0%	
Street Lights								
Overhead		1,185	100.0%	0	0.0%	1,185	100.0%	
Wood Poles								
Overhead		14,003	99.7%	44	0.3%	14,050	100.0%	
Underground		0	0.0%	0	0.0%	0	0.0%	
Pad Mounted		0	0.0%	0	0.0%	0	0.0%	
Sub-Total		14,003	99.7%	44	0.3%	14,050	100.0%	
Total		21,417	99.8%	44	0.2%	21,464	100.0%	
		(1) Percentage of Total Completed Inspections						
		(2) Total condition rating exceeds total Inventory as it includes patrol and detailed/intrusive inspections.						

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Blythe District

		Level 4		Level 5					
		Scheduled	Completed	Balance Remaining	% (1)	Scheduled	Completed	Balance Remaining	% (1)
1998									
Corrective Action									
Distribution Equipment									
Transformers									
Overhead	0	0	0	0	0.0%	0	0	0	0.0%
Underground	0	0	0	0	0.0%	0	0	0	0.0%
Pad Mounted	0	0	0	0	0.0%	0	0	0	0.0%
Sub-Total	0	0	0	0	0.0%	0	0	0	0.0%
Switching/Protective Devices									
Overhead	0	0	0	0	0.0%	0	0	0	0.0%
Underground	0	0	0	0	0.0%	0	0	0	0.0%
Pad Mounted	0	0	0	0	0.0%	0	0	0	0.0%
Sub-Total	0	0	0	0	0.0%	0	0	0	0.0%
Regulators									
Overhead	0	0	0	0	0.0%	0	0	0	0.0%
Underground	0	0	0	0	0.0%	0	0	0	0.0%
Pad Mounted	0	0	0	0	0.0%	0	0	0	0.0%
Sub-Total	0	0	0	0	0.0%	0	0	0	0.0%
Capacitors									
Overhead	0	0	0	0	0.0%	0	0	0	0.0%
Underground	0	0	0	0	0.0%	0	0	0	0.0%
Pad Mounted	0	0	0	0	0.0%	0	0	0	0.0%
Sub-Total	0	0	0	0	0.0%	0	0	0	0.0%
Conductors, Cables									
Overhead (Conductor Miles)	0	0	0	0	0.0%	0	0	0	0.0%
Street Lights									
	0	0	0	0	0.0%	0	0	0	0.0%
Wood Poles									
	0	50	0	0	0.0%	0	0	0	0.0%
Total	0	50	0	0	0.0%	0	0	0	0.0%
(1) Percentage of remaining Corrective Actions									

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Blythe District

	1999 Inspections				1999 Corrective Actions		
	Detail/Intru '98 Balance Remaining	1999 Planned Patrol (1)	Detail/ Intrusive	Total Planned	'98 Balance Remaining	1999 Planned	Total Planned
Distribution Equipment							
Transformers							
Overhead	0	0	0	0	0	0	0
Underground	0	0	40	40	0	0	0
Pad Mounted	0	0	29	29	0	0	0
Sub-Total	0	0	69	69	0	0	0
Switching/Protective Devices							
Overhead	0	0	0	0	0	0	0
Underground	0	0	8	8	0	0	0
Pad Mounted	0	0	4	4	0	0	0
Sub-Total	0	0	12	12	0	0	0
Regulators							
Overhead	0	0	0	0	0	0	0
Underground	0	0	0	0	0	0	0
Pad Mounted	0	0	0	0	0	0	0
Sub-Total	0	0	0	0	0	0	0
Capacitors							
Overhead	0	0	0	0	0	0	0
Underground	0	0	0	0	0	0	0
Pad Mounted	0	0	0	0	0	0	0
Sub-Total	0	0	0	0	0	0	0
Conductors, Cables							
Overhead (Conductor Miles)	0	0	0	0	0	0	0
Street Lights							
	N/A	0	N/A	0	0	0	0
Wood Poles							
	0	0	0	0	0	1	1
Total	0	0	81	81	0	1	1
(1) District is not required to patrol any of its circuits in 1999.							
No street lights are planned to be patrolled in 1999.							
(2) Corrective actions planned to be completed in 1999 based on items found through previous inspections.							



General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Bishop District

Inspection Cycles										1998		Circuits	
(Maximum Intervals In Years)													
Distribution Equipment	Patrol		Detailed		Instructive		Total Inventory	Total Circuits	Required	Total Patrolled (1)	%		
	Urban	Rural	Urban	Rural	Urban	Rural							
Transformers													
Overhead	1	2	5	5	--	--	2,317						
Underground	1	2	3	3	--	--	11						
Pad Mounted	1	2	5	5	--	--	1,238						
Sub-Total							3,561						
Switching/Protective Devices													
Overhead	1	2	5	5	--	--	23						
Underground	1	2	3	3	--	--	140						
Pad Mounted	1	2	5	5	--	--	64						
Sub-Total							227						
Regulators													
Overhead	1	2	5	5	--	--	1						
Underground	1	2	3	3	--	--	0						
Pad Mounted	1	2	5	5	--	--	0						
Sub-Total							1						
Capacitors													
Overhead	1	2	5	5	--	--	41						
Underground	1	2	3	3	--	--	0						
Pad Mounted	1	2	5	5	--	--	2						
Sub-Total							43						
Conductors, Cables													
Overhead (Conductor Miles)	1	2	5	5	--	--	1,326						
Street Lights													
	1	2	--	--	--	--	494						
Wood Poles													
	1	2	--	--	20	20	12,603	44	15	44	100%		
Total							18,285	44	15	44	100%		

(1) For 1998, SCE patrolled circuits to conduct simple visual inspections of distribution facilities. Underground structures and equipment are not opened on Circuit Patrol Inspections.

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Bishop District

		1998			Inspections		Patrol		
		Planned (1)	Complete (2)	Balance Remaining	Explanation For Balance (> 0)	Recovery Date			
Distribution Equipment									
Transformers									
	Overhead	790	2,317	0					
	Underground	4	11	0					
	Pad Mounted	420	1,293	0					
	Sub-Total	1,214	3,561	0					
Switching/Protective Devices									
	Overhead	8	23	0					
	Underground	48	140	0					
	Pad Mounted	22	64	0					
	Sub-Total	77	227	0					
Regulators									
	Overhead	0	1	0					
	Underground	0	0	0					
	Pad Mounted	0	0	0					
	Sub-Total	0	1	0					
Capacitors									
	Overhead	14	41	0					
	Underground	0	0	0					
	Pad Mounted	1	2	0					
	Sub-Total	15	43	0					
Conductors, Cables									
	Overhead (Conductor Miles)	452	1,326	0					
Street Lights									
		0	0	0					
Wood Poles									
		4,296	12,603	0					
	Total	6,055	17,761	0					
		(1) Planned Patrol Inspections are based on Required Circuit Patrols (excl Streetlights).							
		Planned amounts are different from 1997 GO 165 due to changes in the inventory and the quantity of required circuit patrols.							
		(2) Completed Patrol Inspections are based on the percentage of total patrolled circuits (excl Streetlights).							

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Bishop District

		1998		
		Inspections (1)(2)		
		Summary		
Distribution Equipment	Planned	Complete	Balance Remaining	
Transformers				
Overhead	790	2,317	0	
Underground	4	11	0	
Pad Mounted	594	1,415	0	
Sub-Total	1,388	3,743	0	
Switching/Protective Devices				
Overhead	8	23	0	
Underground	139	231	0	
Pad Mounted	25	106	0	
Sub-Total	171	360	0	
Regulators				
Overhead	0	1	0	
Underground	0	0	0	
Pad Mounted	0	0	0	
Sub-Total	0	1	0	
Capacitors				
Overhead	14	41	0	
Underground	0	0	0	
Pad Mounted	1	4	0	
Sub-Total	15	45	0	
Conductors, Cables				
Overhead (Conductor Miles)	452	1,326	0	
Street Lights				
	0	0	0	
Wood Poles				
	4,296	12,642	0	
Total	6,323	18,117	0	

(1) Total inspections may exceed total inventory of an asset as equipment may be inspected twice in a year.
(2) Includes Patrols + Details/Intrusives.

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Bishop District


		1998						
		Condition Rating						
Distribution Equipment	Level 1, 2, 3 Total	% (1)	Level 4 Total	% (1)	Level 5 Total	% (1)	Summary (2)	
							Total	% (1)
Transformers								
Overhead	2,317	100.0%	0	0.0%	0	0.0%	2,317	100.0%
Underground	11	100.0%	0	0.0%	0	0.0%	11	100.0%
Pad Mounted	1,415	100.0%	0	0.0%	0	0.0%	1,415	100.0%
Sub-Total	3,743	100.0%	0	0.0%	0	0.0%	3,743	100.0%
Switching/Protective Devices								
Overhead	23	100.0%	0	0.0%	0	0.0%	23	100.0%
Underground	230	99.6%	1	0.4%	0	0.0%	231	100.0%
Pad Mounted	106	100.0%	0	0.0%	0	0.0%	106	100.0%
Sub-Total	359	99.7%	1	0.3%	0	0.0%	360	100.0%
Regulators								
Overhead	1	100.0%	0	0.0%	0	0.0%	1	100.0%
Underground	0	0.0%	0	0.0%	0	0.0%	0	0.0%
Pad Mounted	0	0.0%	0	0.0%	0	0.0%	0	0.0%
Sub-Total	1	100.0%	0	0.0%	0	0.0%	1	100.0%
Capacitors								
Overhead	41	100.0%	0	0.0%	0	0.0%	41	100.0%
Underground	0	0.0%	0	0.0%	0	0.0%	0	0.0%
Pad Mounted	4	100.0%	0	0.0%	0	0.0%	4	100.0%
Sub-Total	45	100.0%	0	0.0%	0	0.0%	45	100.0%
Conductors, Cables								
Overhead (Conductor Miles)	1,326	100.0%	0	0.0%	0	0.0%	1,326	100.0%
Street Lights								
	0	0.0%	0	0.0%	0	0.0%	0	0.0%
Wood Poles								
	12,626	99.9%	16	0.1%	0	0.0%	12,642	100.0%
Total	18,100	99.9%	17	0.1%	0	0.0%	18,117	100.0%
		(1) Percentage of Total Completed Inspections						
		(2) Total condition rating exceeds total inventory as it includes patrol and detailed/intrusive inspections.						

**General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Bishop District**

		1998				Corrective Action			
		Level 4		Balance		Level 5		Balance	
Distribution Equipment	Scheduled	Completed	Remaining	% (1)	Scheduled	Completed	Remaining	% (1)	
Transformers									
Overhead	1	1	0	0.0%	0	0	0	0.0%	
Underground	0	0	0	0.0%	0	0	0	0.0%	
Pad Mounted	0	0	0	0.0%	0	0	0	0.0%	
Sub-Total	1	1	0	0.0%	0	0	0	0.0%	
Switching/Protective Devices									
Overhead	0	0	0	0.0%	0	0	0	0.0%	
Underground	0	1	0	0.0%	0	0	0	0.0%	
Pad Mounted	0	0	0	0.0%	0	0	0	0.0%	
Sub-Total	0	1	0	0.0%	0	0	0	0.0%	
Regulators									
Overhead	0	0	0	0.0%	0	0	0	0.0%	
Underground	0	0	0	0.0%	0	0	0	0.0%	
Pad Mounted	0	0	0	0.0%	0	0	0	0.0%	
Sub-Total	0	0	0	0.0%	0	0	0	0.0%	
Capacitors									
Overhead	0	0	0	0.0%	0	0	0	0.0%	
Underground	0	0	0	0.0%	0	0	0	0.0%	
Pad Mounted	0	0	0	0.0%	0	0	0	0.0%	
Sub-Total	0	0	0	0.0%	0	0	0	0.0%	
Conductors, Cables									
Overhead (Conductor Miles)	0	0	0	0.0%	0	0	0	0.0%	
Street Lights									
	0	0	0	0.0%	0	0	0	0.0%	
Wood Poles									
	0	52	0	0.0%	0	0	0	0.0%	
Total	1	54	0	0.0%	0	0	0	0.0%	
(1) Percentage of remaining Corrective Actions									

**General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Bishop District**

Distribution Equipment	1999 Inspections					1999 Corrective Actions		
	Detail/Intr	1999 Planned		Total	'98 Balance	1999	Total	
	'98 Balance Remaining	Patrol (1)	Intrusive	Planned	Remaining	Planned (2)	Planned	
Transformers								
Overhead	0	0	0	0	0	0	0	
Underground	0	0	10	10	0	0	0	
Pad Mounted	0	0	33	33	0	0	0	
Sub-Total	0	0	43	43	0	0	0	
Switching/Protective Devices								
Overhead	0	0	0	0	0	0	0	
Underground	0	0	43	43	0	0	0	
Pad Mounted	0	0	16	16	0	0	0	
Sub-Total	0	0	59	59	0	0	0	
Regulators								
Overhead	0	0	0	0	0	0	0	
Underground	0	0	0	0	0	0	0	
Pad Mounted	0	0	0	0	0	0	0	
Sub-Total	0	0	0	0	0	0	0	
Capacitors								
Overhead	0	0	0	0	0	0	0	
Underground	0	0	0	0	0	0	0	
Pad Mounted	0	0	0	0	0	0	0	
Sub-Total	0	0	0	0	0	0	0	
Conductors, Cables								
Overhead (Conductor Miles)	0	0	0	0	0	0	0	
Street Lights								
	N/A	494	N/A	494	0	0	0	
Wood Poles								
	0	0	0	0	0	3	3	
Total	0	494	102	596	0	3	3	
(1) District is not required to patrol circuits in 1999. 100% of street lights are planned to be patrolled in 1999.								
(2) Corrective actions planned to be completed in 1999 based on items found through previous inspections.								



General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Ridgecrest District

		Inspection Cycles						1998		Circuits				
		(Maximum Intervals in Years)												
Distribution Equipment	Patrol	Urban		Rural		Detailed		Instructive		Total Inventory	Total Circuits	Required	Patrolled (1)	%
		Urban	Rural	Urban	Rural	Urban	Rural	Urban	Rural					
Transformers														
Overhead	1	2	5	5	5	5	--	--	4,829					
Underground	1	2	3	3	3	3	--	--	401					
Pad Mounted	1	2	5	5	5	5	--	--	820					
Sub-Total									6,050					
Switching/Protective Devices														
Overhead	1	2	5	5	5	5	--	--	33					
Underground	1	2	3	3	3	3	--	--	134					
Pad Mounted	1	2	5	5	5	5	--	--	72					
Sub-Total									239					
Regulators														
Overhead	1	2	5	5	5	5	--	--	2					
Underground	1	2	3	3	3	3	--	--	0					
Pad Mounted	1	2	5	5	5	5	--	--	0					
Sub-Total									2					
Capacitors														
Overhead	1	2	5	5	5	5	--	--	92					
Underground	1	2	3	3	3	3	--	--	0					
Pad Mounted	1	2	5	5	5	5	--	--	0					
Sub-Total									92					
Conductors, Cables														
Overhead (Conductor Miles)	1	2	5	5	5	5	--	--	2,816					
Street Lights	1	2	--	--	--	--	--	--	2,499					
Wood Poles	1	2	--	--	--	--	20	20	20,810					
Total									32,508	50	33	35	100%	
(1) For 1998, SCE patrolled circuits to conduct simple visual inspections of distribution facilities. Underground structures and equipment are not opened on Circuit Patrol Inspections.														

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Ridgecrest District

		1998		
		Inspections (1)(1)(2)		
		Summary		
Distribution Equipment		Planned	Complete	Balance Remaining
Transformers				
Overhead		3,187	3,380	0
Underground		283	312	0
Pad Mounted		632	694	0
	Sub-Total	4,102	4,386	0
Switching/Protective Devices				
Overhead		22	23	0
Underground		159	165	0
Pad Mounted		48	100	0
	Sub-Total	229	288	0
Regulators				
Overhead		1	1	0
Underground		0	0	0
Pad Mounted		0	0	0
	Sub-Total	1	1	0
Capacitors				
Overhead		61	64	0
Underground		0	0	0
Pad Mounted		0	0	0
	Sub-Total	61	64	0
Conductors, Cables				
Overhead (Conductor Miles)		1,859	1,971	0
Street Lights		0	2,499	0
Wood Poles		13,735	14,649	0
	Total	19,986	23,859	0
(1) Total inspections may exceed total inventory of an asset as equipment may be inspected twice in a year. (2) Includes Patrols + Details/Intrusives.				

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Ridgecrest District


		1998					Condition Rating		
Distribution Equipment	Total	Level 1, 2, 3		Level 4		Level 5		Summary (2)	
		Total	% (1)	Total	% (1)	Total	% (1)	Total	% (1)
Transformers									
Overhead	3,379	100.0%	0	0.0%	1	0.0%	3,380	100.0%	
Underground	312	100.0%	0	0.0%	0	0.0%	312	100.0%	
Pad Mounted	694	100.0%	0	0.0%	0	0.0%	694	100.0%	
Sub-Total	4,385	100.0%	0	0.0%	1	0.0%	4,386	100.0%	
Switching/Protective Devices									
Overhead	22	95.7%	1	4.3%	0	0.0%	23	100.0%	
Underground	164	99.4%	0	0.0%	1	0.6%	165	100.0%	
Pad Mounted	100	100.0%	0	0.0%	0	0.0%	100	100.0%	
Sub-Total	286	99.3%	1	0.3%	1	0.3%	288	100.0%	
Regulators									
Overhead	1	100.0%	0	0.0%	0	0.0%	1	100.0%	
Underground	0	0.0%	0	0.0%	0	0.0%	0	0.0%	
Pad Mounted	0	0.0%	0	0.0%	0	0.0%	0	0.0%	
Sub-Total	1	100.0%	0	0.0%	0	0.0%	1	100.0%	
Capacitors									
Overhead	57	89.1%	7	10.9%	0	0.0%	64	100.0%	
Underground	0	0.0%	0	0.0%	0	0.0%	0	0.0%	
Pad Mounted	0	0.0%	0	0.0%	0	0.0%	0	0.0%	
Sub-Total	57	89.1%	7	10.9%	0	0.0%	64	100.0%	
Conductors, Cables									
Overhead (Conductor Miles)	1,971	100.0%	0	0.0%	0	0.0%	1,971	100.0%	
Street Lights									
	2,499	100.0%	0	0.0%	0	0.0%	2,499	100.0%	
Wood Poles									
	14,649	100.0%	0	0.0%	0	0.0%	14,649	100.0%	
Total	23,849	100.0%	8	0.0%	2	0.0%	23,859	100.0%	
		(1) Percentage of Total Completed Inspections							
		(2) Total condition rating exceeds total inventory as it includes patrol and detailed/intrusive inspections.							

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Ridgecrest District

		1998				Corrective Action			
		Level 4		Level 5					
Distribution Equipment	Scheduled	Completed	Balance Remaining	% (1)	Scheduled	Completed	Balance Remaining	% (1)	
Transformers									
Overhead	1	1	0	0.0%	0	1	0	0.0%	
Underground	0	0	0	0.0%	0	0	0	0.0%	
Pad Mounted	0	0	0	0.0%	0	0	0	0.0%	
Sub-Total	1	1	0	0.0%	0	1	0	0.0%	
Switching/Protective Devices									
Overhead	0	1	0	0.0%	0	0	0	0.0%	
Underground	1	2	0	0.0%	0	0	0	0.0%	
Pad Mounted	0	0	0	0.0%	0	0	0	0.0%	
Sub-Total	1	3	0	0.0%	0	0	0	0.0%	
Regulators									
Overhead	0	0	0	0.0%	0	0	0	0.0%	
Underground	0	0	0	0.0%	0	0	0	0.0%	
Pad Mounted	0	0	0	0.0%	0	0	0	0.0%	
Sub-Total	0	0	0	0.0%	0	0	0	0.0%	
Capacitors									
Overhead	0	14	0	0.0%	0	0	0	0.0%	
Underground	0	0	0	0.0%	0	0	0	0.0%	
Pad Mounted	0	0	0	0.0%	0	0	0	0.0%	
Sub-Total	0	14	0	0.0%	0	0	0	0.0%	
Conductors, Cables									
Overhead (Conductor Miles)	0	0	0	0.0%	0	0	0	0.0%	
Street Lights									
	0	0	0	0.0%	0	0	0	0.0%	
Wood Poles									
	0	21	0	0.0%	0	1	0	0.0%	
Total	2	39	0	0.0%	0	2	0	0.0%	
		(1) Percentage of remaining Corrective Actions							

**General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Ridgecrest District**

	1999						
	Inspections			Corrective Actions			
	Detail/Intru '98 Balance Remaining	1999 Planned Patrol (1)	Detail/ Intrusive Planned	Total Planned	'98 Balance Remaining	1999 Planned (2)	Total Planned
Distribution Equipment							
Transformers							
Overhead	0	1,642	0	1,642	0	0	0
Underground	0	136	272	408	0	0	0
Pad Mounted	0	279	48	327	0	0	0
Sub-Total	0	2,057	320	2,377	0	0	0
Switching/Protective Devices							
Overhead	0	11	0	11	0	0	0
Underground	0	46	44	90	0	0	0
Pad Mounted	0	24	13	37	0	0	0
Sub-Total	0	81	57	138	0	0	0
Regulators							
Overhead	0	1	0	1	0	0	0
Underground	0	0	0	0	0	0	0
Pad Mounted	0	0	0	0	0	0	0
Sub-Total	0	1	0	1	0	0	0
Capacitors							
Overhead	0	31	0	31	0	0	0
Underground	0	0	0	0	0	0	0
Pad Mounted	0	0	0	0	0	0	0
Sub-Total	0	31	0	31	0	0	0
Conductors, Cables							
Overhead (Conductor Miles)	0	957	0	957	0	0	0
Street Lights							
N/A	N/A	0	N/A	0	0	0	0
Wood Poles							
0	0	7,075	0	7,075	0	2	2
Total	0	10,203	377	10,580	0	2	2
<p>(1) District is required to patrol 34% of its circuits in 1999. No street lights are planned to be patrolled in 1999. (2) Corrective actions planned to be completed in 1999 based on items found through previous inspections.</p>							



**General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Blythe District**

		1998				
		Inspections				
		Patrol				
Distribution Equipment	Planned (1)	Complete (2)	Balance Remaining	Explanation For Balance (> 0)	Recovery Date	
Transformers						
Overhead	169	3,287	0			
Underground	5	92	0			
Pad Mounted	19	366	0			
Sub-Total	192	3,745	0			
Switching/Protective Devices						
Overhead	8	152	0			
Underground	1	22	0			
Pad Mounted	2	46	0			
Sub-Total	11	220	0			
Regulators						
Overhead	0	4	0			
Underground	0	0	0			
Pad Mounted	0	0	0			
Sub-Total	0	4	0			
Capacitors						
Overhead	4	79	0			
Underground	0	0	0			
Pad Mounted	0	0	0			
Sub-Total	4	79	0			
Conductors, Cables						
Overhead (Conductor Miles)	106	2,070	0			
Street Lights						
	0	1,185	0			
Wood Poles						
	691	13,473	0			
Total	1,005	20,776	0			
<p>(1) Planned Patrol Inspections are based on Required Circuit Patrols (excl Streetlights).</p> <p>Planned amounts are different from 1997 GO 165 Report due to changes in the inventory and the quantity of required circuit patrols</p> <p>(2) Completed Patrol Inspections are based on the percentage of total patrolled circuits (excl Streetlights).</p>						

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Blythe District

		1998		
		Inspections ⁽¹⁾⁽²⁾		
		Summary		
		Planned	Complete	Balance Remaining
Distribution Equipment				
Transformers				
	Overhead	169	3,287	0
	Underground	15	104	0
	Pad Mounted	57	407	0
	Sub-Total	240	3,798	0
Switching/Protective Devices				
	Overhead	8	152	0
	Underground	30	51	0
	Pad Mounted	10	75	0
	Sub-Total	48	278	0
Regulators				
	Overhead	0	4	0
	Underground	0	0	0
	Pad Mounted	0	0	0
	Sub-Total	0	4	0
Capacitors				
	Overhead	4	79	0
	Underground	0	0	0
	Pad Mounted	0	0	0
	Sub-Total	4	79	0
Conductors, Cables				
	Overhead (Conductor Miles)	106	2,070	0
Street Lights				
		0	1,185	0
Wood Poles				
		986	14,050	0
	Total	1,385	21,464	0
		(1) Total inspections may exceed total inventory of an asset as equipment may be inspected twice in a year.		
		(2) Includes Patrols + Details/Intrusives.		

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Blythe District

		1998						
		Condition Rating						
		Level 1, 2, 3	Level 4	Level 5	Summary	Total	%	(a)
Distribution Equipment		Total	% (b)	Total	% (b)	Total	% (b)	Total
Transformers								
Overhead		3,287	100.0%	0	0.0%	0	0.0%	3,287
Underground		104	100.0%	0	0.0%	0	0.0%	104
Pad Mounted		407	100.0%	0	0.0%	0	0.0%	407
	Sub-Total	3,798	100.0%	0	0.0%	0	0.0%	3,798
Switching/Protective Devices								
Overhead		152	100.0%	0	0.0%	0	0.0%	152
Underground		51	100.0%	0	0.0%	0	0.0%	51
Pad Mounted		75	100.0%	0	0.0%	0	0.0%	75
	Sub-Total	278	100.0%	0	0.0%	0	0.0%	278
Regulators								
Overhead		4	100.0%	0	0.0%	0	0.0%	4
Underground		0	0.0%	0	0.0%	0	0.0%	0
Pad Mounted		0	0.0%	0	0.0%	0	0.0%	0
	Sub-Total	4	100.0%	0	0.0%	0	0.0%	4
Capacitors								
Overhead		79	100.0%	0	0.0%	0	0.0%	79
Underground		0	0.0%	0	0.0%	0	0.0%	0
Pad Mounted		0	0.0%	0	0.0%	0	0.0%	0
	Sub-Total	79	100.0%	0	0.0%	0	0.0%	79
Conductors, Cables								
Overhead (Conductor Miles)		2,070	100.0%	0	0.0%	0	0.0%	2,070
Street Lights								
		1,185	100.0%	0	0.0%	0	0.0%	1,185
Wood Poles								
		14,003	99.7%	44	0.3%	3	0.0%	14,050
	Total	21,417	99.8%	44	0.2%	3	0.0%	21,464
		(1) Percentage of Total Completed Inspections						
		(2) Total condition rating exceeds total inventory as it includes patrol and detailed/trustive inspections.						

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Blythe District

		1998						
		Corrective Action						
		Level 4			Level 5			
Distribution Equipment	Scheduled	Completed	Balance		Scheduled	Completed	Balance	
			Remaining	% (1)			Remaining	% (1)
Transformers								
Overhead	0	0	0	0.0%	0	0	0	0.0%
Underground	0	0	0	0.0%	0	0	0	0.0%
Pad Mounted	0	0	0	0.0%	0	0	0	0.0%
Sub-Total	0	0	0	0.0%	0	0	0	0.0%
Switching/Protective Devices								
Overhead	0	0	0	0.0%	0	0	0	0.0%
Underground	0	0	0	0.0%	0	0	0	0.0%
Pad Mounted	0	0	0	0.0%	0	0	0	0.0%
Sub-Total	0	0	0	0.0%	0	0	0	0.0%
Regulators								
Overhead	0	0	0	0.0%	0	0	0	0.0%
Underground	0	0	0	0.0%	0	0	0	0.0%
Pad Mounted	0	0	0	0.0%	0	0	0	0.0%
Sub-Total	0	0	0	0.0%	0	0	0	0.0%
Capacitors								
Overhead	0	0	0	0.0%	0	0	0	0.0%
Underground	0	0	0	0.0%	0	0	0	0.0%
Pad Mounted	0	0	0	0.0%	0	0	0	0.0%
Sub-Total	0	0	0	0.0%	0	0	0	0.0%
Conductors, Cables								
Overhead (Conductor Miles)	0	0	0	0.0%	0	0	0	0.0%
Street Lights								
	0	0	0	0.0%	0	0	0	0.0%
Wood Poles								
	0	50	0	0.0%	0	0	0	0.0%
Total	0	50	0	0.0%	0	0	0	0.0%
		(1) Percentage of remaining Corrective Actions						

**General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Blythe District**

				1998			Corrective Action Summary ⁽¹⁾		Recovery Date
Distribution Equipment	Scheduled	Completed	Balance Remaining	% ⁽¹⁾	Explanation For Balance (> 0)				
Transformers									
Overhead	0	0	0	0.0%					
Underground	0	0	0	0.0%					
Pad Mounted	0	0	0	0.0%					
Sub-Total	0	0	0	0.0%					
Switching/Protective Devices									
Overhead	0	0	0	0.0%					
Underground	0	0	0	0.0%					
Pad Mounted	0	0	0	0.0%					
Sub-Total	0	0	0	0.0%					
Regulators									
Overhead	0	0	0	0.0%					
Underground	0	0	0	0.0%					
Pad Mounted	0	0	0	0.0%					
Sub-Total	0	0	0	0.0%					
Capacitors									
Overhead	0	0	0	0.0%					
Underground	0	0	0	0.0%					
Pad Mounted	0	0	0	0.0%					
Sub-Total	0	0	0	0.0%					
Conductors, Cables									
Overhead (Conductor Miles)	0	0	0	0.0%					
Street Lights									
	0	0	0	0.0%					
Wood Poles									
	0	50	0	0.0%					
Total	0	50	0	0.0%					
				(1) Percentage of remaining Corrective Actions					
				(2) Summary = Condition Level 4 + Condition Level 5 from Page 6.					

General Order No. 165, Inspection Cycles For Electric Distribution Facilities
1998 Annual Report
Blythe District

	1999				Corrective Actions		
	Detail/Intru '98 Balance Remaining	1999 Planned Patrol (1)	Detail/ Intrusive	Total Planned	'98 Balance Remaining	1999 Planned	Total Planned
Distribution Equipment							
Transformers							
Overhead	0	0	0	0	0	0	0
Underground	0	0	40	40	0	0	0
Pad Mounted	0	0	29	29	0	0	0
Sub-Total	0	0	69	69	0	0	0
Switching/Protective Devices							
Overhead	0	0	0	0	0	0	0
Underground	0	0	8	8	0	0	0
Pad Mounted	0	0	4	4	0	0	0
Sub-Total	0	0	12	12	0	0	0
Regulators							
Overhead	0	0	0	0	0	0	0
Underground	0	0	0	0	0	0	0
Pad Mounted	0	0	0	0	0	0	0
Sub-Total	0	0	0	0	0	0	0
Capacitors							
Overhead	0	0	0	0	0	0	0
Underground	0	0	0	0	0	0	0
Pad Mounted	0	0	0	0	0	0	0
Sub-Total	0	0	0	0	0	0	0
Conductors, Cables							
Overhead (Conductor Miles)	0	0	0	0	0	0	0
Street Lights							
	N/A	0	N/A	0	0	0	0
Wood Poles							
Overhead	0	0	0	0	0	1	1
Total	0	0	81	81	0	1	1
(1) District is not required to patrol any of its circuits in 1999. No street lights are planned to be patrolled in 1999.							
(2) Corrective actions planned to be completed in 1999 based on items found through previous inspections.							